


Summer

2Q/2000 Performance Indicators

Licensee's General Comments: Changed data to reflect more conservative administrative limit as a result of FAQ.

Unplanned Scrams per 7000 Critical Hrs

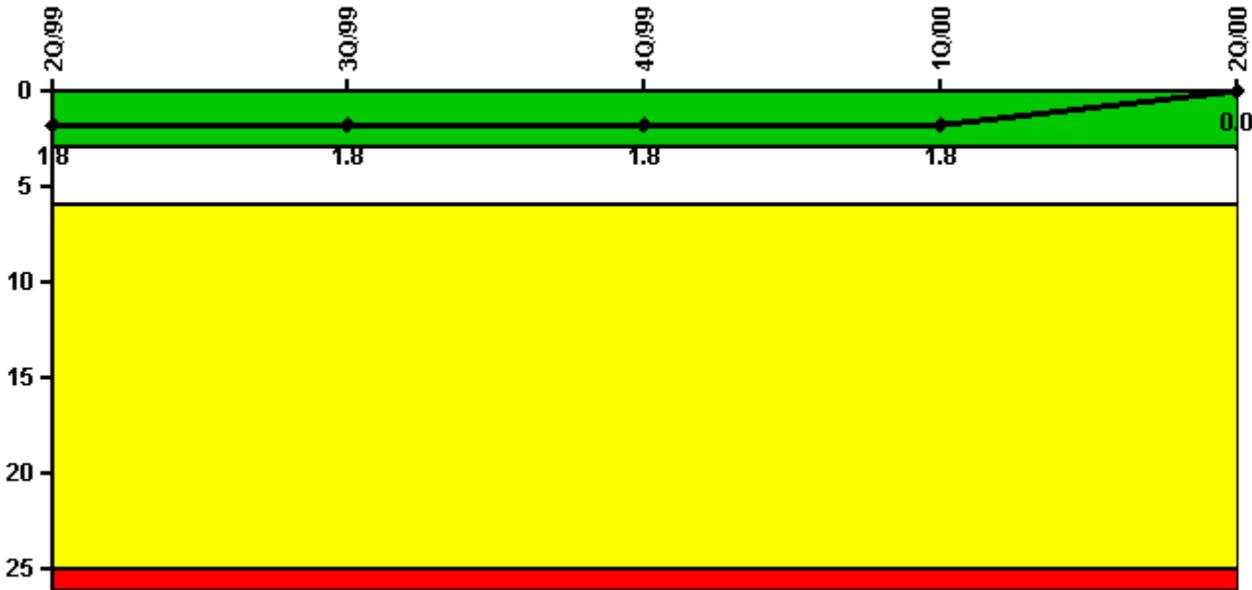


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned scrams	2.0	0	0	0	0
Critical hours	1253.3	2208.0	2209.0	2184.0	2183.0
Indicator value	1.8	1.8	1.8	1.8	0

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

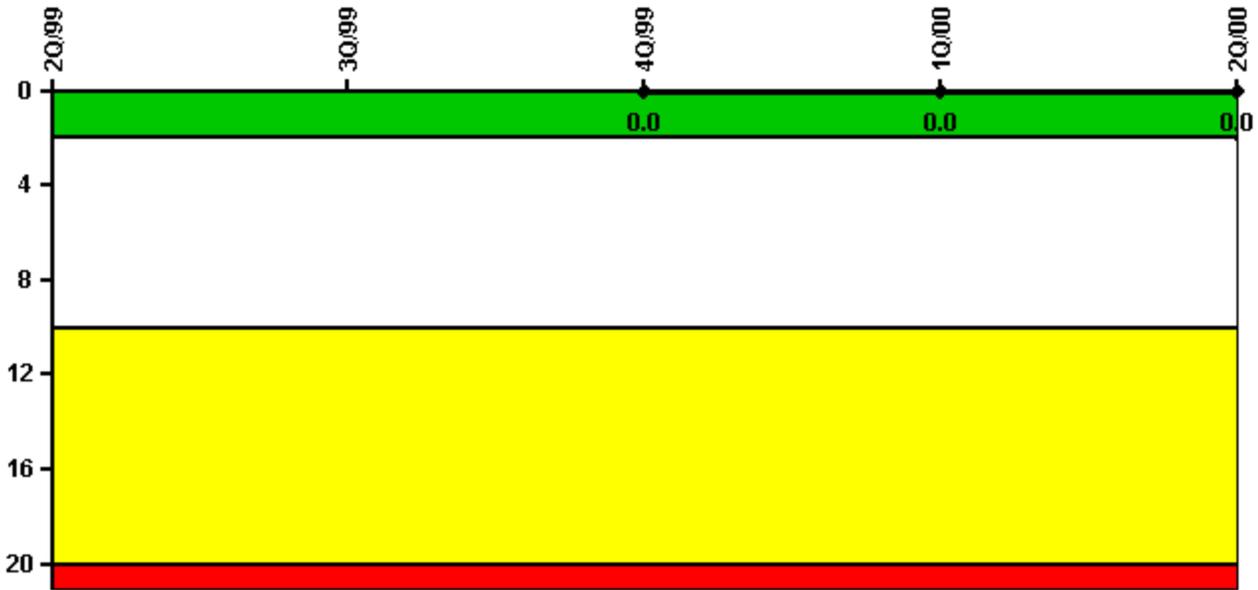


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Scrams	0	0	0	0	0
Indicator value			0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

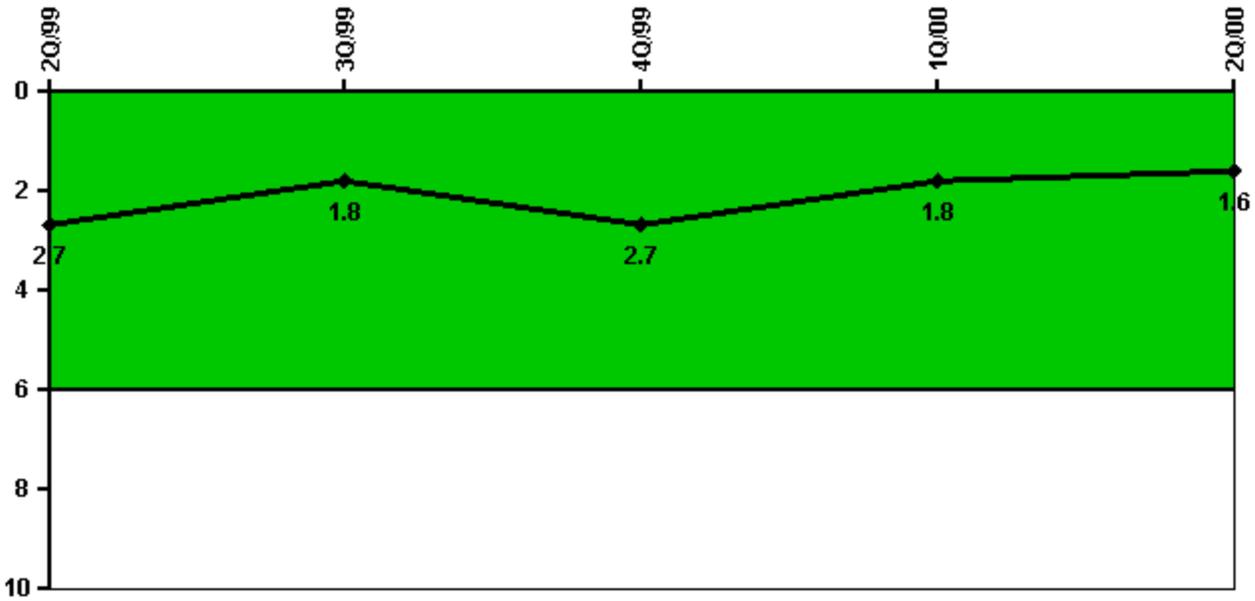


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned power changes	1.0	0	1.0	0	1.0
Critical hours	1253.3	2208.0	2209.0	2184.0	2183.0
Indicator value	2.7	1.8	2.7	1.8	1.6

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

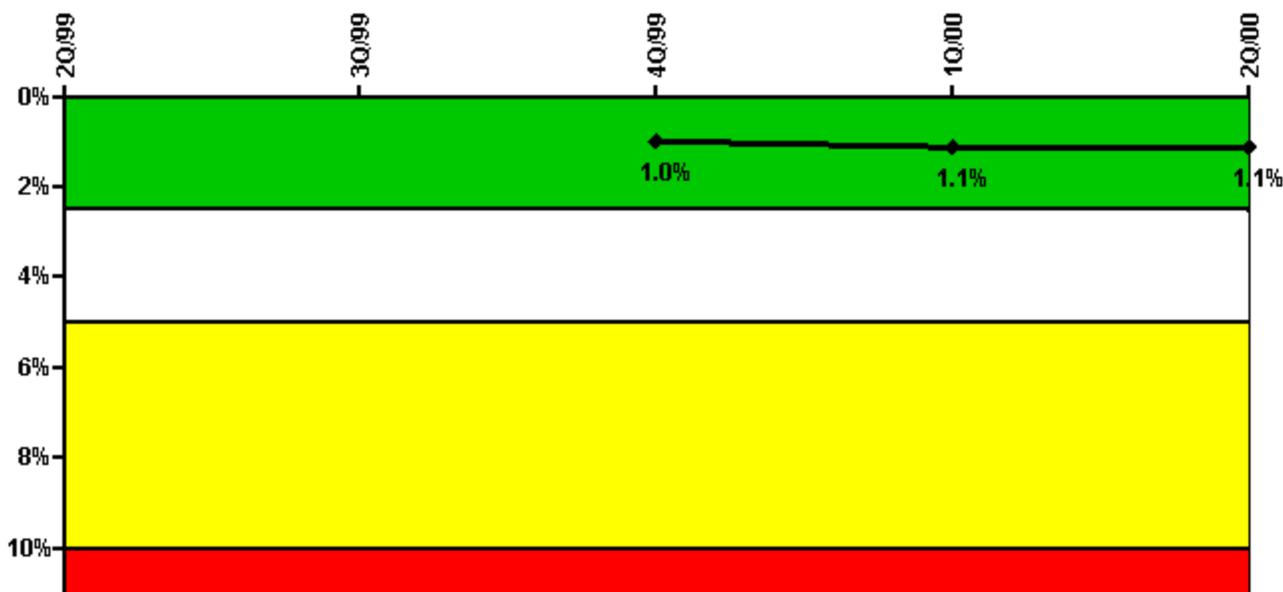

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes


Safety System Unavailability, Emergency AC Power	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	7.60	12.90	0.60	52.30	11.50
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0.60	16.80	12.00	13.60	25.90
Unplanned unavailable hours	0	0	0	0	12.30
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value			1.0%	1.1%	1.1%

Licensee Comments:

4Q/99: Train 2 planned unavailable hours were erroneously reported under Train 1. This had no impact to the performance indicator.

1Q/99: Train 2 planned unavailable hours were erroneously reported under Train 1 planned unavailable hours. This did not impact performance indicator.

Safety System Unavailability, High Pressure Injection System (HPSI)

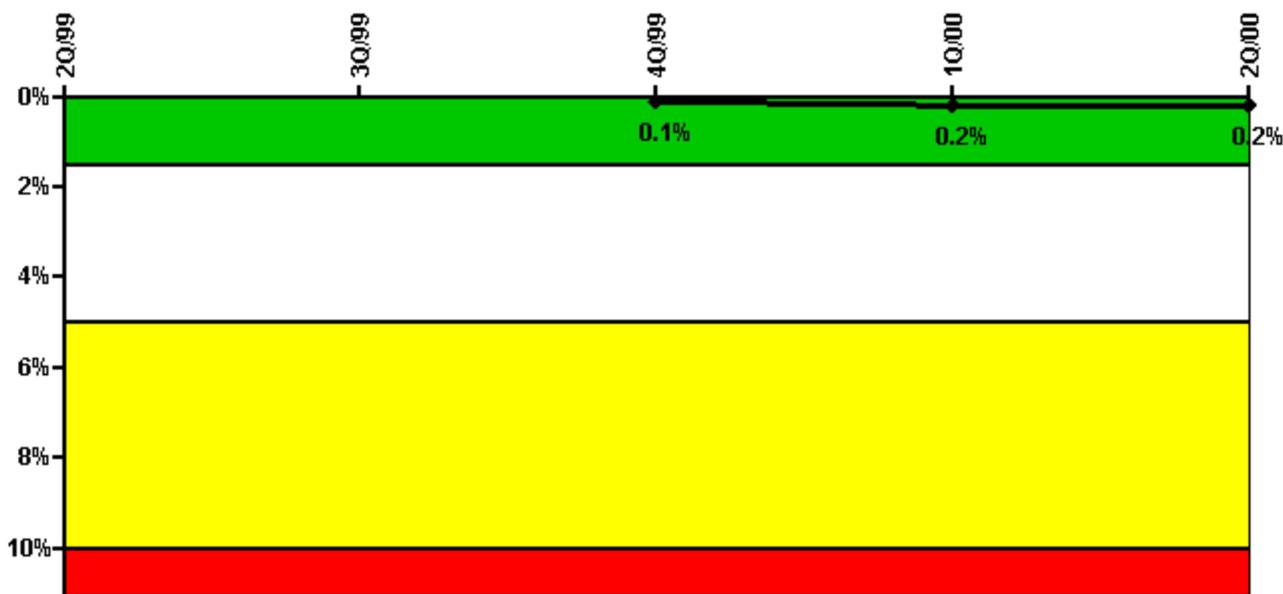

Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	12.25	3.50	3.50	14.20	3.25
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1253.30	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	21.50	3.75	3.25	15.55	3.25
Unplanned unavailable hours	0	0	0	0	21.30
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1253.30	2208.00	2209.00	2184.00	2183.00
Indicator value			0.1%	0.2%	0.2%

Licensee Comments:

1Q/00: It was determined that support system unavailability initially was not captured. Planned unavailable hours have been corrected to account for unavailability from the "B" CCW Train.

Safety System Unavailability, Heat Removal System (AFW)



Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	10.30	0	8.50	0	2.00
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1253.30	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0	0	13.30	0	15.80
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1253.30	2208.00	2209.00	2184.00	2183.00
Train 3					
Planned unavailable hours	14.60	0	10.60	0	7.50
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1253.30	2208.00	2209.00	2184.00	2183.00
Indicator value			0.4%	0.4%	0.3%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System



Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	5.90	11.50	23.95	0.25	0.25
Unplanned unavailable hours	5.80	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0.10	9.60	7.05	12.55	0.25
Unplanned unavailable hours	4.00	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value			0.5%	0.4%	0.4%

Licensee Comments:

1Q/00: It was determined that support system unavailability initially was not captured. Planned unavailable hours have been corrected to account for unavailability from the "B" CCW Train.

Safety System Functional Failures (PWR)

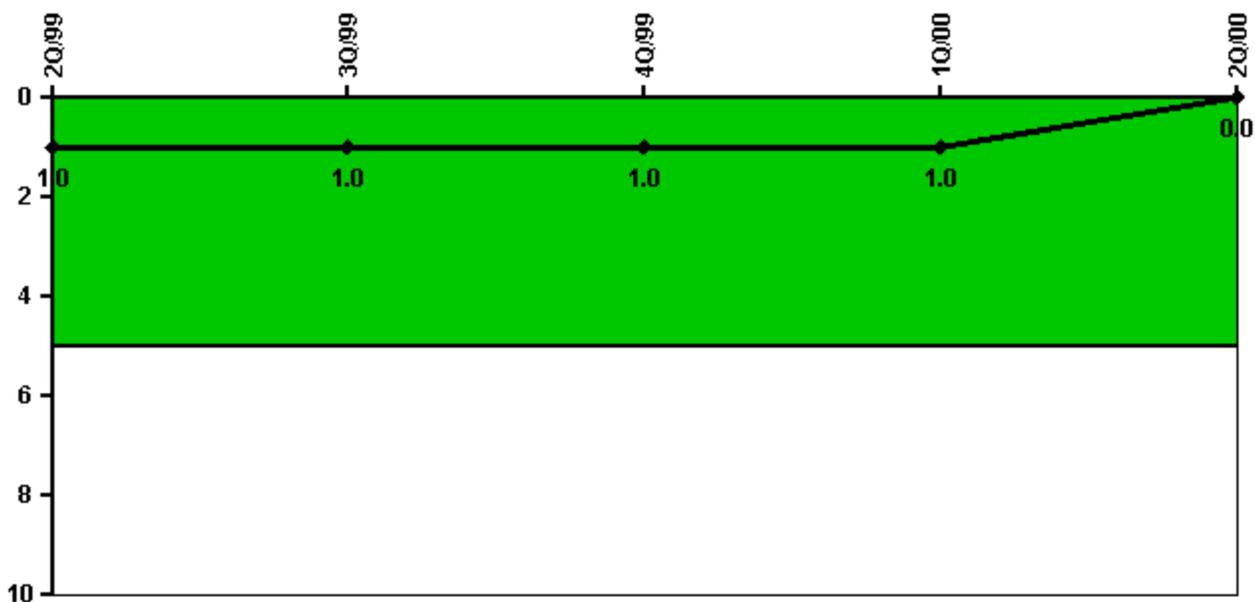


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Safety System Functional Failures	1	0	0	0	0
Indicator value	1	1	1	1	0

Licensee Comments: none

Reactor Coolant System Activity

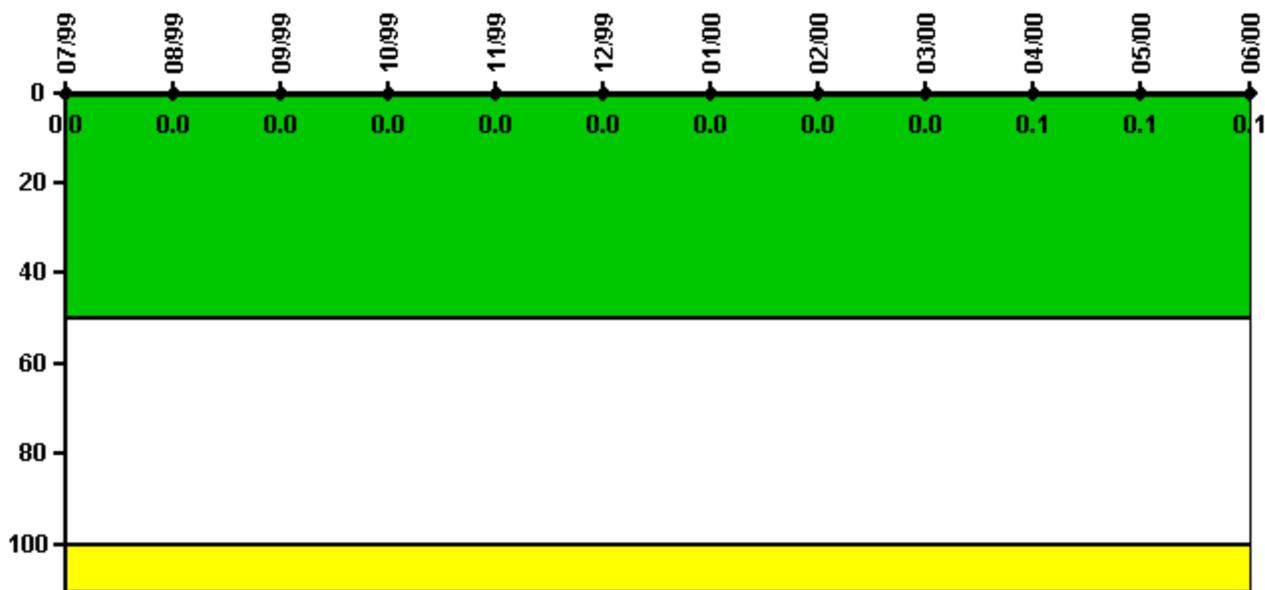

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum activity	0.000288	0.000344	0.000335	0.000327	0.000487	0.000359	0.000382	0.000440	0.000409	0.000504	0.000440	0.000453
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	0.4	0.4	0.4
Indicator value	0	0	0	0	0	0	0	0	0	0.1	0.1	0.1

Licensee Comments:

6/00: Data changed to reflect more restrictive administrative limit.

Reactor Coolant System Leakage

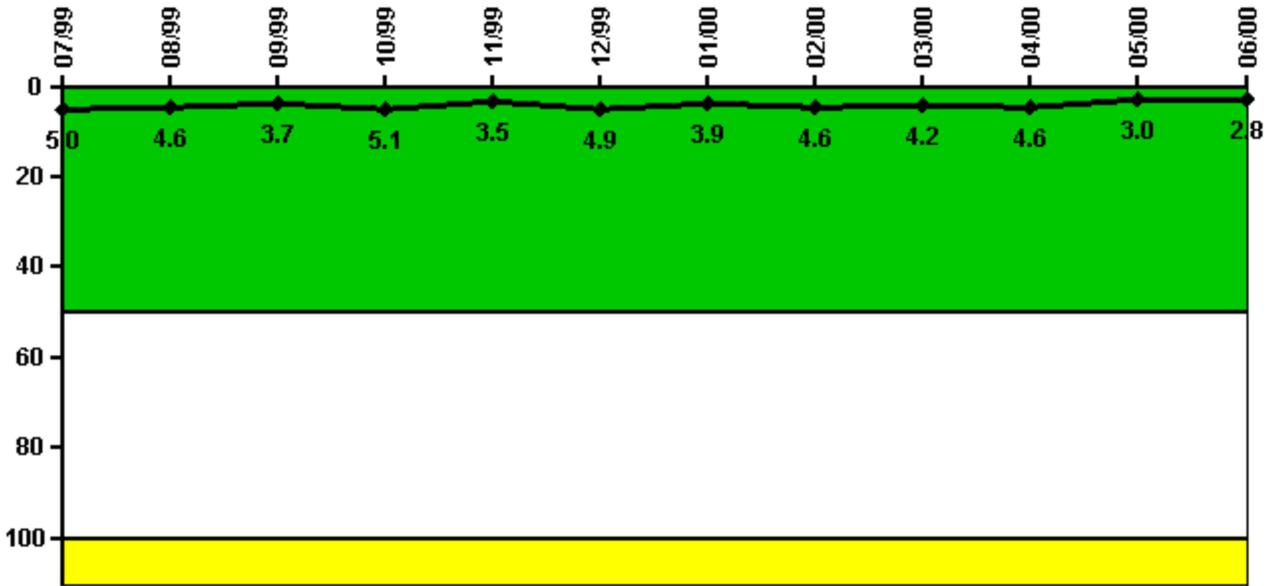


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum leakage	0.500	0.460	0.370	0.510	0.350	0.490	0.390	0.460	0.420	0.460	0.300	0.280
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	5.0	4.6	3.7	5.1	3.5	4.9	3.9	4.6	4.2	4.6	3.0	2.8

Licensee Comments: none

Drill/Exercise Performance

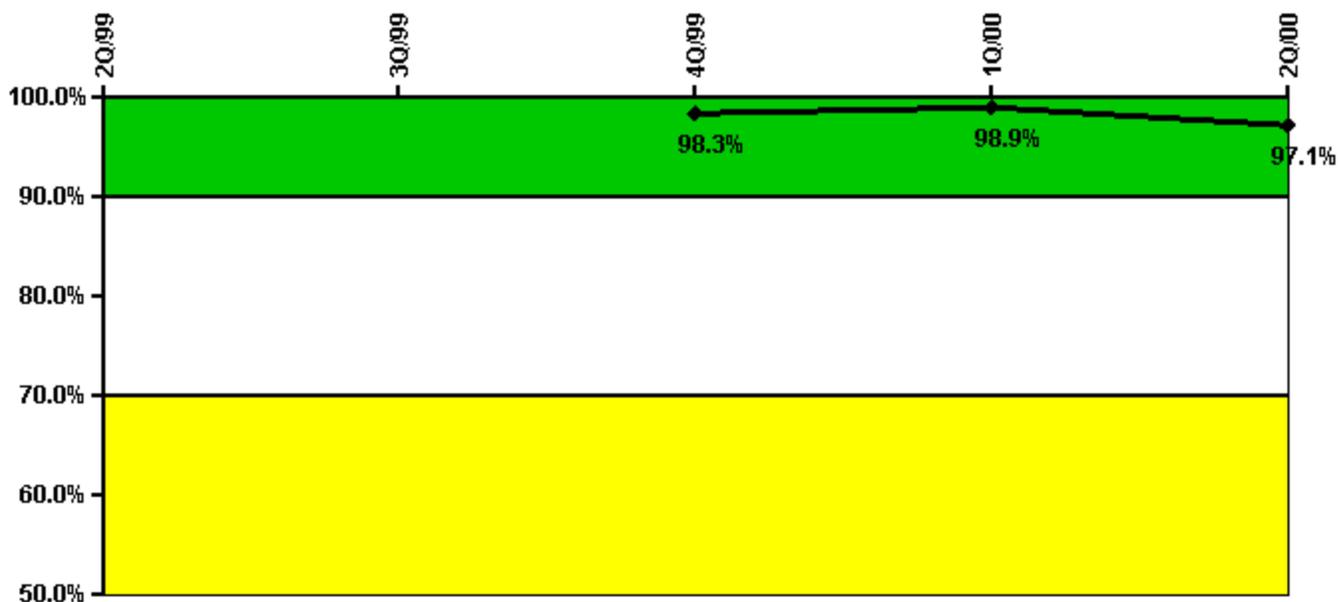


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful opportunities	7.0	14.0	20.0	38.0	16.0
Total opportunities	7.0	14.0	20.0	38.0	18.0
Indicator value			98.3%	98.9%	97.1%

Licensee Comments: none

ERO Drill Participation

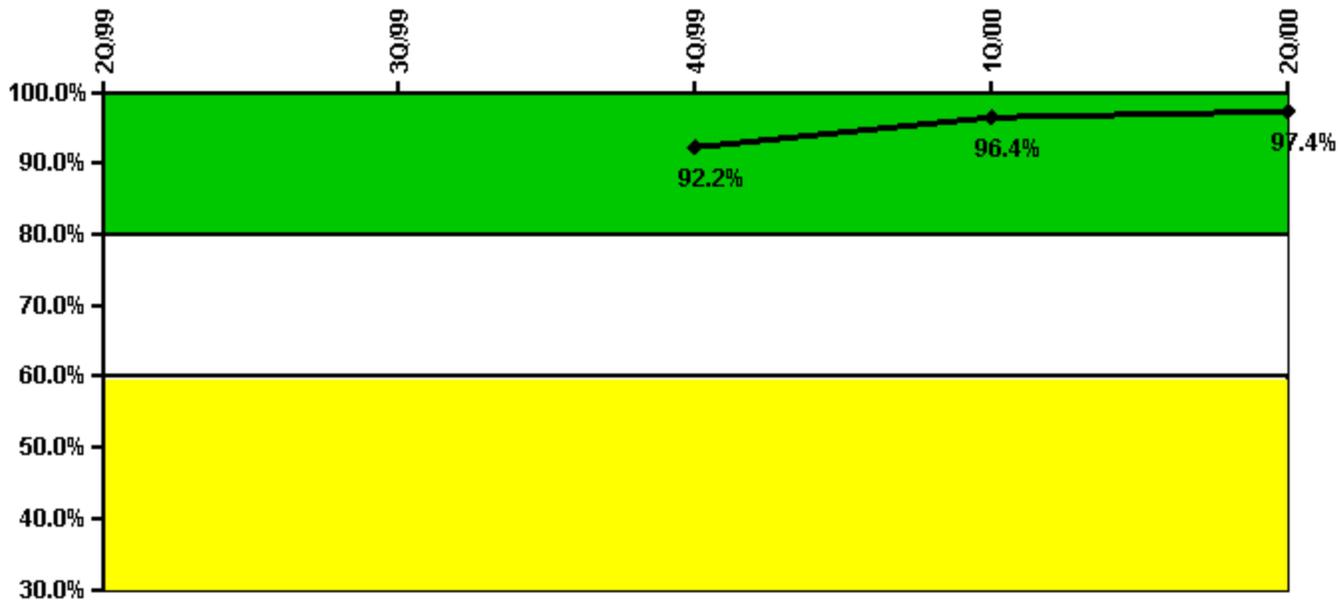


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Participating Key personnel			106.0	107.0	74.0
Total Key personnel			115.0	111.0	76.0
Indicator value			92.2%	96.4%	97.4%

Licensee Comments: none

Alert & Notification System

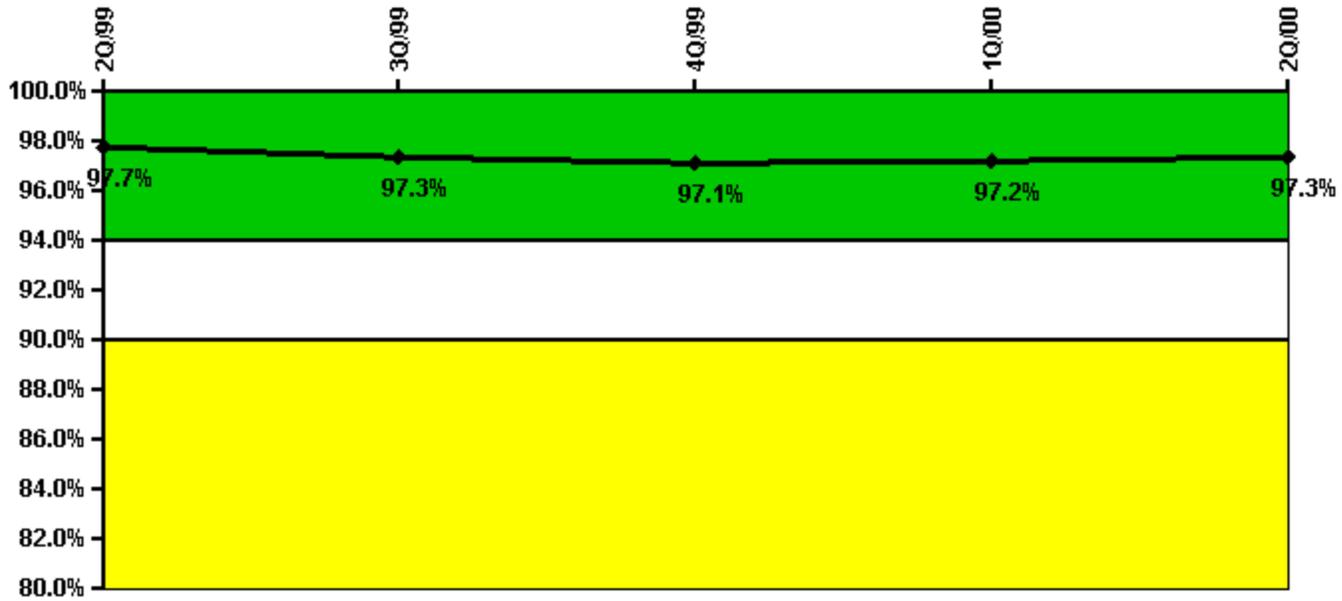


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful siren-tests	1549	1629	1653	1662	1656
Total sirens-tests	1590	1696	1696	1696	1696
Indicator value	97.7%	97.3%	97.1%	97.2%	97.3%

Licensee Comments: none

Occupational Exposure Control Effectiveness

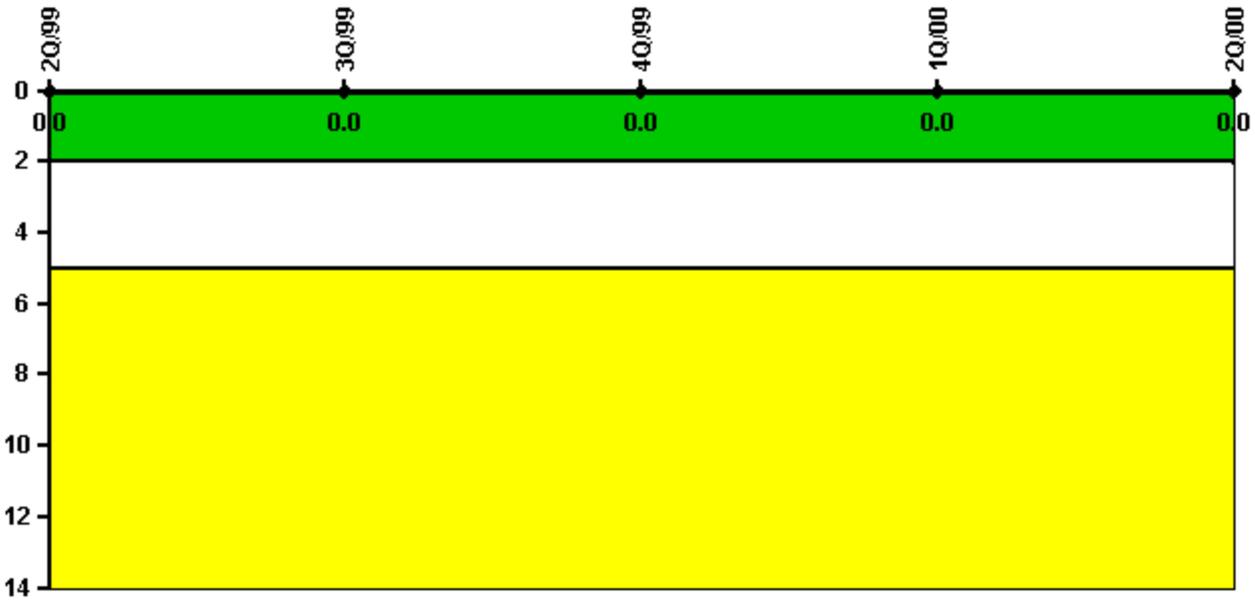


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

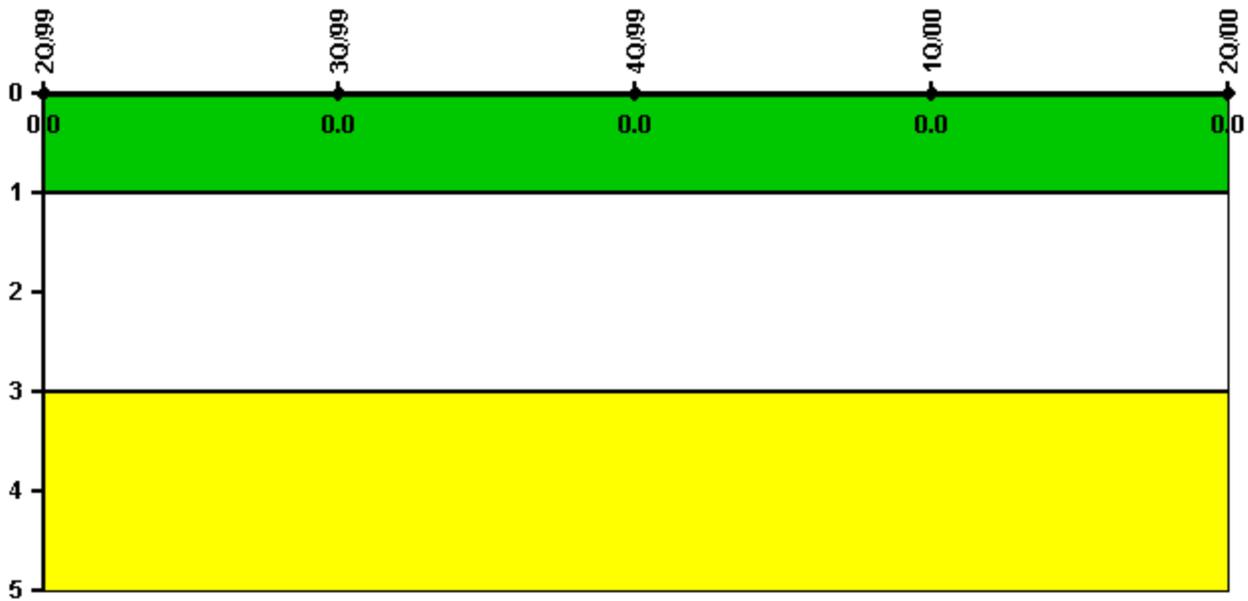


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

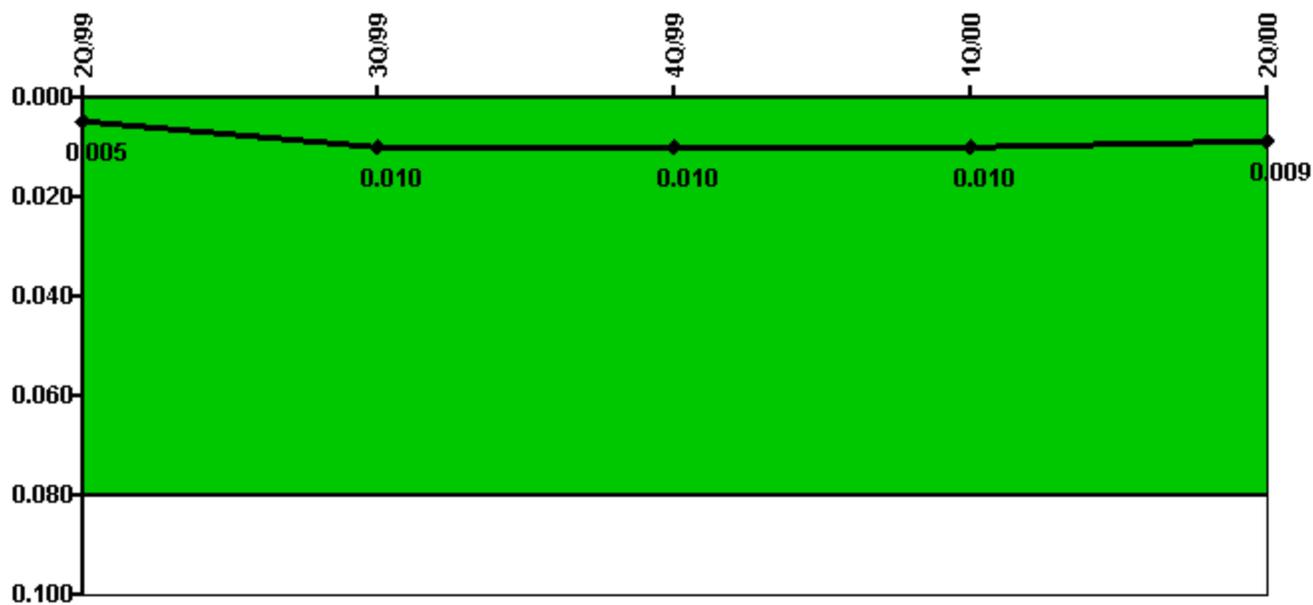

Thresholds: White > 0.080

Notes


Protected Area Security Performance Index	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
IDS compensatory hours	20.70	158.10	17.50	0.90	0
CCTV compensatory hours	0	2.1	0	0	0
IDS normalization factor	1.15	1.15	1.15	1.15	1.15
CCTV normalization factor	1.0	1.0	1.0	1.0	1.0
Index Value	0.005	0.010	0.010	0.010	0.009

Licensee Comments:

2Q/00: It was determined that compensatory hours for the intrusion detection system (IDS) for the Access Portal doors had been reported. However, these doors were not included in the number of IDS zones used in the normalization factor and any compensatory hours should not have been reported for the Access Portal doors.

1Q/00: It was determined that compensatory hours for the intrusion detection system (IDS) for the Access Portal doors had been previously reported. However, these doors were not included in the IDS zones used in the normalization factor and any compensatory hours should not have been reported for the Access Portal doors.

Personnel Screening Program

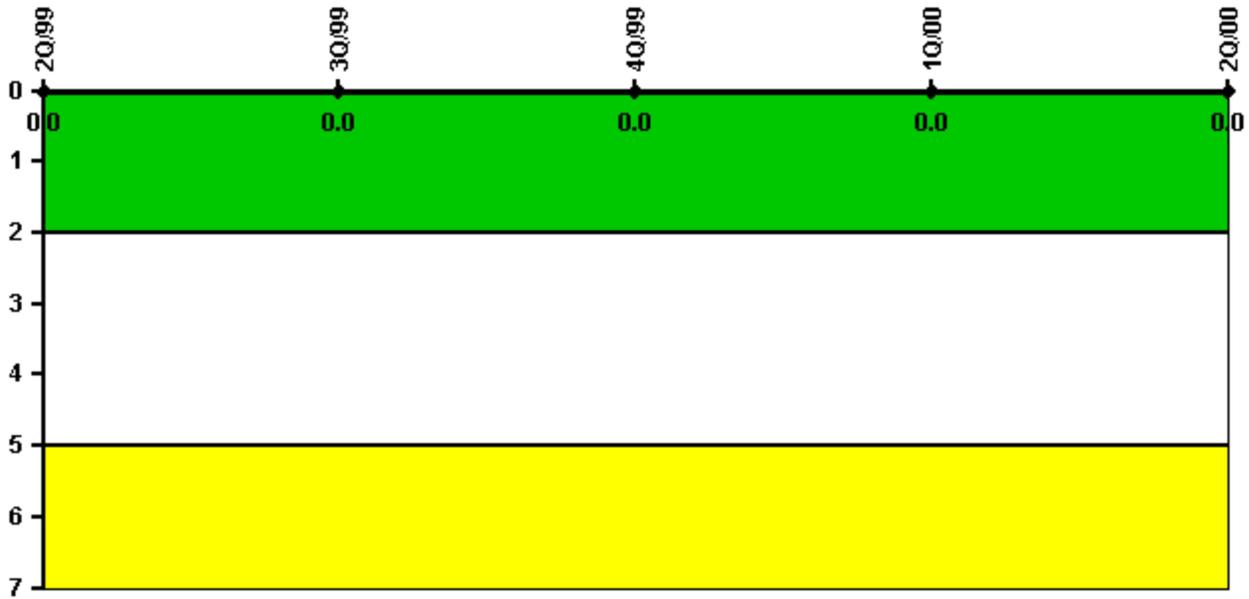


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

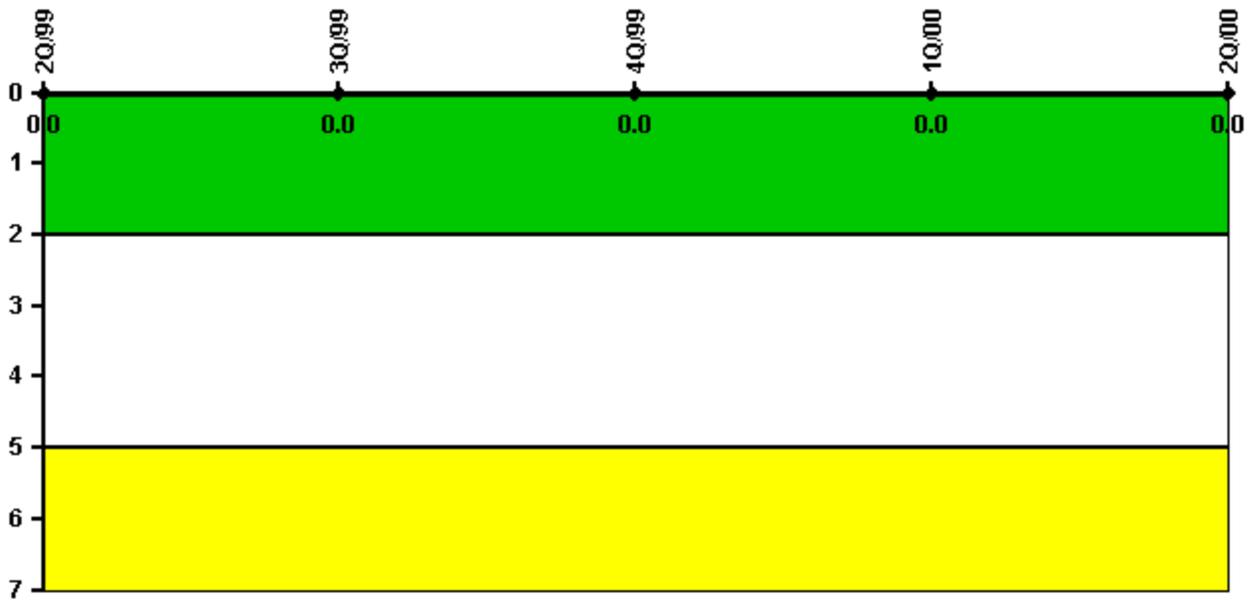

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 1, 2002