


Wolf Creek 1

2Q/2000 Performance Indicators

Licensee's General Comments: Change to Mitigating Systems RHR PI for 1Q2000 to reflect reduced planned unavailability hours from 1.12 hours to 0.21. Change report also reflects the addition of one key ERO person for the ERO Drill Participation Indicator for 2Q2000.

Unplanned Scrams per 7000 Critical Hrs

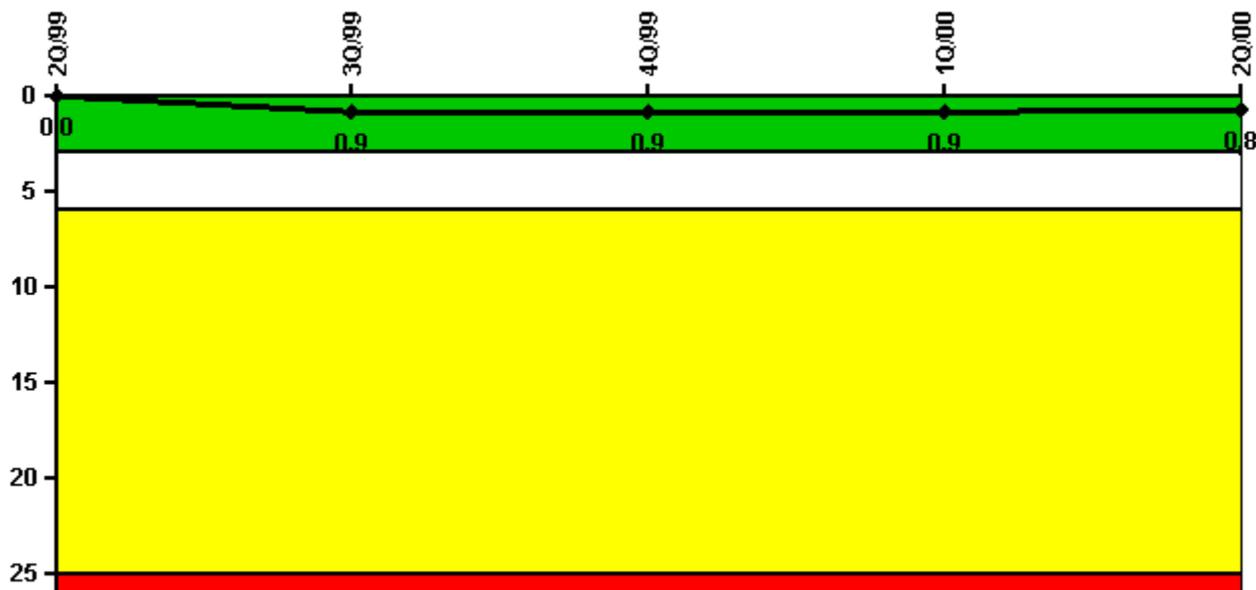


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned scrams	0	1.0	0	0	0
Critical hours	1328.8	2192.0	2209.0	2184.0	2183.0
Indicator value	0	0.9	0.9	0.9	0.8

Licensee Comments: none

Scrams with Loss of Normal Heat Removal

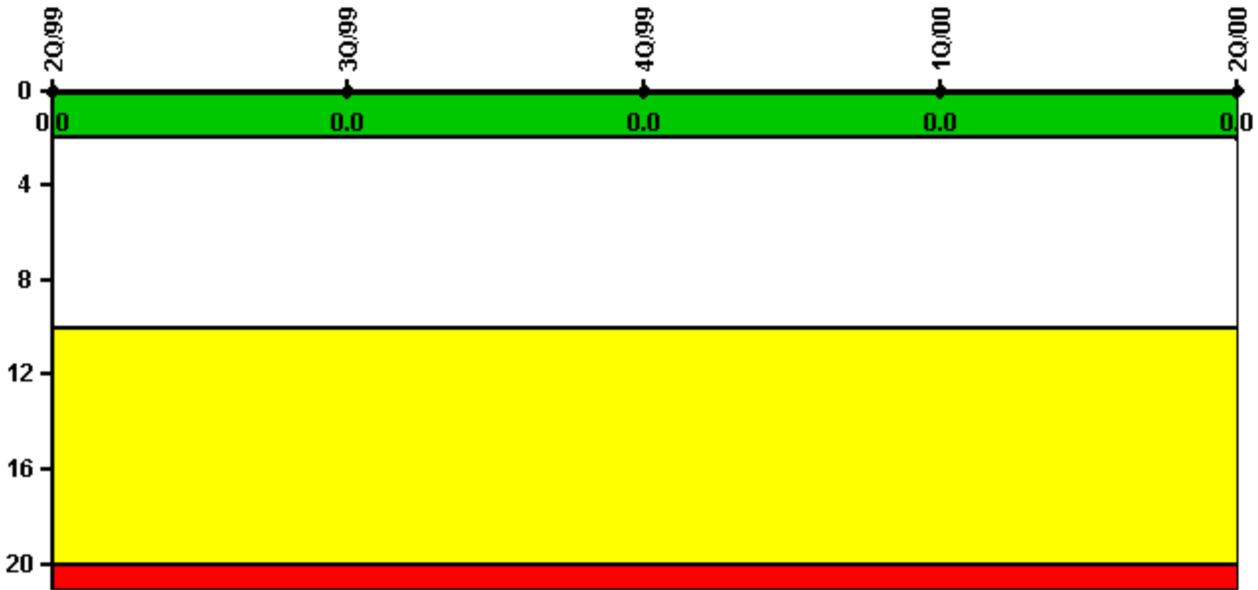


Thresholds: White > 2.0 Yellow > 10.0 Red > 20.0

Notes

Scrams with Loss of Normal Heat Removal	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Scrams	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

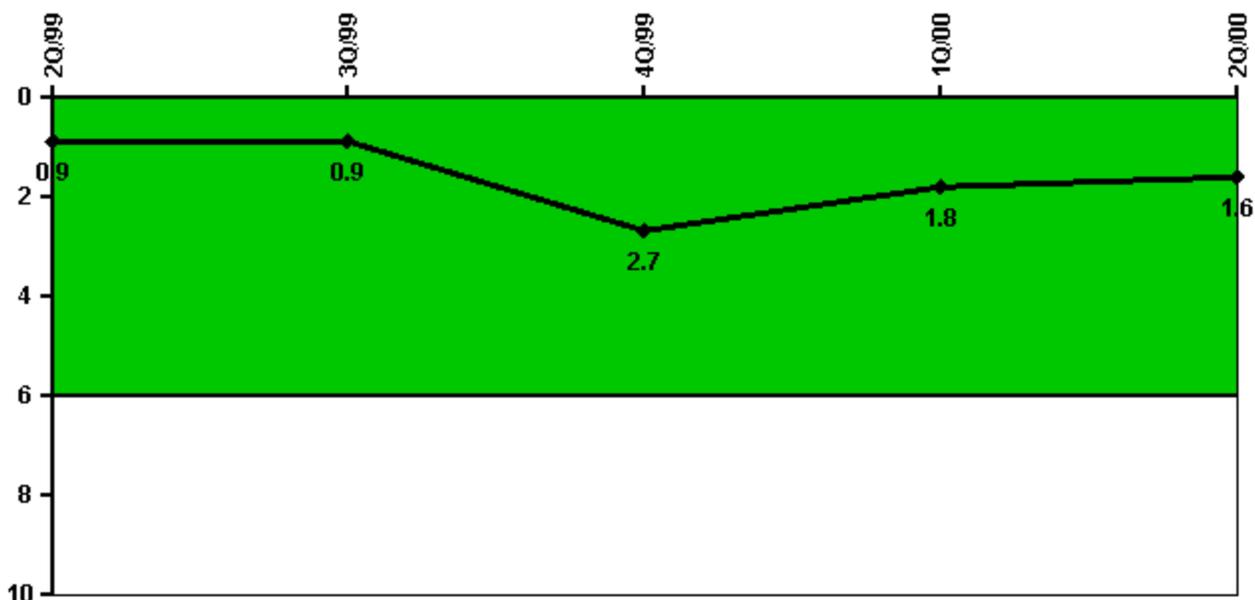


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Unplanned power changes	0	0	2.0	0	0
Critical hours	1328.8	2192.0	2209.0	2184.0	2183.0
Indicator value	0.9	0.9	2.7	1.8	1.6

Licensee Comments: none

Safety System Unavailability, Emergency AC Power

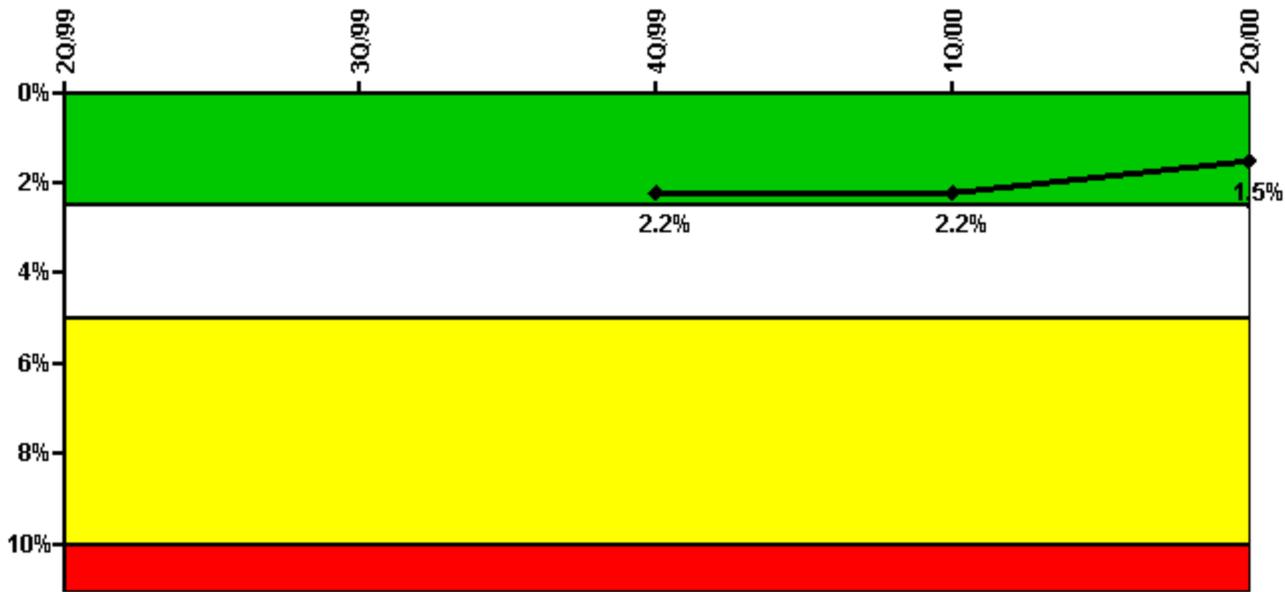

Thresholds: White > 2.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, Emergency AC Power	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	27.89	4.50	35.20	54.64	33.88
Unplanned unavailable hours	0	0	44.40	10.90	4.78
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	395.50
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	3.51	19.89	3.58	38.68	3.64
Unplanned unavailable hours	36.10	0	3.33	0	20.57
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value			2.2%	2.2%	1.5%

Licensee Comments:

1Q/99: First Quarter 1999: WCNOG has removed 395.5 fault exposure hours in accordance with NEI 99-02, Rev. 0 requirements: 1) Four quarters have elapsed since the time of discovery (2/1999), 2) The hours accrued were greater than or equal to 336, 3) Corrective actions associated with the item to preclude recurrence have been completed, and 4) Supplemental inspection activities (50-482/99-17) have been completed and all items closed. Based upon meeting the above requirements, WCNOG removed the hours in May 2000.

Effective Reset Comments:

2Q/00: First Quarter 1999: WCNOG had "removed" 395.5 fault exposure hours in accordance with NEI 99-02, Rev 0 requirements: 1) Four quarters have elapsed since the time of discovery (2/1999), 2) The hours accrued were greater than or equal to 336, 3) Corrective actions associated with the item to preclude recurrence have been completed, and 4) Supplemental inspection activities (50-48/99-17) have been completed and all items closed. Based upon meeting the above requirements, WCNOG removed the hours in May 2000. In accordance with RIS 2001-23, dated December 3, 2001, the hours that were previously removed were "reset" under the new process.

Safety System Unavailability, High Pressure Injection System (HPSI)



Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%

Notes

Safety System Unavailability, High Pressure Injection System (HPSI)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	6.83	2.02	36.27	50.80	33.36
Unplanned unavailable hours	0	0	44.33	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	1.83	7.91	40.98	54.10	18.04
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Train 3					
Planned unavailable hours	0.42	8.00	0.38	61.59	9.34
Unplanned unavailable hours	0	0	44.33	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Train 4					
Planned unavailable hours	0.25	0	0.15	50.49	5.90
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0

Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Indicator value			0.7%	0.9%	0.9%

Licensee Comments: none

Safety System Unavailability, Heat Removal System (AFW)



Thresholds: White > 2.0% Yellow > 6.0% Red > 12.0%

Notes

Safety System Unavailability, Heat Removal System (AFW)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	21.88	8.21	22.52	67.52	3.44
Unplanned unavailable hours	0	0	44.40	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0.55	39.10	16.40	45.22	1.93
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Train 3					
Planned unavailable hours	10.71	13.74	3.14	14.86	2.51
Unplanned unavailable hours	0	7.00	0	0	0
Fault exposure hours	0	0	0	0	0

Effective Reset hours	0	0	0	0	0
Required hours	1328.80	2192.00	2209.00	2184.00	2183.00
Indicator value			1.2%	1.2%	1.1%

Licensee Comments: none

Safety System Unavailability, Residual Heat Removal System



Thresholds: White > 1.5% Yellow > 5.0% Red > 10.0%


Notes

Safety System Unavailability, Residual Heat Removal System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Train 1					
Planned unavailable hours	0.33	0.22	21.70	51.43	26.51
Unplanned unavailable hours	0	0	44.40	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Train 2					
Planned unavailable hours	0.74	0.11	15.93	32.33	22.23
Unplanned unavailable hours	0	0	0	0	0
Fault exposure hours	0	0	0	0	0
Effective Reset hours	0	0	0	0	0
Required hours	2183.00	2208.00	2209.00	2184.00	2183.00
Indicator value			0.7%	0.8%	0.8%

Licensee Comments:

1Q/00: Changed B Train RHR planned unavailability from 1.12 hours to 0.21 based on additional system reviews.

Safety System Functional Failures (PWR)

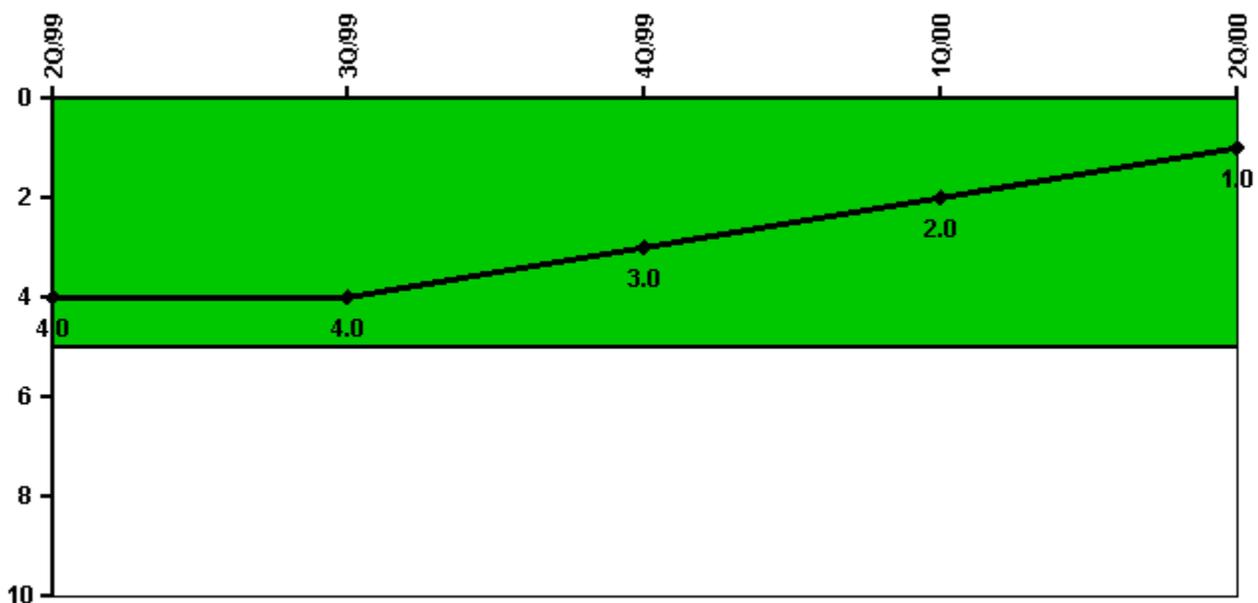


Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Safety System Functional Failures	1	1	0	0	0
Indicator value	4	4	3	2	1

Licensee Comments: none

Reactor Coolant System Activity

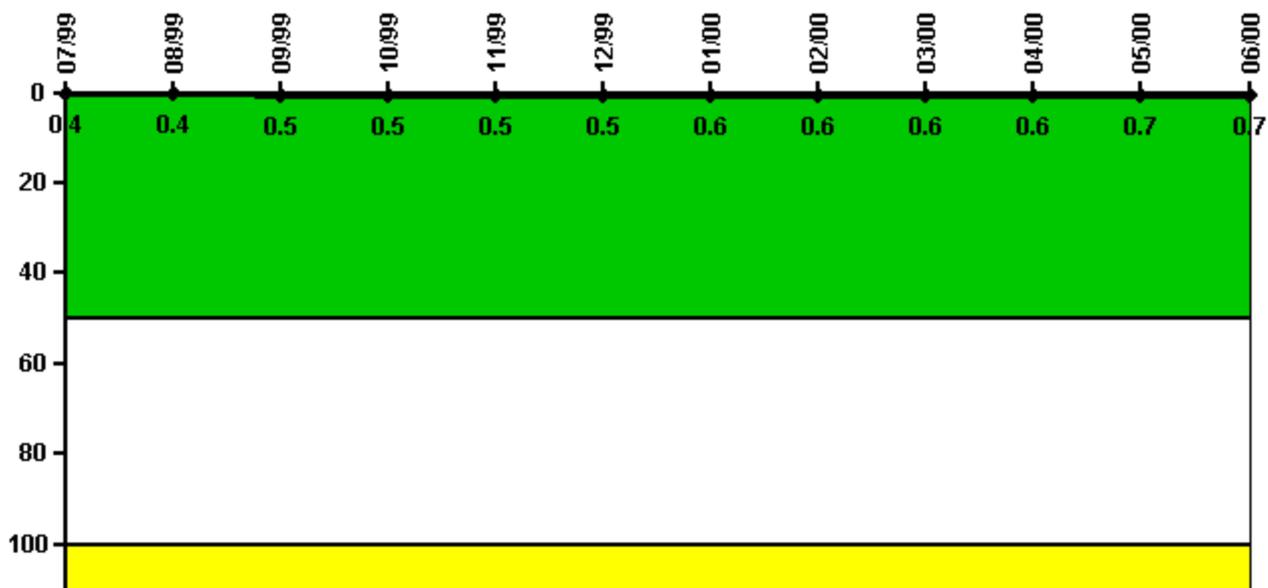


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum activity	0.003700	0.004100	0.004500	0.004600	0.005100	0.005100	0.005600	0.005800	0.006300	0.005900	0.007000	0.006600
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.4	0.4	0.5	0.5	0.5	0.5	0.6	0.6	0.6	0.6	0.7	0.7

Licensee Comments: none

Reactor Coolant System Leakage

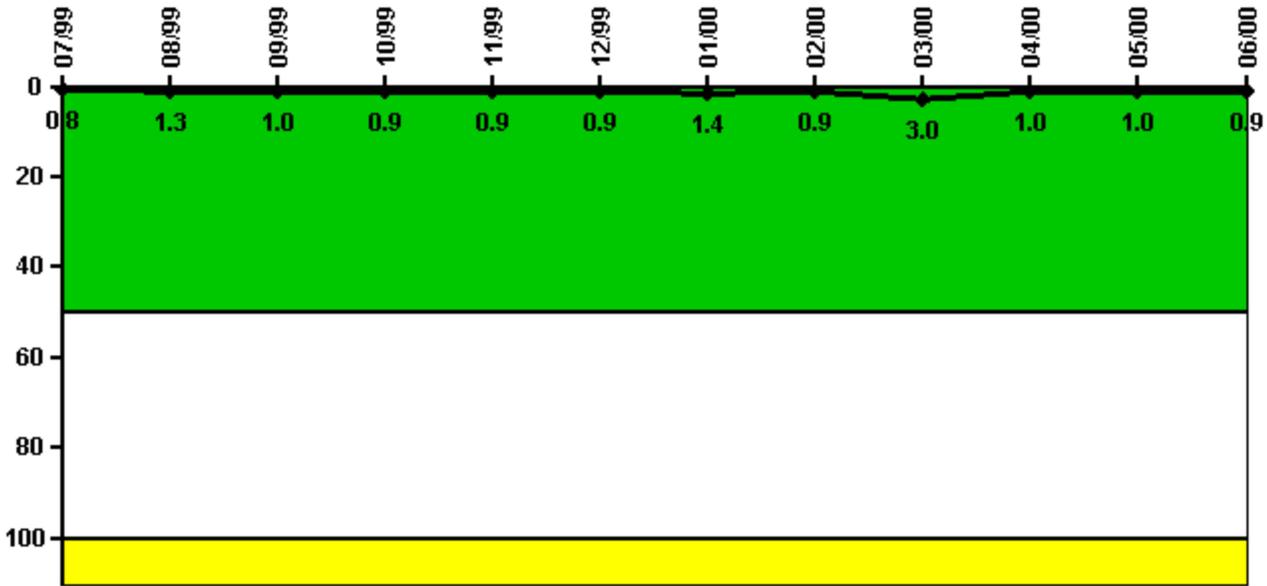


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/99	8/99	9/99	10/99	11/99	12/99	1/00	2/00	3/00	4/00	5/00	6/00
Maximum leakage	0.083	0.125	0.095	0.094	0.090	0.086	0.135	0.090	0.295	0.098	0.100	0.088
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.8	1.3	1.0	0.9	0.9	0.9	1.4	0.9	3.0	1.0	1.0	0.9

Licensee Comments: none

Drill/Exercise Performance

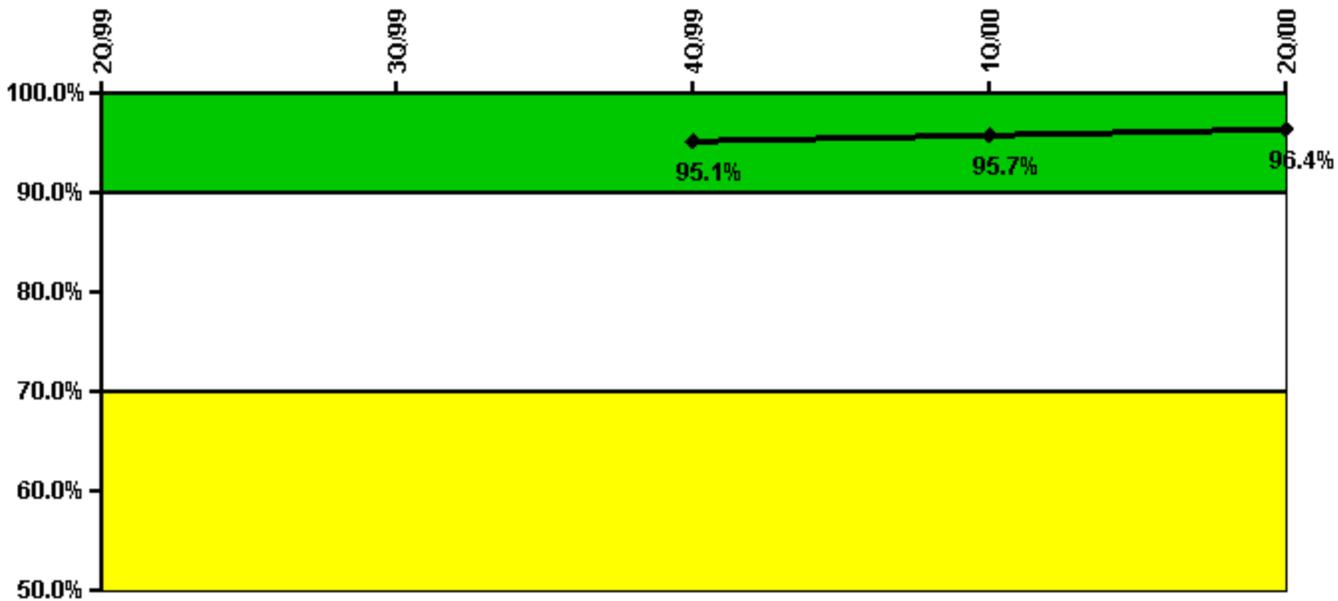

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful opportunities	10.0	60.0	57.0	56.0	39.0
Total opportunities	10.0	61.0	60.0	57.0	40.0
Indicator value			95.1%	95.7%	96.4%

Licensee Comments:

1Q/00: Previously reported a quarterly number for March 2000 that was revised to show just March statistics. In addition for one drill during the month of March one opportunity was removed due to lack of supporting records.


4Q/99: Previously reported 58 successes with 62 opportunities; revised to removed a failure to meet procedural expectations item that was counted twice and should have only been counted once.

3Q/99: Document reviews disclosed records supporting additional opportunities for this period.

2Q/99: Document reviews disclosed that records supporting a second classification were not evident, therefore the previously reported 12 opportunities and 12 successes were revised to 10 opportunities and 10 successes.

3Q/98: Data for 3rd quarter 1998 was previously reported as 41 successes with 43 opportunities, this data has been revised due to additional document reviews.

ERO Drill Participation

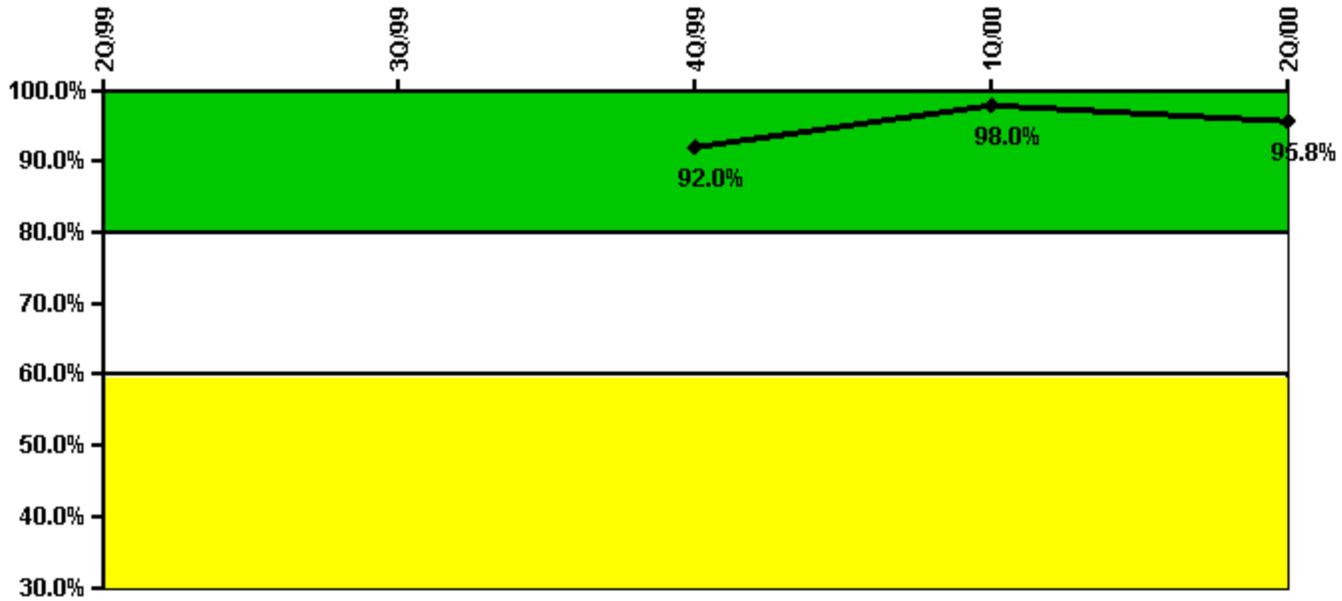

Thresholds: White < 80.0% Yellow < 60.0%


Notes

ERO Drill Participation	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Participating Key personnel	0	0	46.0	48.0	46.0
Total Key personnel	0	0	50.0	49.0	48.0
Indicator value			92.0%	98.0%	95.8%

Licensee Comments:

2Q/00: Changed to reflect the addition of one key ERO member who was not counted on the original submittal.

Alert & Notification System

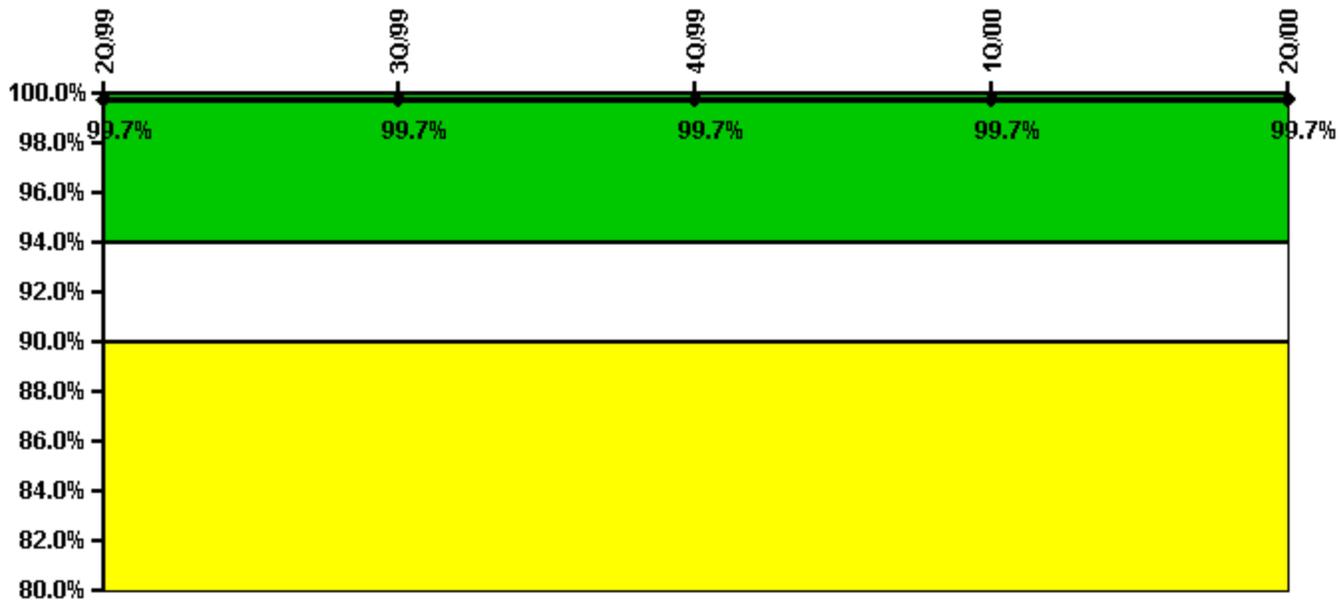


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Successful siren-tests	77	66	78	77	76
Total sirens-tests	78	66	78	77	77
Indicator value	99.7%	99.7%	99.7%	99.7%	99.7%

Licensee Comments: none

Occupational Exposure Control Effectiveness

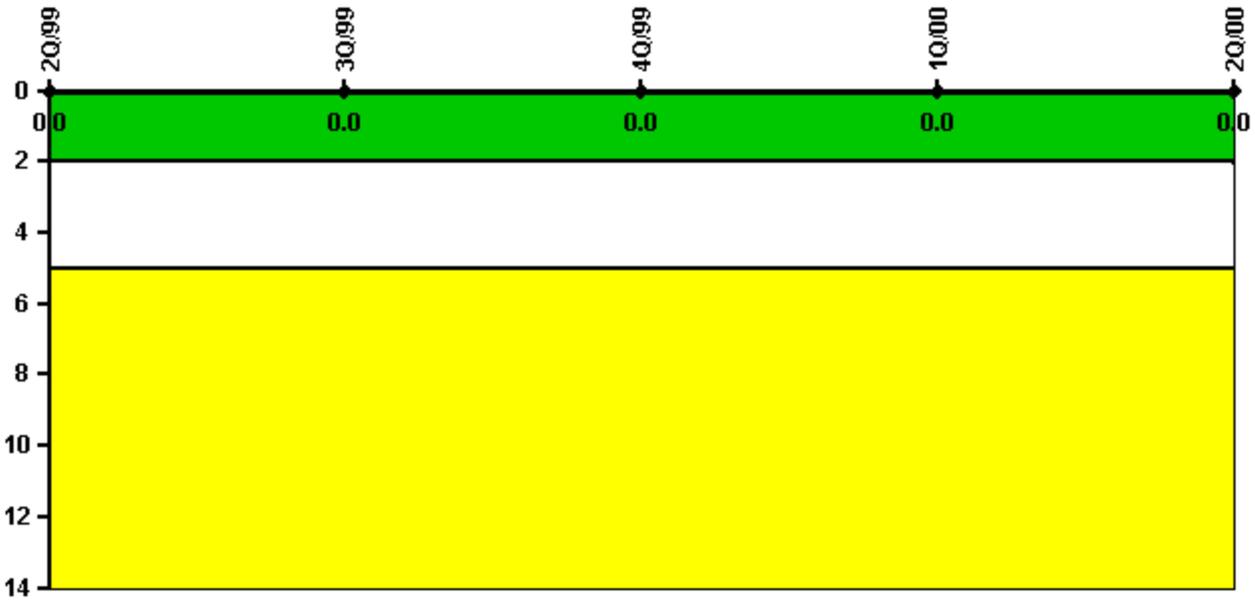


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
High radiation area occurrences	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

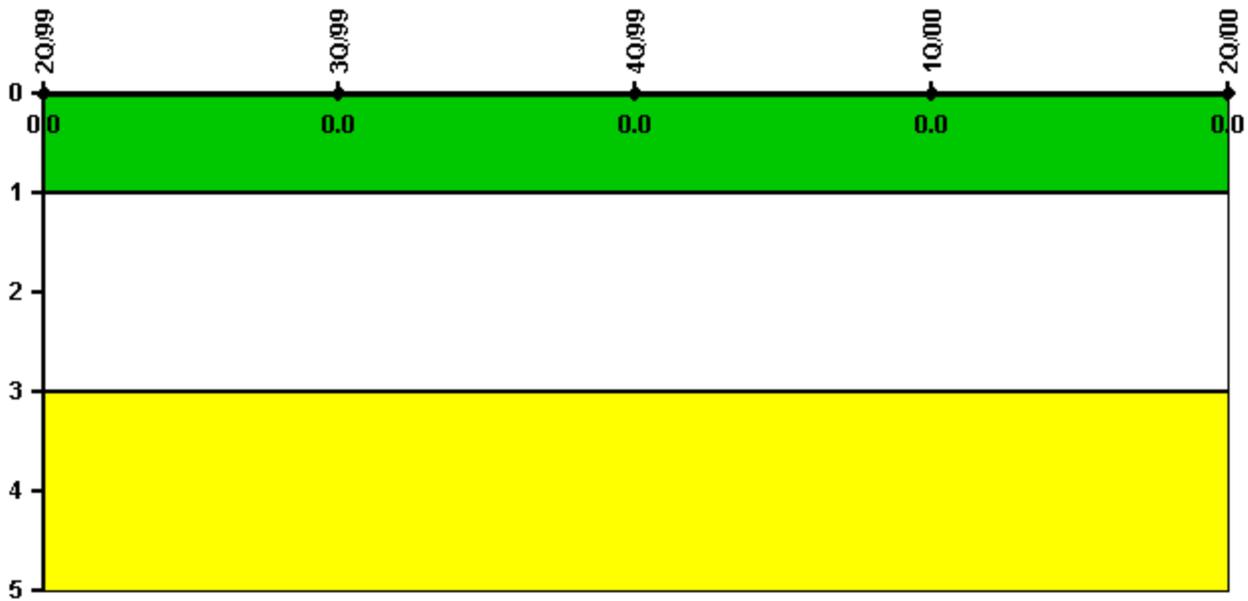


Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
RETS/ODCM occurrences	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

Protected Area Security Performance Index

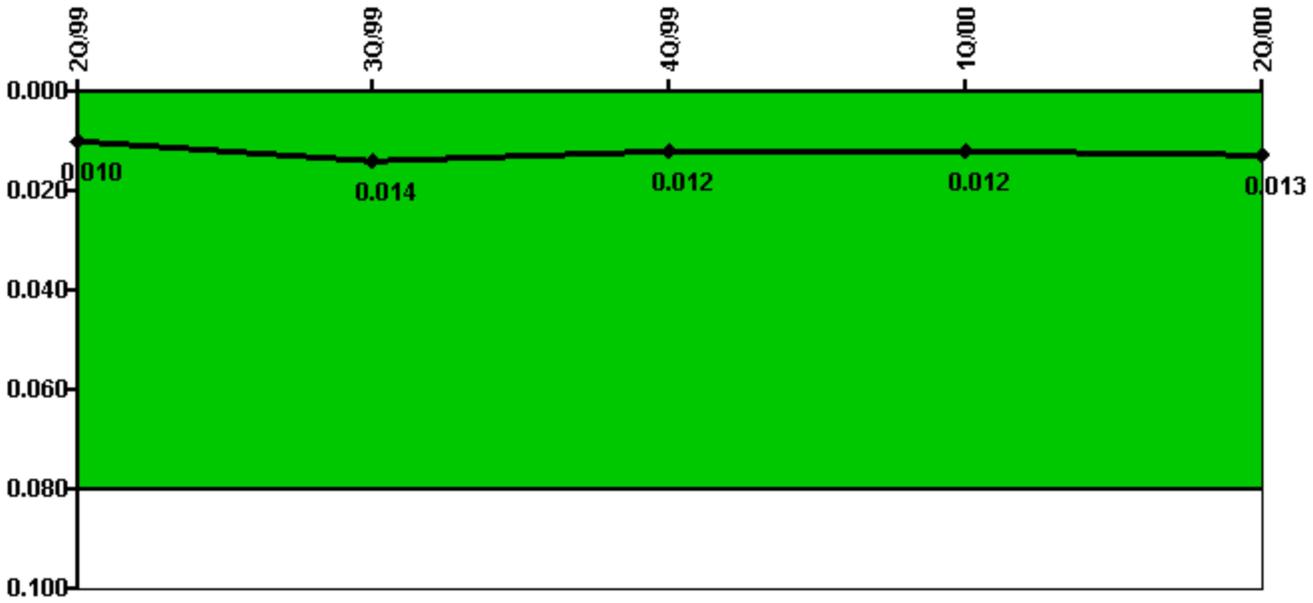


Thresholds: White > 0.080

Notes

Protected Area Security Performance Index	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
IDS compensatory hours	0	120.90	0.60	98.10	28.40
CCTV compensatory hours	42.1	31.6	17.9	3.4	35.8
IDS normalization factor	1.50	1.50	1.50	1.50	1.50
CCTV normalization factor	1.3	1.3	1.3	1.3	1.3
Index Value	0.010	0.014	0.012	0.012	0.013

Licensee Comments: none

Personnel Screening Program

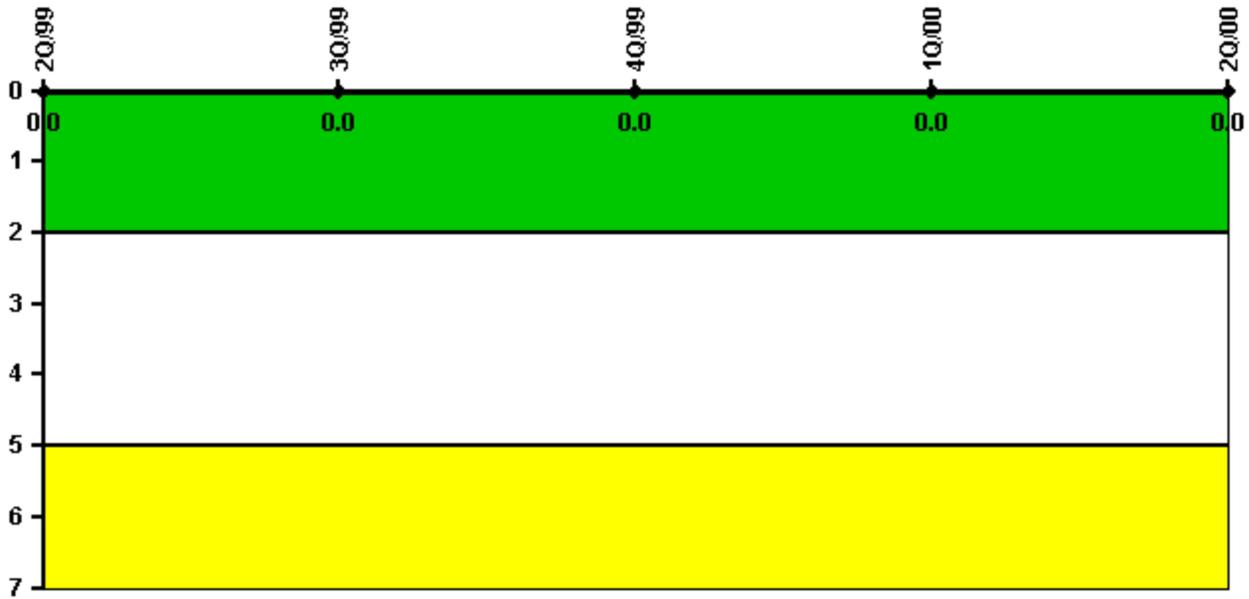


Thresholds: White > 2.0 Yellow > 5.0

Notes

Personnel Screening Program	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

FFD/Personnel Reliability

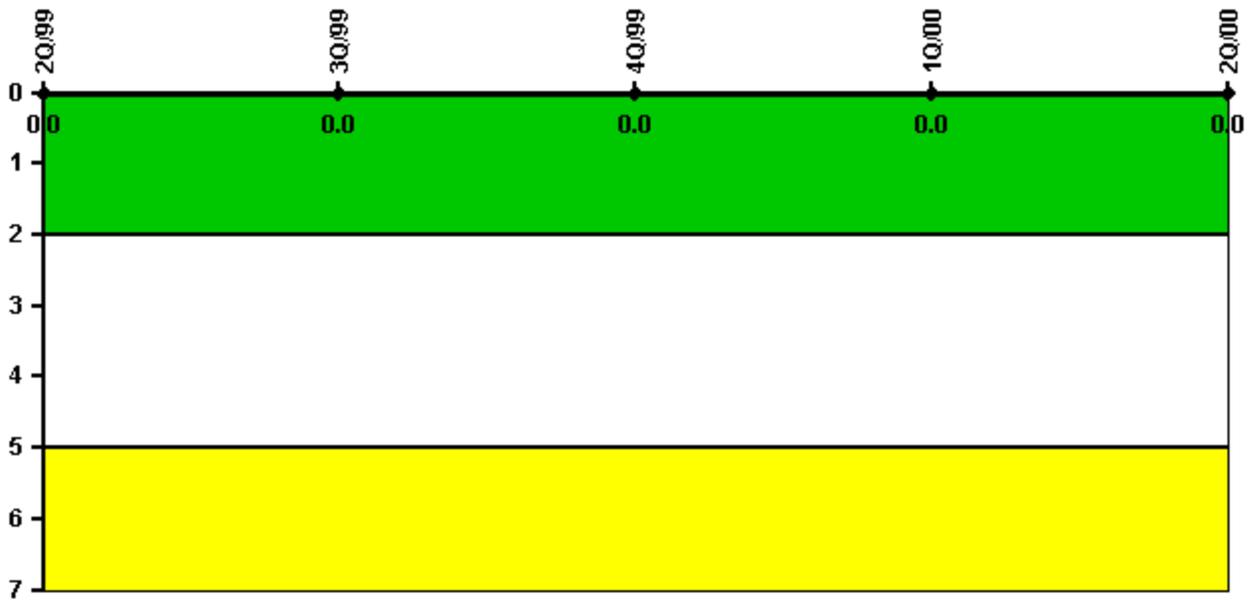

Thresholds: White > 2.0 Yellow > 5.0

Notes

FFD/Personnel Reliability	2Q/99	3Q/99	4Q/99	1Q/00	2Q/00
Program Failures	0	0	0	0	0
Indicator value	0	0	0	0	0

Licensee Comments: none

▲ [PI Summary](#) | [Inspection Findings Summary](#) | [Reactor Oversight Process](#)

Last Modified: April 1, 2002