


FitzPatrick

2Q/2012 Performance Indicators

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

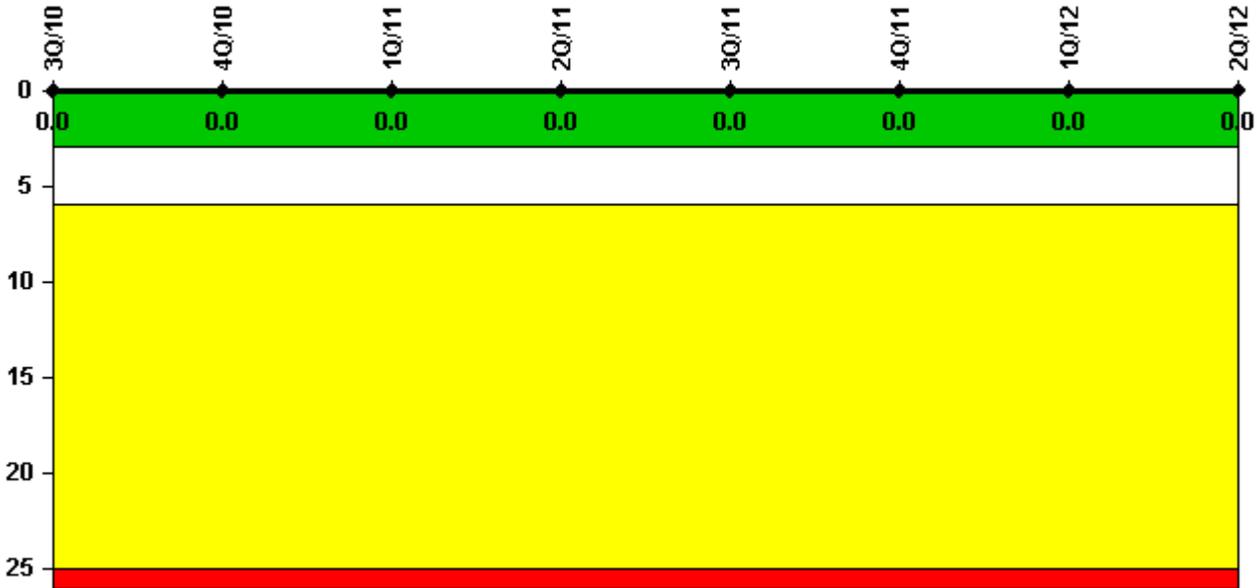


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	1760.5	1890.1	2159.0	2184.0	2208.0	2209.0	2183.0	2184.0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

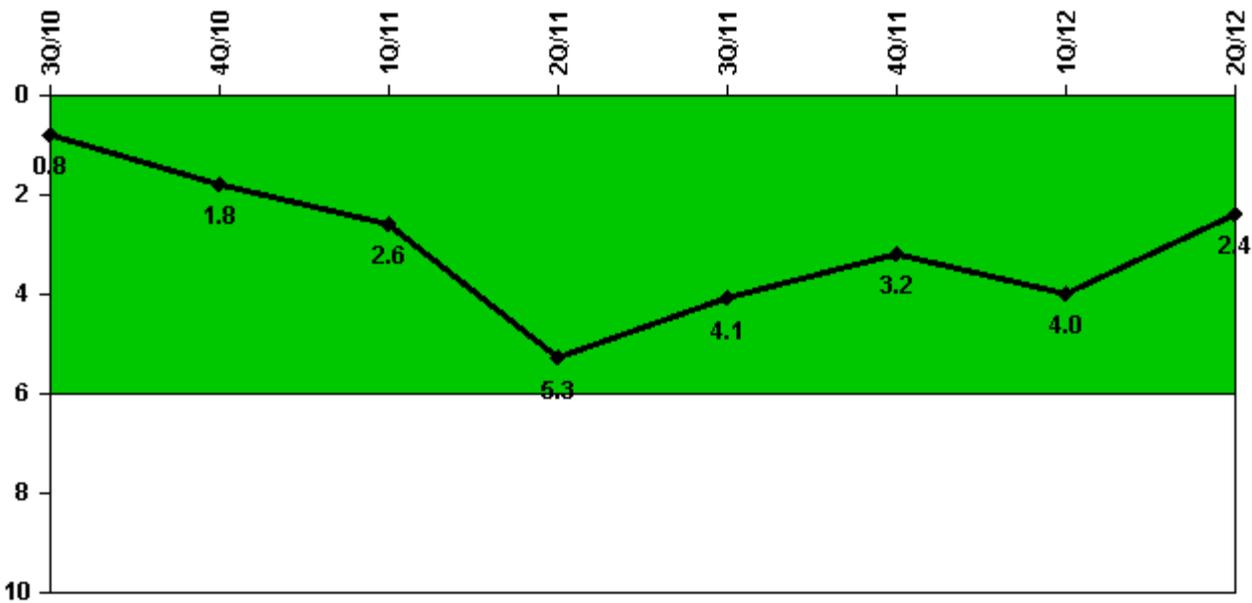

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Unplanned power changes	1.0	1.0	1.0	3.0	0	0	2.0	1.0
Critical hours	1760.5	1890.1	2159.0	2184.0	2208.0	2209.0	2183.0	2184.0
Indicator value	0.8	1.8	2.6	5.3	4.1	3.2	4.0	2.4


Licensee Comments:

4Q/11: A Power Change affecting May 2011 was changed to Unplanned based on a review by the Senior Resident Inspector. It involved a failed tube in the main condenser. Two (2) Power changes affecting June 2011 were reviewed by the Senior Resident inspector and by the ROP via the FAQ process. These two Power Changes were updated to Unplanned. They were caused by fouling of the main condenser due to maintenance work.

3Q/11: Three downpowers are being re-evaluated by the FAQ process to determine planned or unplanned status. Downpowers being considered for revision occurred on 5/6/11, 6/7/11, and 6/9/11. These include 1 downpower to repair main condenser tube leaks and 2 downpowers caused by defishing the main condenser during Traveling Screen maintenance.

2Q/11: Based on review with the Resident Inspector 1 power change in May was reclassified as unplanned. Two down powers in June were reviewed through the FAQ process and determined to not meet the NEI 99-02 environmental exclusion and were reclassified as unplanned.

Unplanned Scrams with Complications

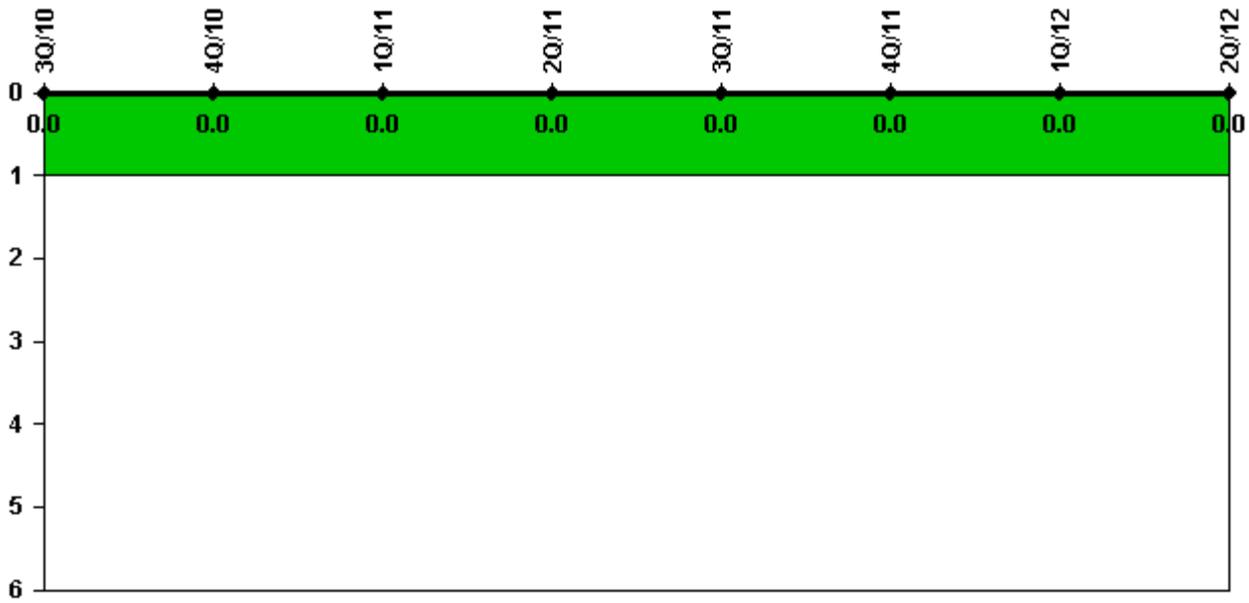


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0	0.0	0.0	0.0	0.0	0.0	0.0	0.0

Licensee Comments: none

Safety System Functional Failures (BWR)

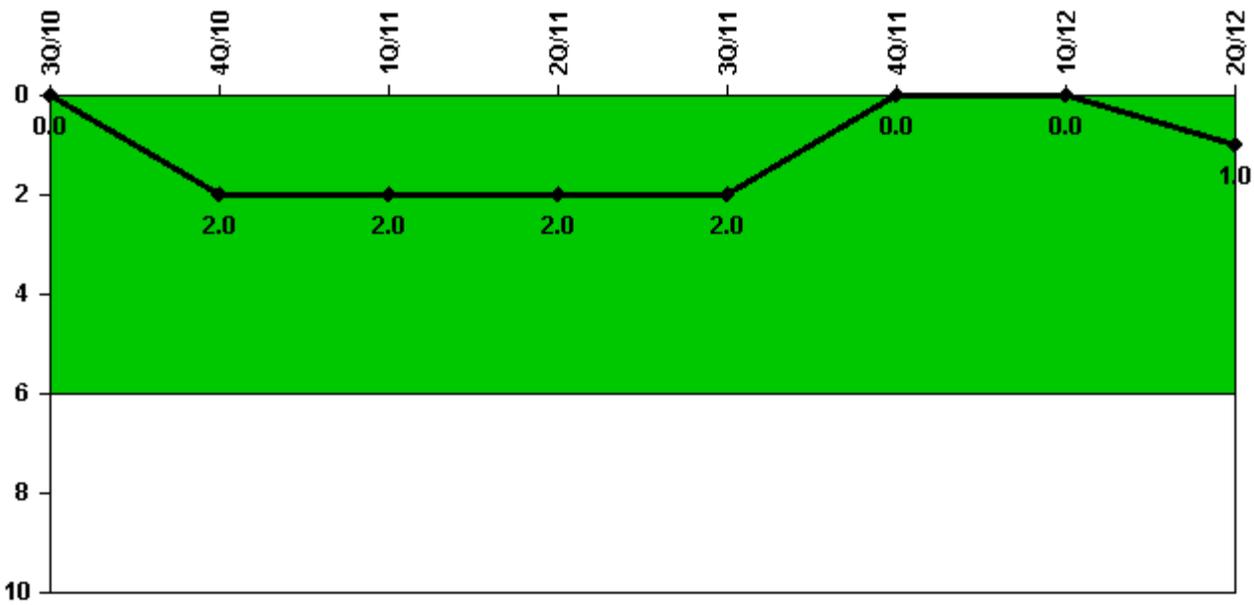

Thresholds: White > 6.0


Notes

Safety System Functional Failures (BWR)	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Safety System Functional Failures	0	2	0	0	0	0	0	1
Indicator value	0	2	2	2	2	0	0	1

Licensee Comments:

2Q/12: LER-2012-001, Unit Cooler Fan Motor Contactor Low Voltage Test Failure Results in Loss of Safety Function and Condition Prohibited by the Technical Specifications, reported in June 2012

Mitigating Systems Performance Index, Emergency AC Power System

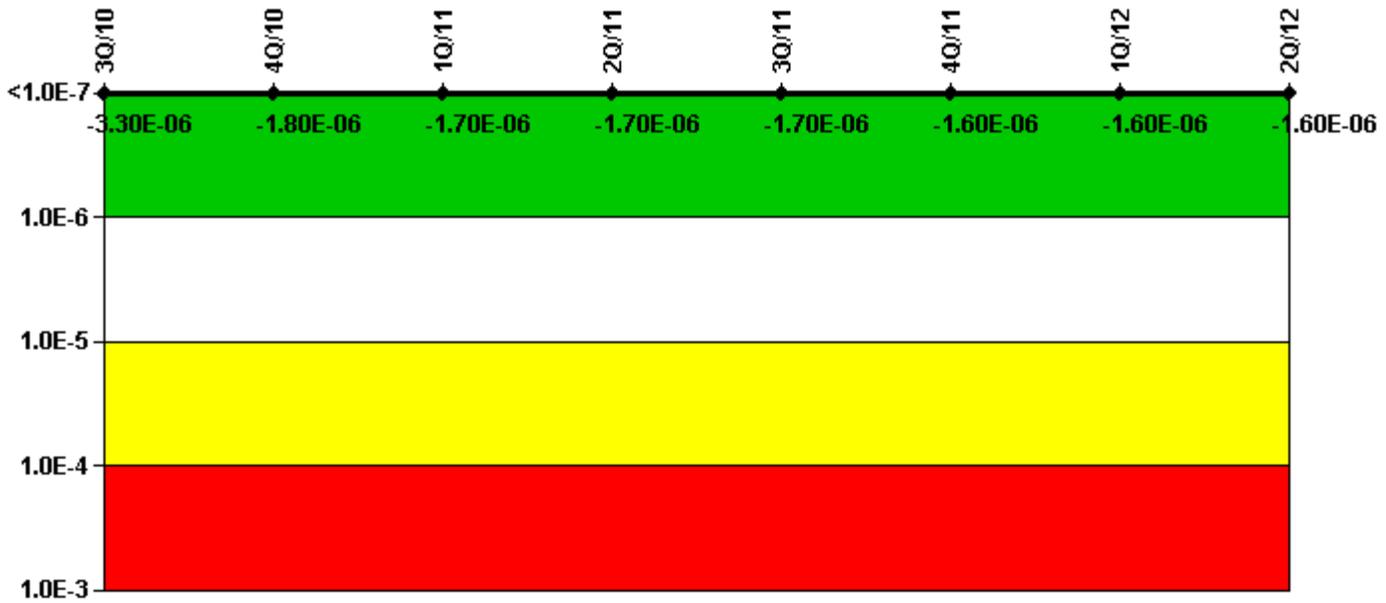

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Emergency AC Power System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	2.15E-08	7.03E-09	7.25E-09	8.43E-09	7.54E-09	8.45E-09	1.05E-08	3.31E-09
URI (Δ CDF)	-3.31E-06	-1.77E-06	-1.71E-06	-1.74E-06	-1.68E-06	-1.66E-06	-1.66E-06	-1.56E-06
PLE	NO							
Indicator value	-3.30E-06	-1.80E-06	-1.70E-06	-1.70E-06	-1.70E-06	-1.60E-06	-1.60E-06	-1.60E-06

Licensee Comments:

3Q/10: Risk Cap Invoked.

Mitigating Systems Performance Index, High Pressure Injection System

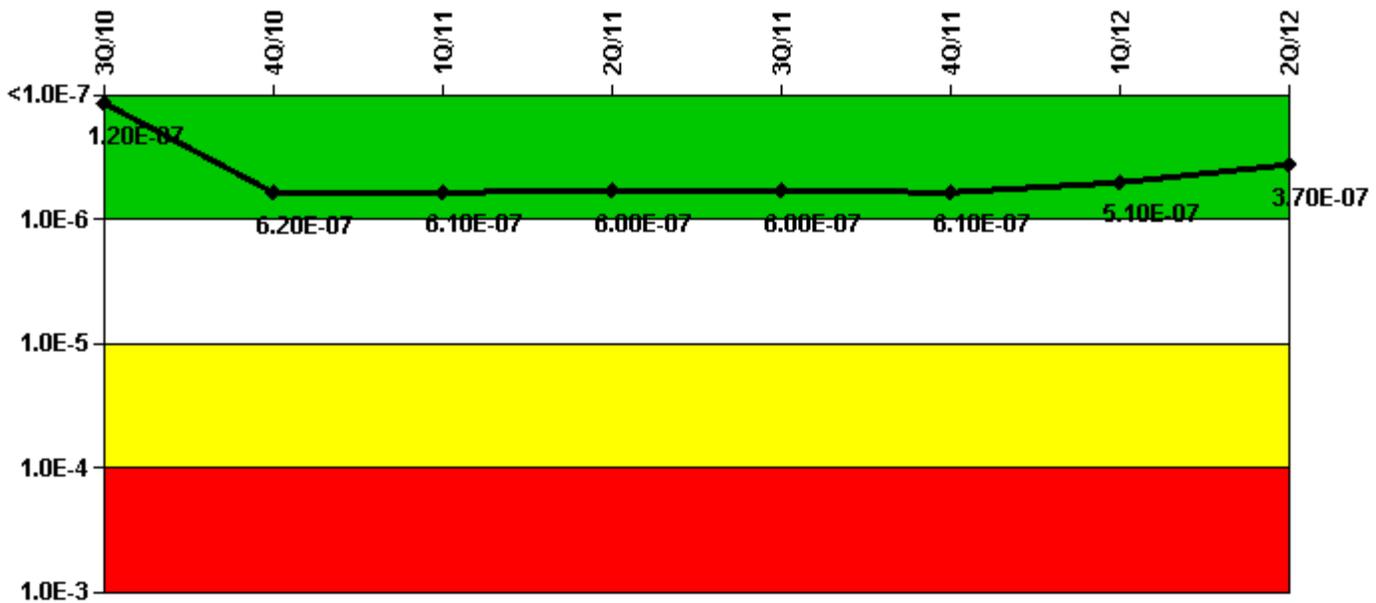

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (ΔCDF)	4.29E-08	1.19E-07	1.23E-07	1.11E-07	1.06E-07	1.06E-07	9.04E-09	6.84E-08
URI (ΔCDF)	7.89E-08	5.03E-07	4.85E-07	4.94E-07	4.94E-07	5.03E-07	5.04E-07	3.05E-07
PLE	NO							
Indicator value	1.20E-07	6.20E-07	6.10E-07	6.00E-07	6.00E-07	6.10E-07	5.10E-07	3.70E-07

Licensee Comments:

4Q/10: MSPI Basis Document was revised to incorporate the 2009 PSA Model Update. The update resulted in deletion of 2 MOVs in the High Pressure Coolant Injection System and changes to most PSA values. Changes were incorporated effective for four Quarter 2010.

Mitigating Systems Performance Index, Heat Removal System

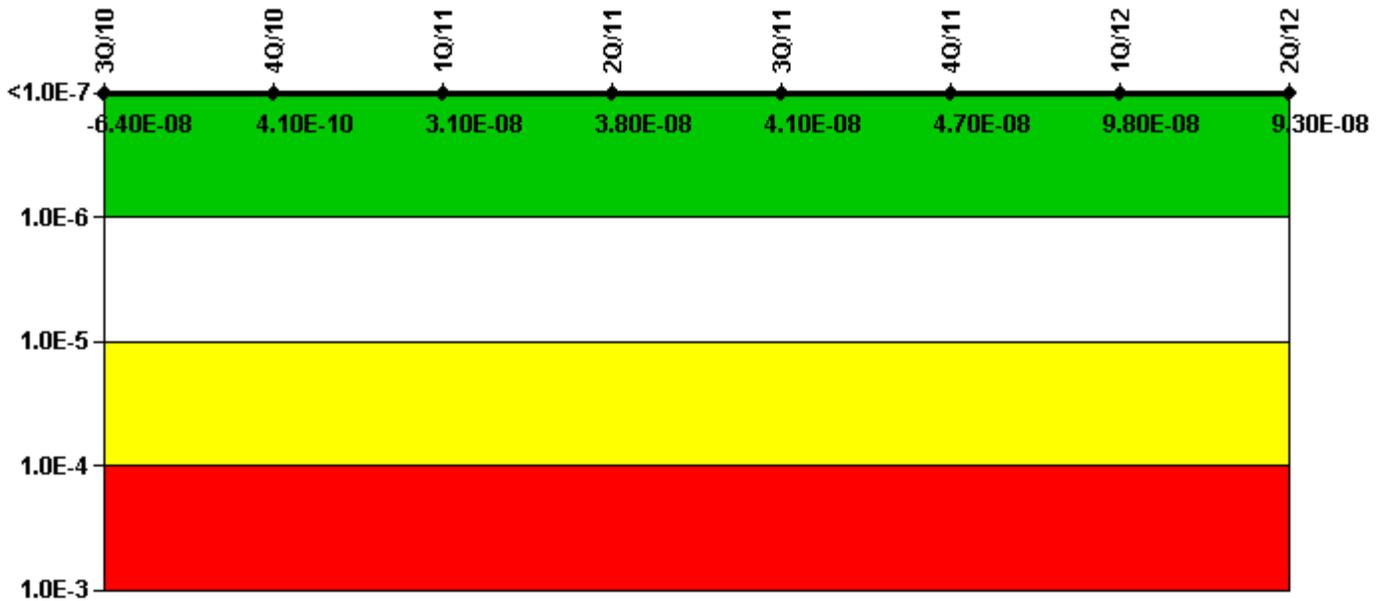

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	-9.55E-09	1.32E-08	-3.32E-09	4.46E-09	8.93E-09	1.32E-08	6.19E-08	5.74E-08
URI (Δ CDF)	-5.49E-08	-1.28E-08	3.41E-08	3.40E-08	3.17E-08	3.41E-08	3.63E-08	3.60E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	-6.40E-08	4.10E-10	3.10E-08	3.80E-08	4.10E-08	4.70E-08	9.80E-08	9.30E-08

Licensee Comments:

4Q/10: Data for October was revised based on causal information developed in relation to a January 2011 failure of 13MOV-131. This information changed the classification of an October 2010 failure. The failure had previously be classified as related to maintenance and was determined to be a demand failure based on a January Failure.

Mitigating Systems Performance Index, Residual Heat Removal System

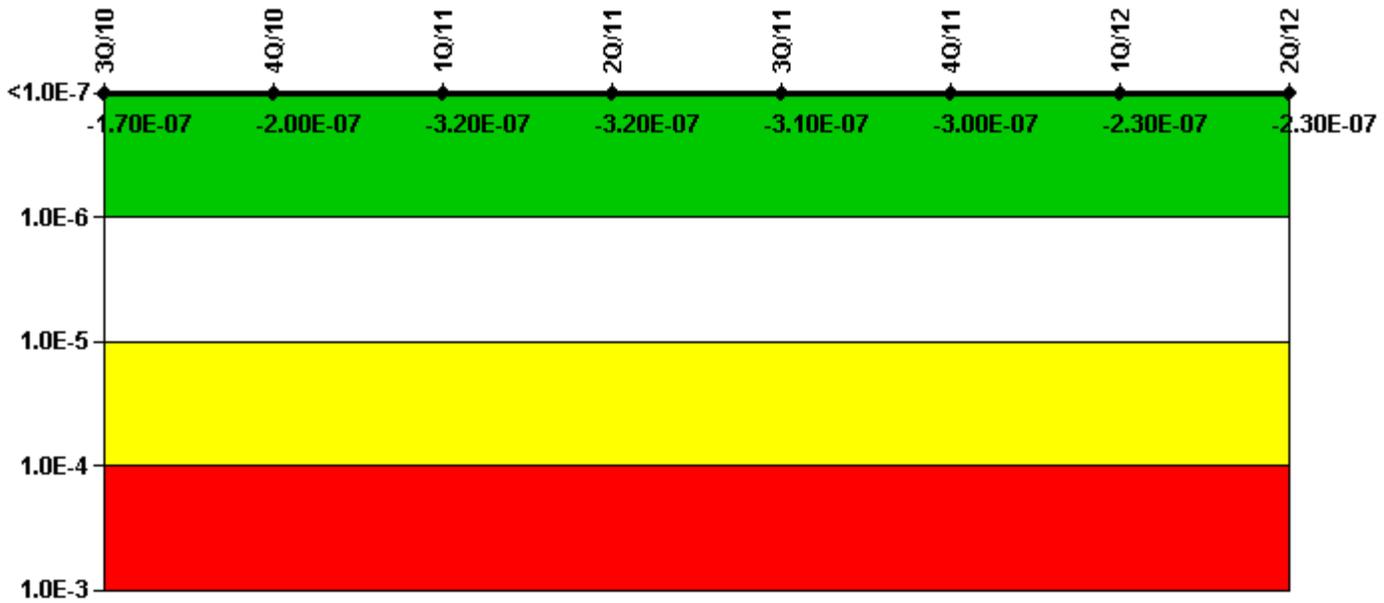


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	3.82E-08	8.69E-08	-3.76E-08	-3.12E-08	-3.60E-08	-3.82E-08	3.46E-08	2.86E-08
URI (Δ CDF)	-2.08E-07	-2.88E-07	-2.87E-07	-2.84E-07	-2.75E-07	-2.67E-07	-2.61E-07	-2.56E-07
PLE	NO							
Indicator value	-1.70E-07	-2.00E-07	-3.20E-07	-3.20E-07	-3.10E-07	-3.00E-07	-2.30E-07	-2.30E-07

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

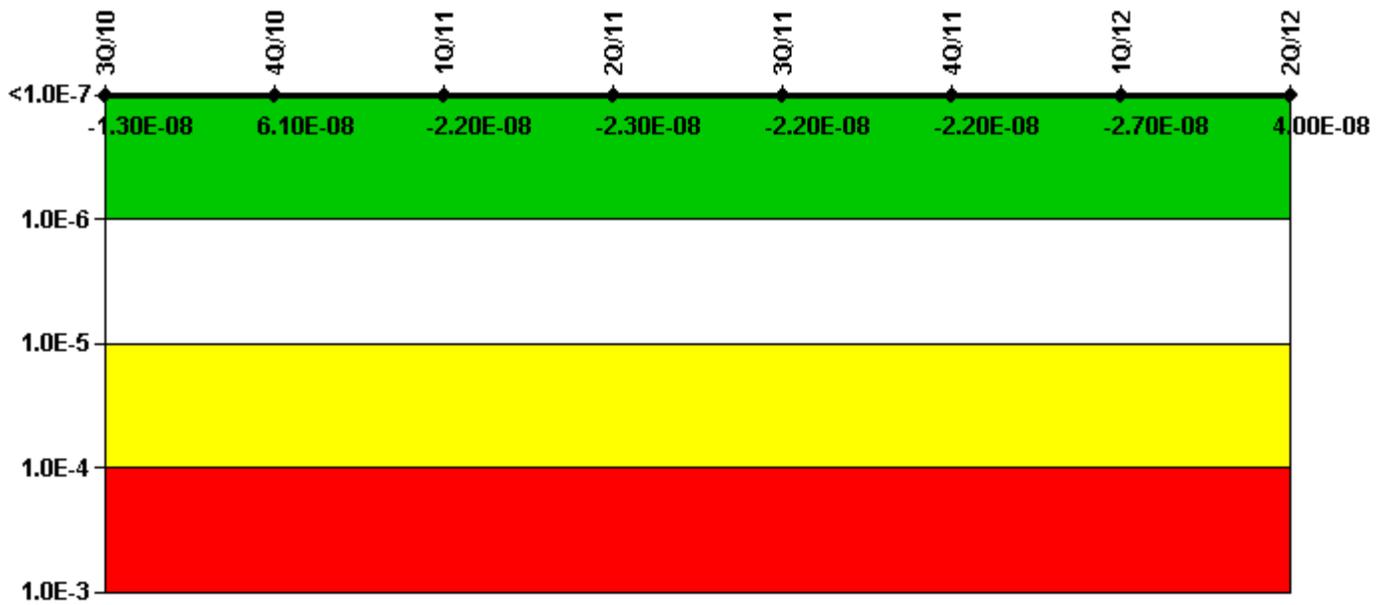


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
UAI (Δ CDF)	3.46E-08	7.25E-08	-1.04E-08	-1.04E-08	-1.04E-08	-1.04E-08	-1.58E-08	5.21E-08
URI (Δ CDF)	-4.73E-08	-1.18E-08	-1.20E-08	-1.23E-08	-1.17E-08	-1.16E-08	-1.17E-08	-1.16E-08
PLE	NO							
Indicator value	-1.30E-08	6.10E-08	-2.20E-08	-2.30E-08	-2.20E-08	-2.20E-08	-2.70E-08	4.00E-08

Licensee Comments: none

Reactor Coolant System Activity

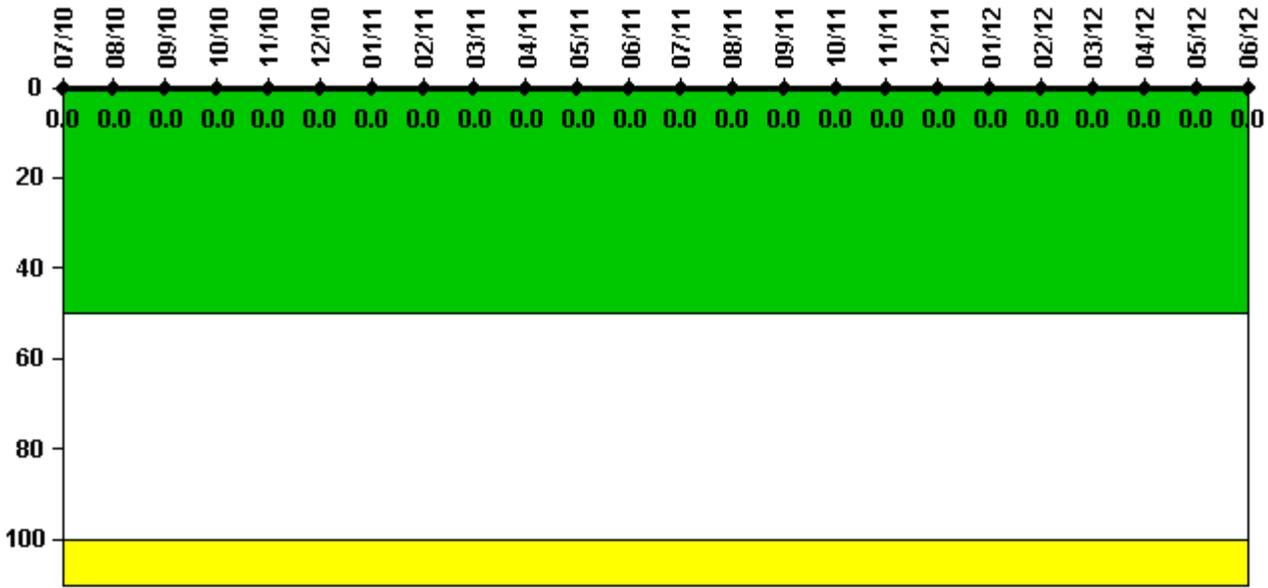

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum activity	0.000061	0.000041	0.000040	0.000013	0.000017	0.000018	0.000029	0.000015	0.000015	0.000023	0.000042	0.000019
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.000015	0.000018	0.000020	0.000015	0.000012	0.000024	0.000038	0.000019	0.000020	0.000033	0.000036	0.000023
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

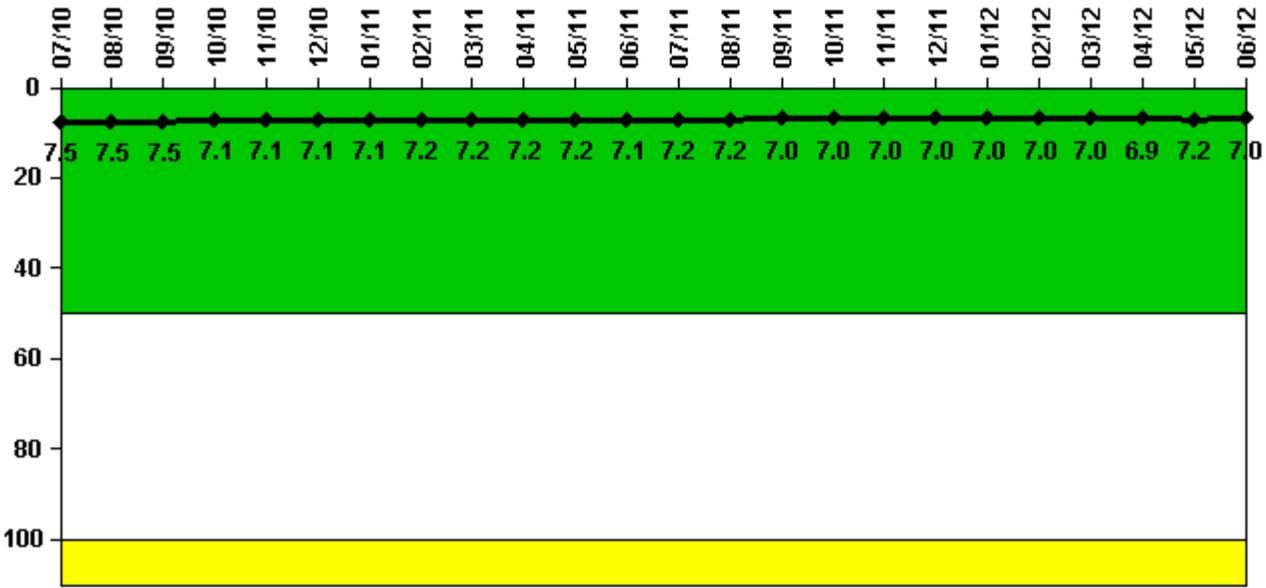


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/10	8/10	9/10	10/10	11/10	12/10	1/11	2/11	3/11	4/11	5/11	6/11
Maximum leakage	1.880	1.880	1.880	1.770	1.770	1.770	1.780	1.790	1.790	1.790	1.790	1.780
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.5	7.5	7.5	7.1	7.1	7.1	7.1	7.2	7.2	7.2	7.2	7.1
Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	1.800	1.800	1.750	1.740	1.740	1.740	1.740	1.760	1.740	1.720	1.810	1.740
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	7.2	7.2	7.0	7.0	7.0	7.0	7.0	7.0	7.0	6.9	7.2	7.0

Licensee Comments: none

Drill/Exercise Performance

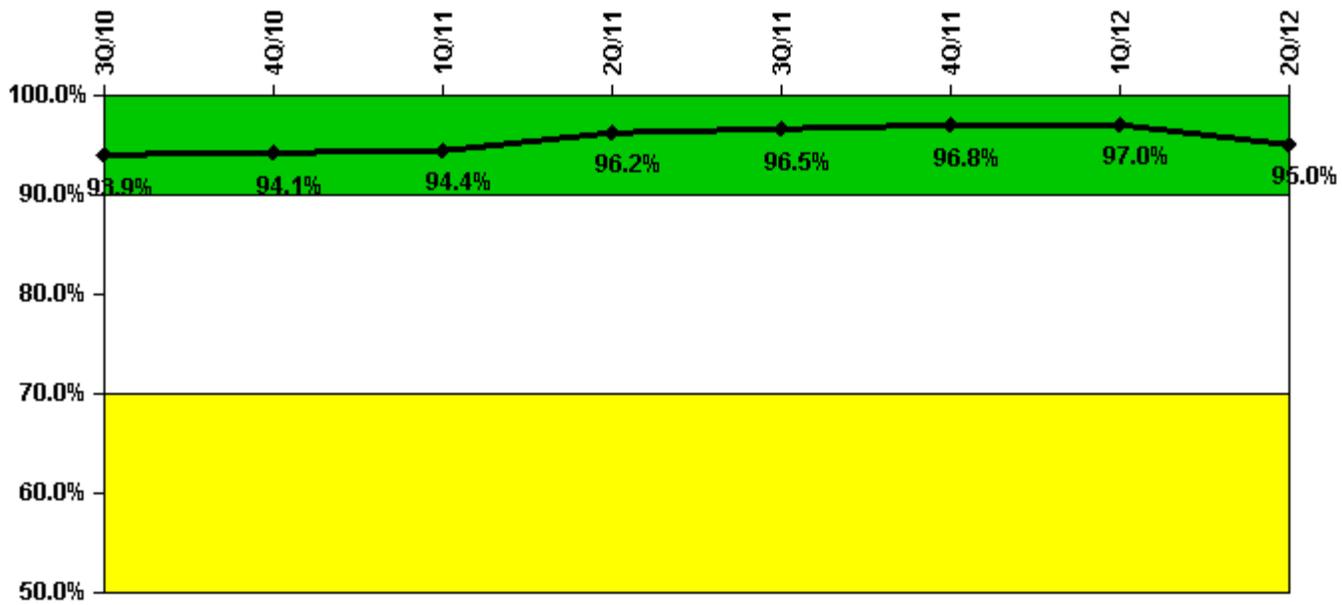


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful opportunities	14.0	19.0	18.0	58.0	25.0	7.0	30.0	39.0
Total opportunities	14.0	20.0	18.0	58.0	26.0	8.0	31.0	46.0
Indicator value	93.9%	94.1%	94.4%	96.2%	96.5%	96.8%	97.0%	95.0%

Licensee Comments: none

ERO Drill Participation

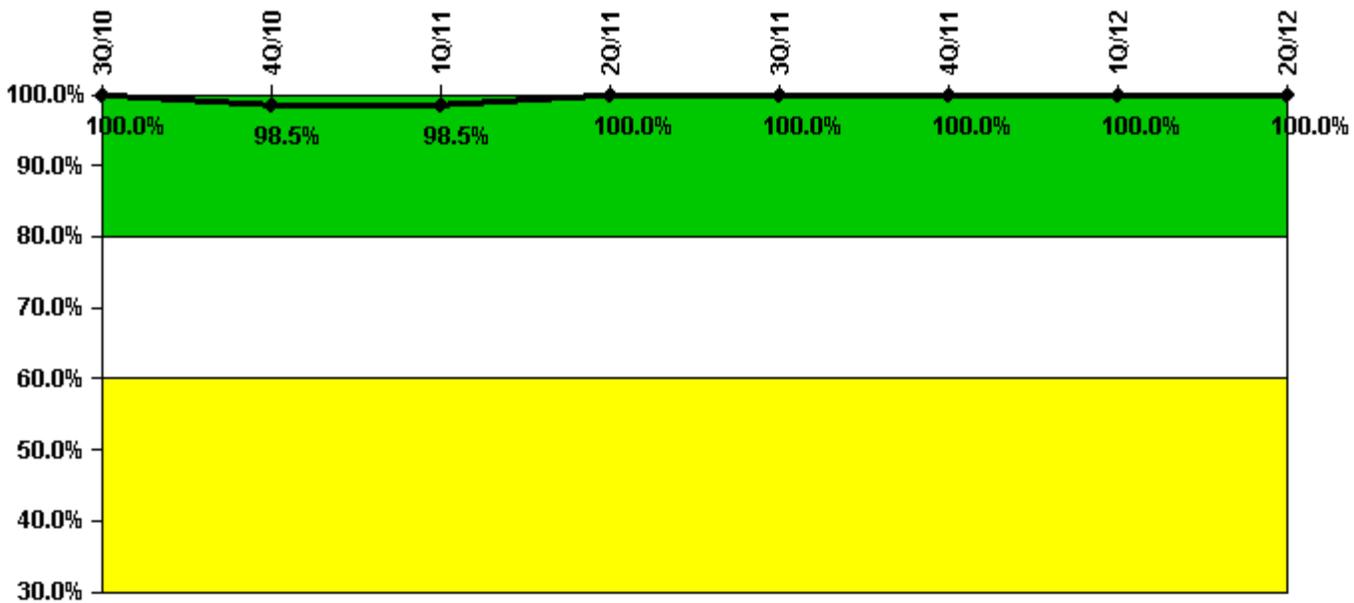

Thresholds: White < 80.0% Yellow < 60.0%


Notes

ERO Drill Participation	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Participating Key personnel	65.0	65.0	66.0	67.0	73.0	74.0	71.0	72.0
Total Key personnel	65.0	66.0	67.0	67.0	73.0	74.0	71.0	72.0
Indicator value	100.0%	98.5%	98.5%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments:

4Q/10: For November, PI was changed due to add 2 newly qualified positions that were not previously accounted for. For December, PI was changed due to add 3 newly qualified positions that were not previously accounted for.

Alert & Notification System

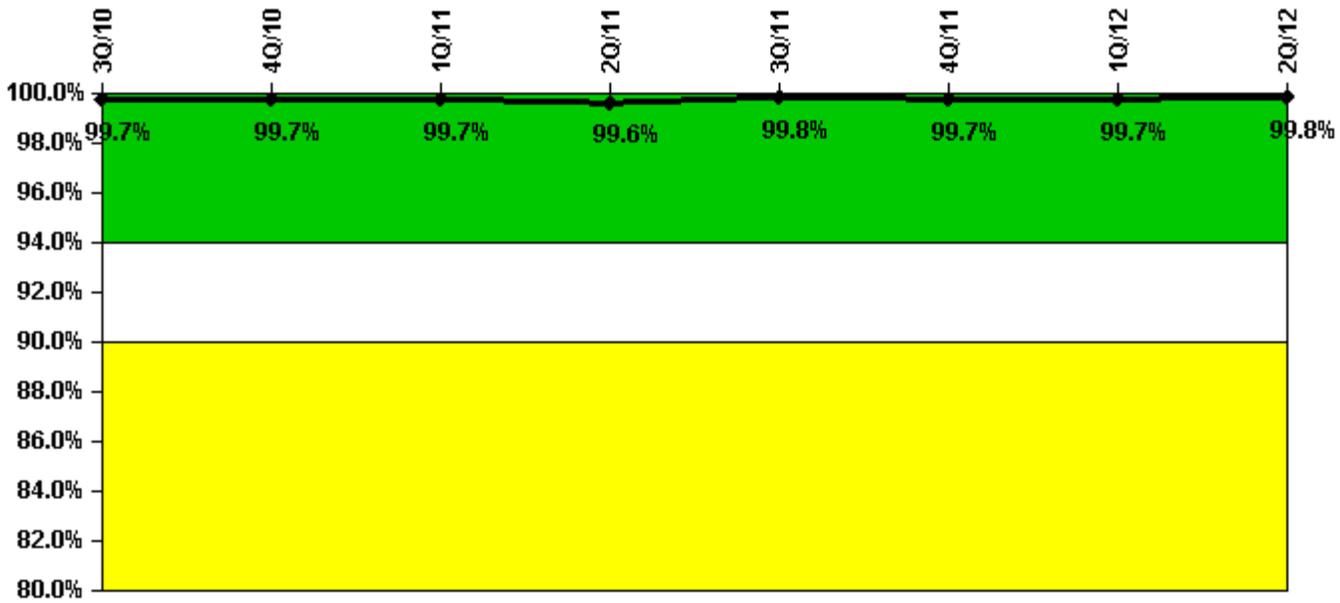


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
Successful siren-tests	256	296	222	258	258	295	222	296
Total sirens-tests	259	296	222	259	259	296	222	296
Indicator value	99.7%	99.7%	99.7%	99.6%	99.8%	99.7%	99.7%	99.8%

Licensee Comments: none

Occupational Exposure Control Effectiveness

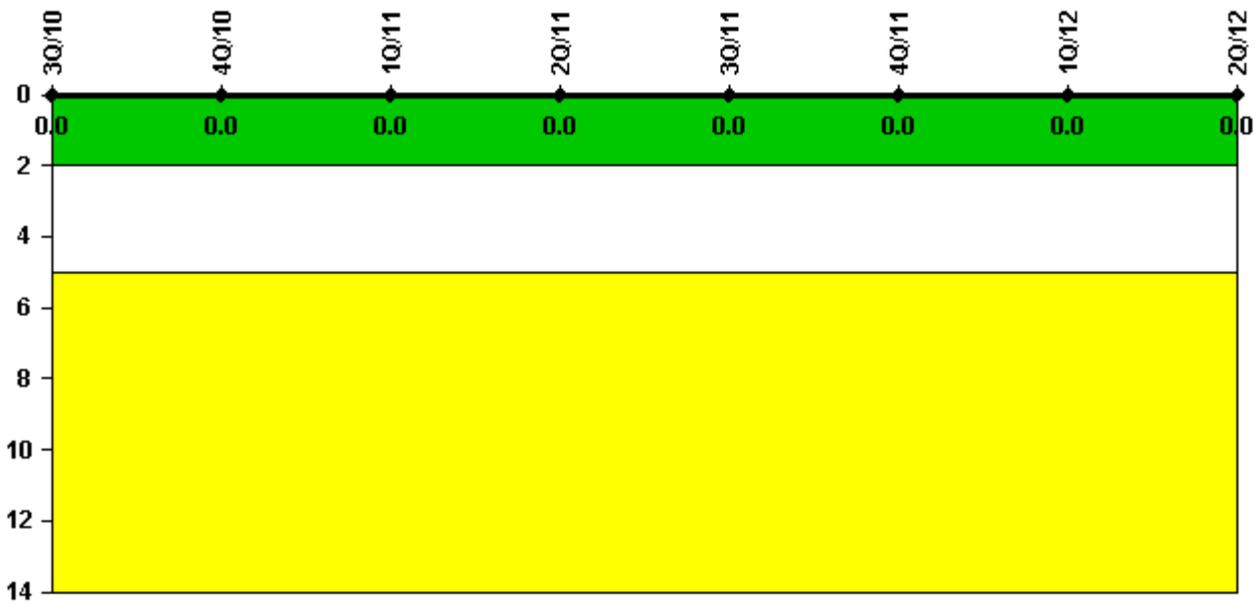


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

RETS/ODCM Radiological Effluent

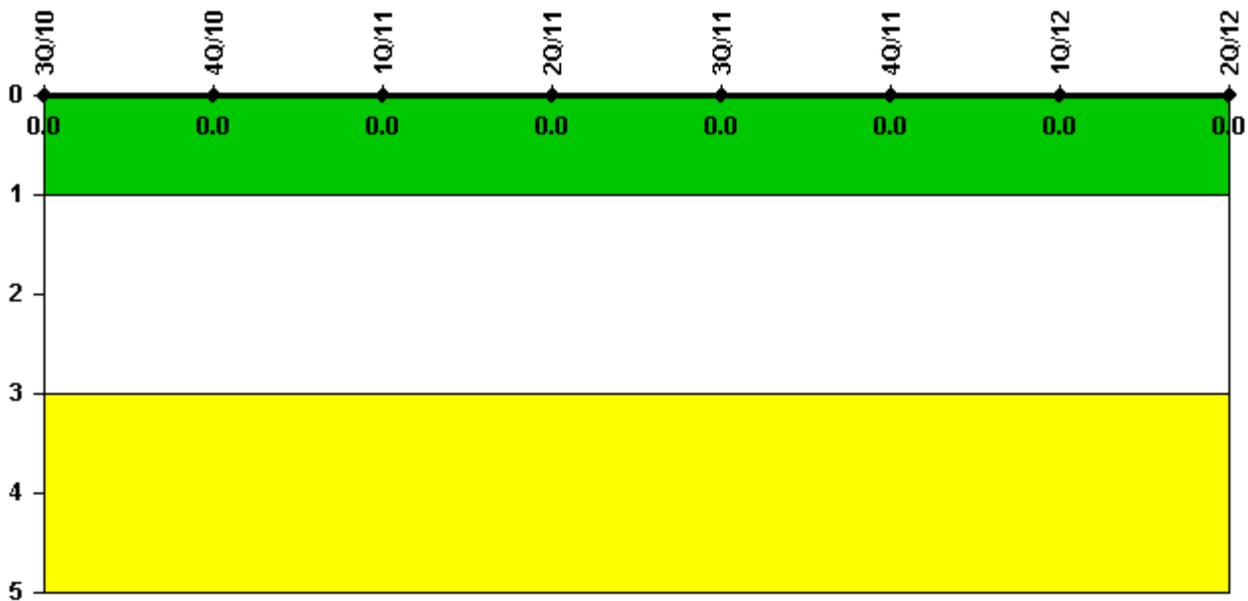

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/10	4Q/10	1Q/11	2Q/11	3Q/11	4Q/11	1Q/12	2Q/12
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.
