


Waterford 3

2Q/2013 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

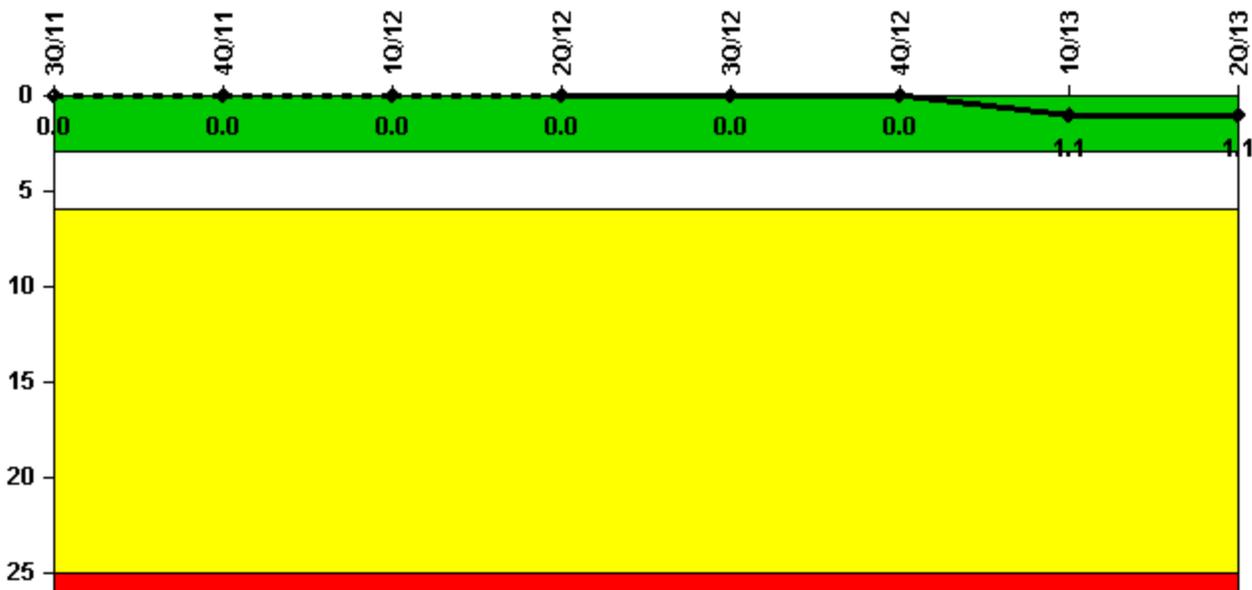


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Unplanned scrams	0	0	0	0	0	0	1.0	0
Critical hours	2208.0	2209.0	2183.0	2184.0	2097.3	383.8	1726.0	2069.0
Indicator value	0	0	0	0	0	0	1.1	1.1

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

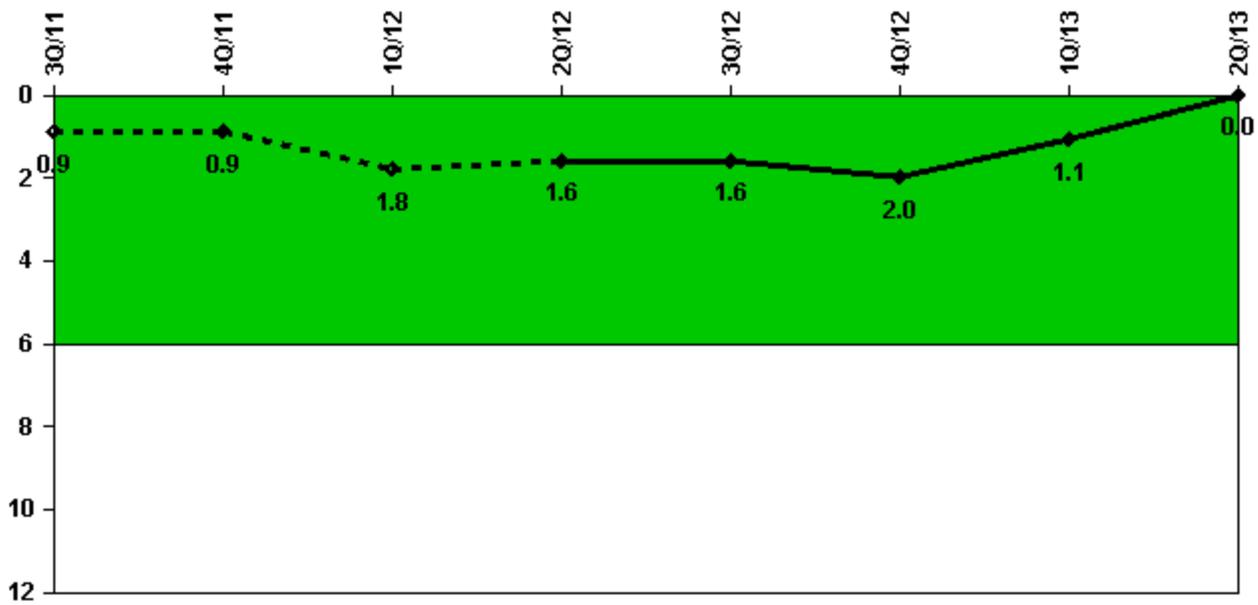


Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Unplanned power changes	0	0	1.0	1.0	0	0	0	0
Critical hours	2208.0	2209.0	2183.0	2184.0	2097.3	383.8	1726.0	2069.0
Indicator value	0.9	0.9	1.8	1.6	1.6	2.0	1.1	0

Licensee Comments: none

Unplanned Scrams with Complications

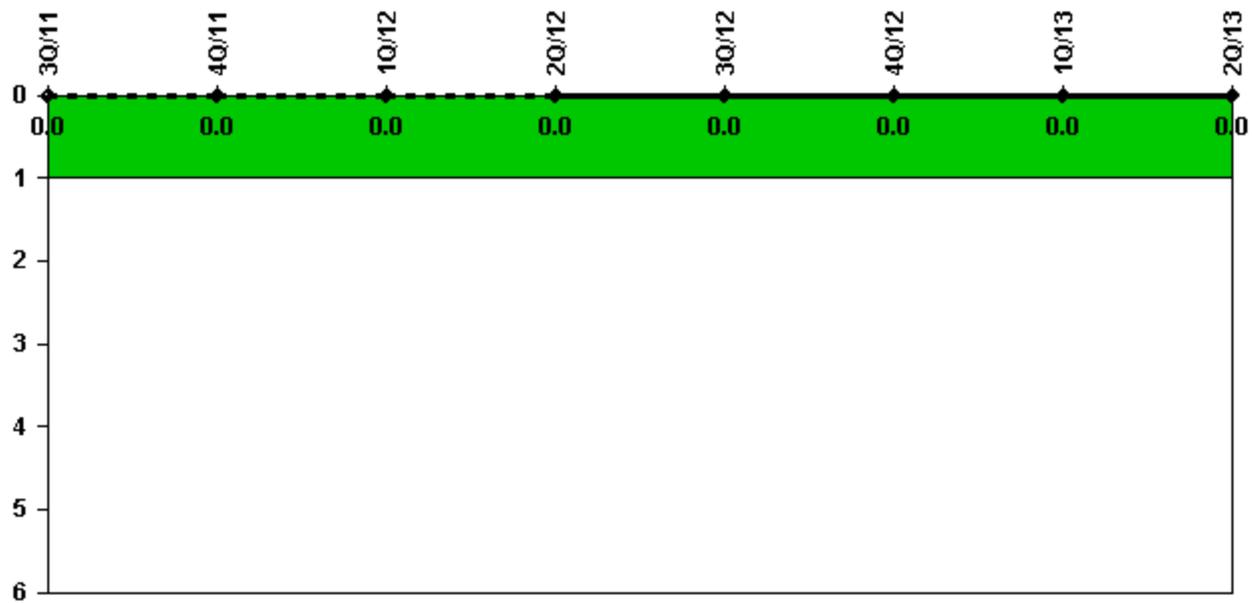


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0							

Licensee Comments: none

Safety System Functional Failures (PWR)

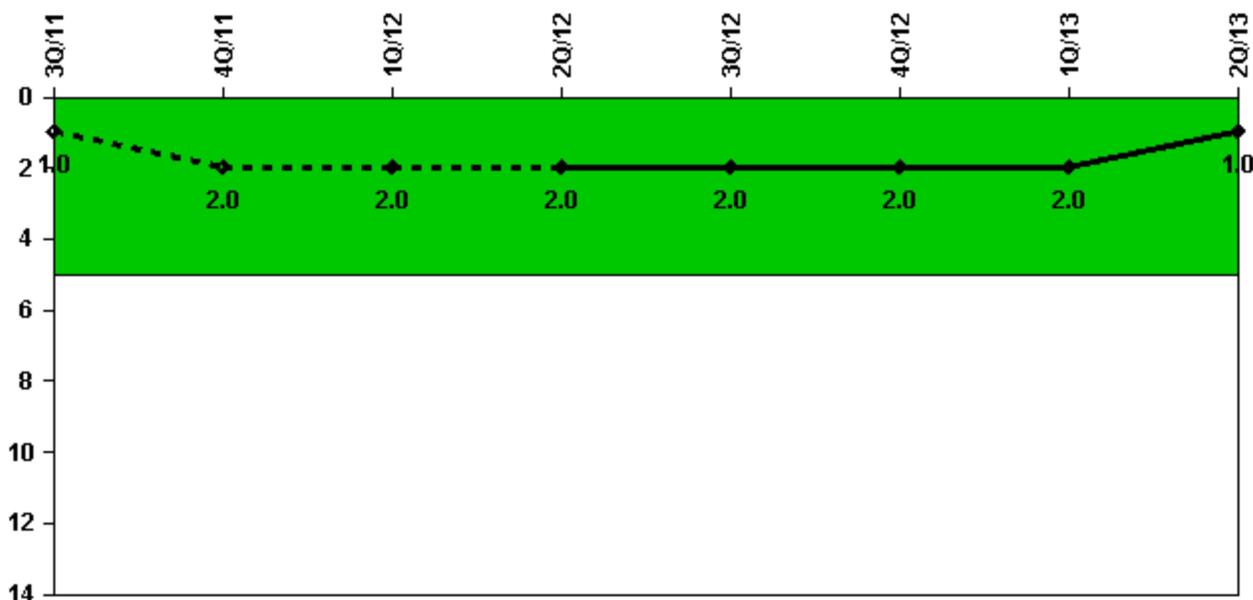

Thresholds: White > 5.0

Notes

Safety System Functional Failures (PWR)	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Safety System Functional Failures	0	1	0	1	0	1	0	0
Indicator value	1	2	2	2	2	2	2	1

Licensee Comments:


3Q/12: A SSFF reported in Licensee Event Report number LER 2012-004-00 was not included in the 2nd quarter 2012 PI data that should have been. A change report is being submitted with the 3rd quarter 2012 data submittal to provide this information. This difference in information has no affect on the PI color, which remains GREEN.

2Q/12: LER 2012-004-00. A SSFF was reported in Licensee Event Report number LER 2012-004-00. This SSFF was not originally reported with the 2nd Quarter 2012 data submittal. This has been entered into the corrective action program under CR-WF3-2012-5133. There is no affect on the PI color, which remains GREEN.

4Q/11: A SSFF associated with the Heat Removal System was reported in Licensee Event Report 2011-005-00.

3Q/11: A change file is being submitted this quarter to provide a Licensee Event Report number for a Safety System Functional Failure that occurred in the second quarter of 2011. There is no change to the PI value or color.

Mitigating Systems Performance Index, Emergency AC Power System

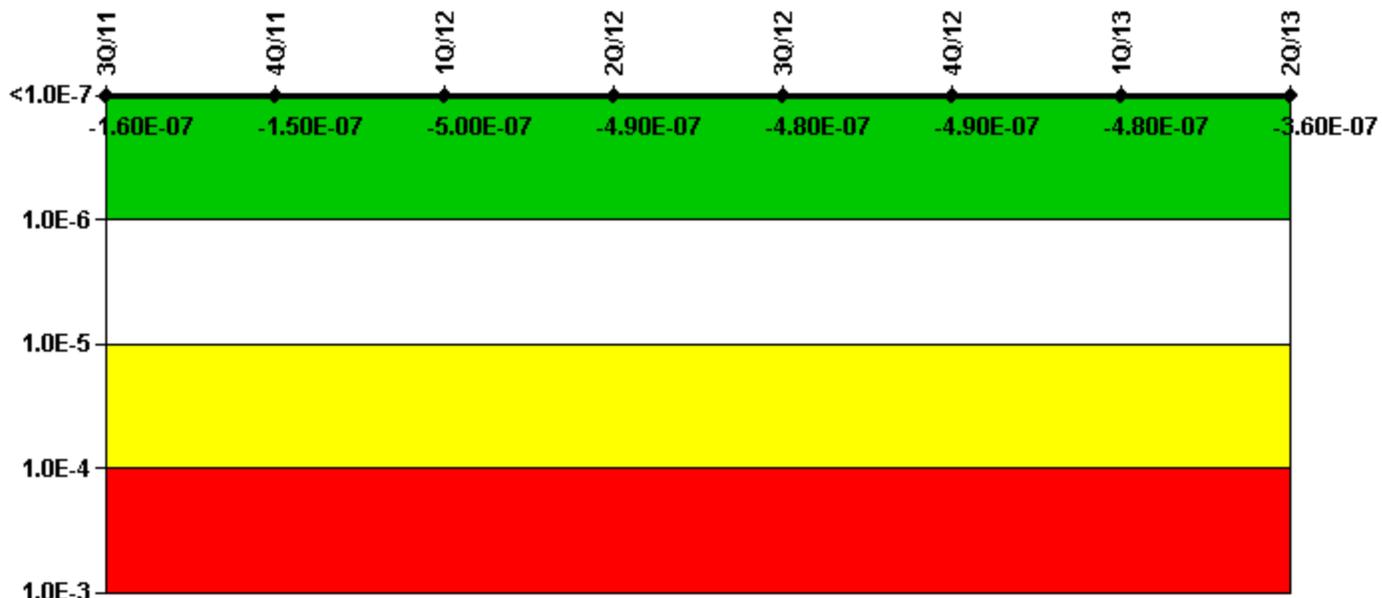

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Emergency AC Power System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI (ΔCDF)	1.38E-07	1.38E-07	4.65E-08	1.66E-08	1.76E-08	-2.66E-09	-3.60E-09	1.19E-07
URI (ΔCDF)	-2.99E-07	-2.86E-07	-5.47E-07	-5.04E-07	-5.01E-07	-4.87E-07	-4.77E-07	-4.76E-07
PLE	NO							
Indicator value	-1.60E-07	-1.50E-07	-5.00E-07	-4.90E-07	-4.80E-07	-4.90E-07	-4.80E-07	-3.60E-07

Licensee Comments:

2Q/12: Changed PRA Parameter(s). The Waterford 3 MSPI Basis Document was revised in April 2012 to change the PRA parameters for the Emergency AC Power System in response to approved FAQs, and was effective with the 1st quarter 2012 MSPI data.

1Q/12: Changed PRA Parameter(s). The Waterford 3 MSPI Basis Document was revised to change the PRA parameters for the Emergency AC Power System in response to approved FAQs, and is effective with the 1st quarter 2012 MSPI data.

Mitigating Systems Performance Index, High Pressure Injection System

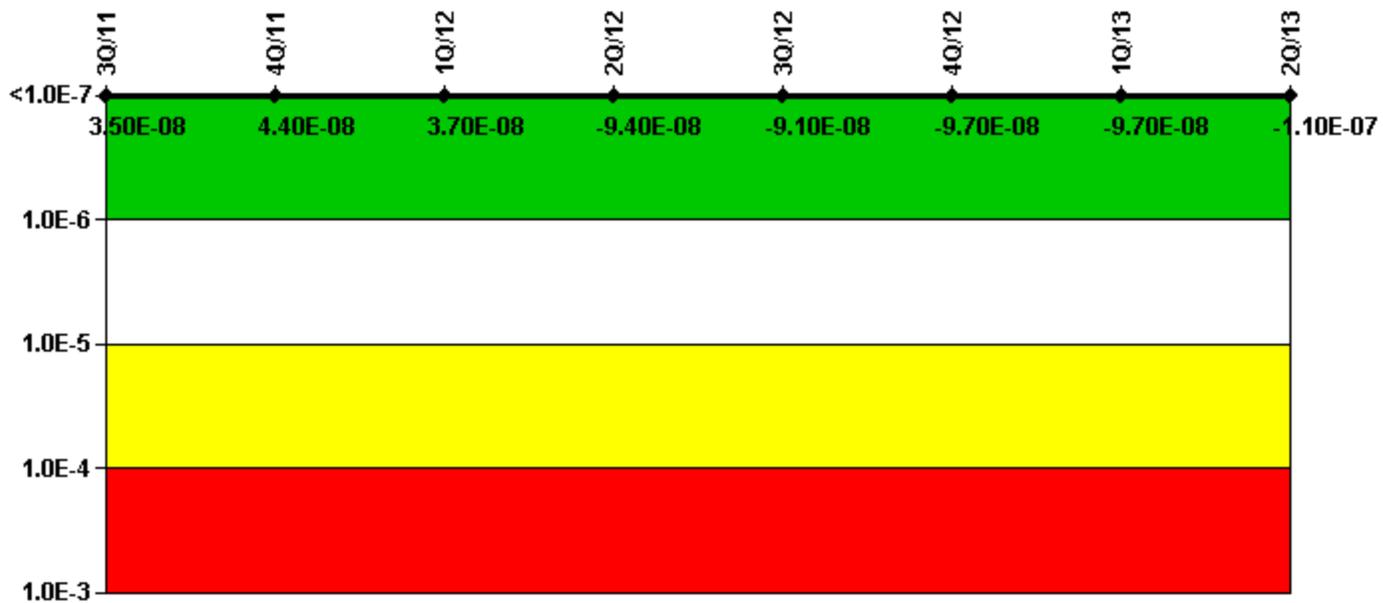


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI (Δ CDF)	1.29E-08	1.29E-08	1.74E-09	-4.26E-09	-4.22E-09	-5.25E-09	-5.10E-09	-1.30E-08
URI (Δ CDF)	2.20E-08	3.10E-08	3.53E-08	-8.97E-08	-8.71E-08	-9.13E-08	-9.23E-08	-9.29E-08
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	3.50E-08	4.40E-08	3.70E-08	-9.40E-08	-9.10E-08	-9.70E-08	-9.70E-08	-1.10E-07

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

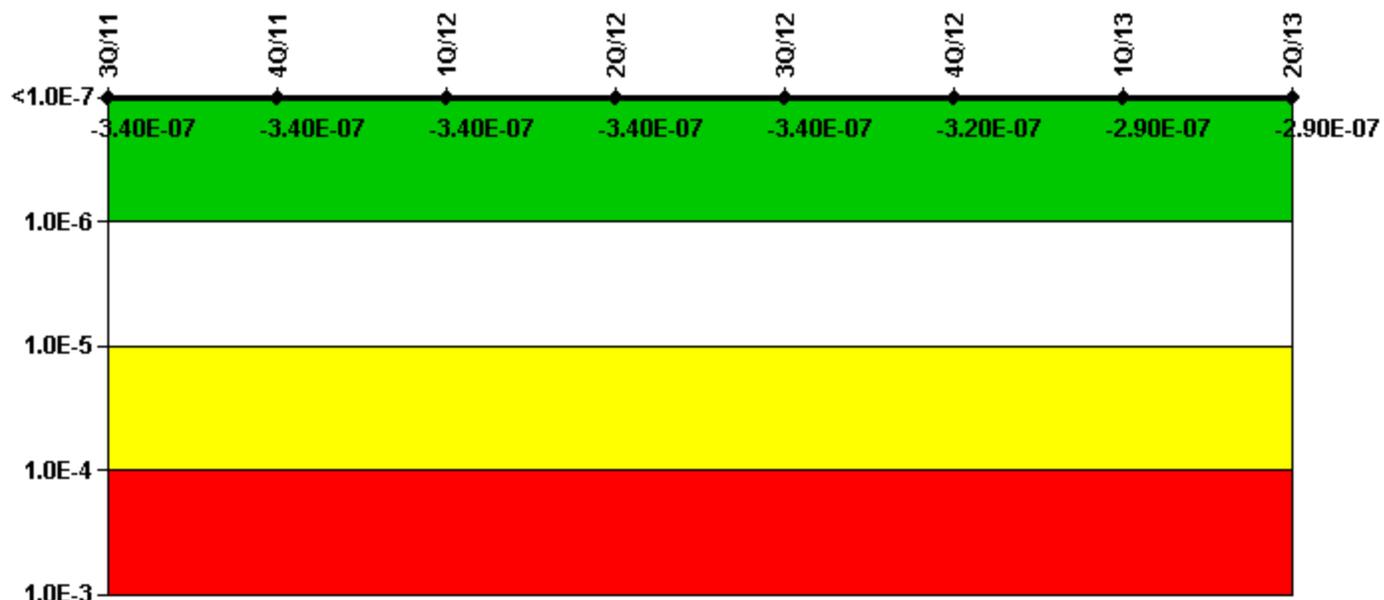


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI (Δ CDF)	-4.30E-08	-4.27E-08	-4.27E-08	-4.30E-08	-4.30E-08	-3.12E-08	1.62E-08	1.55E-08
URI (Δ CDF)	-3.02E-07	-3.00E-07	-2.96E-07	-3.00E-07	-3.02E-07	-2.92E-07	-3.06E-07	-3.06E-07
PLE	NO							
Indicator value	-3.40E-07	-3.40E-07	-3.40E-07	-3.40E-07	-3.40E-07	-3.20E-07	-2.90E-07	-2.90E-07

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

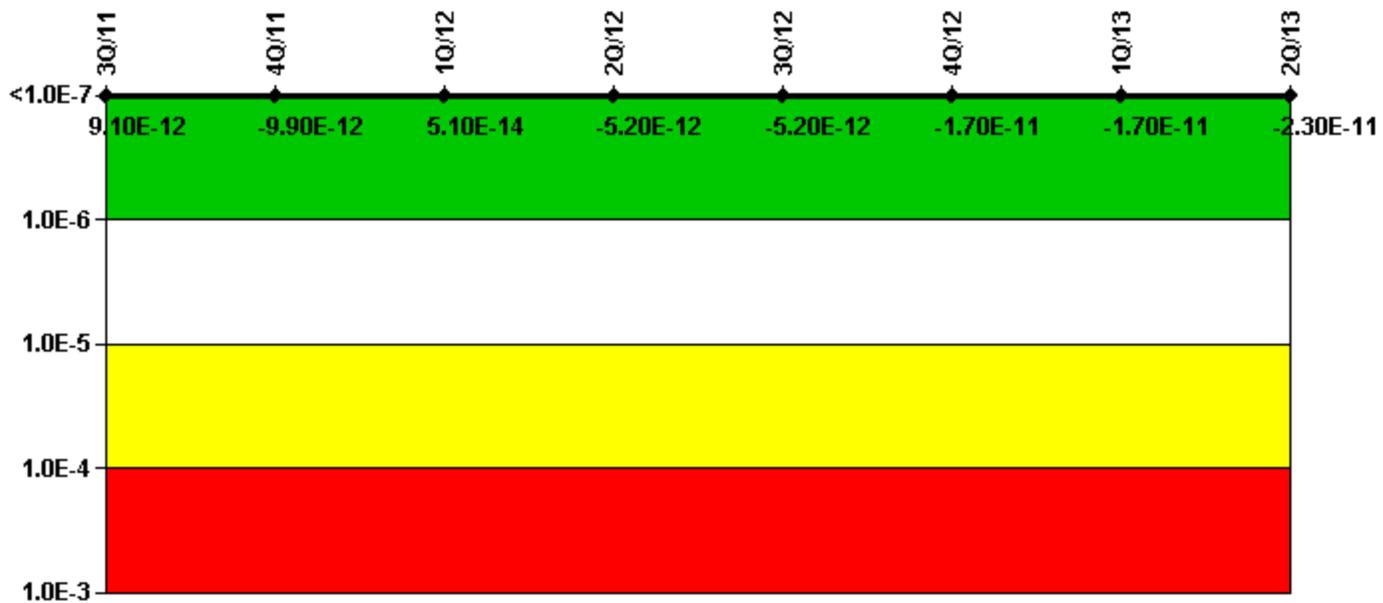


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI (Δ CDF)	2.08E-11	1.61E-12	1.17E-11	6.30E-12	6.63E-12	-5.00E-12	-4.89E-12	-1.07E-11
URI (Δ CDF)	-1.16E-11	-1.16E-11	-1.16E-11	-1.15E-11	-1.18E-11	-1.17E-11	-1.19E-11	-1.18E-11
PLE	NO							
Indicator value	9.10E-12	-9.90E-12	5.10E-14	-5.20E-12	-5.20E-12	-1.70E-11	-1.70E-11	-2.30E-11

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

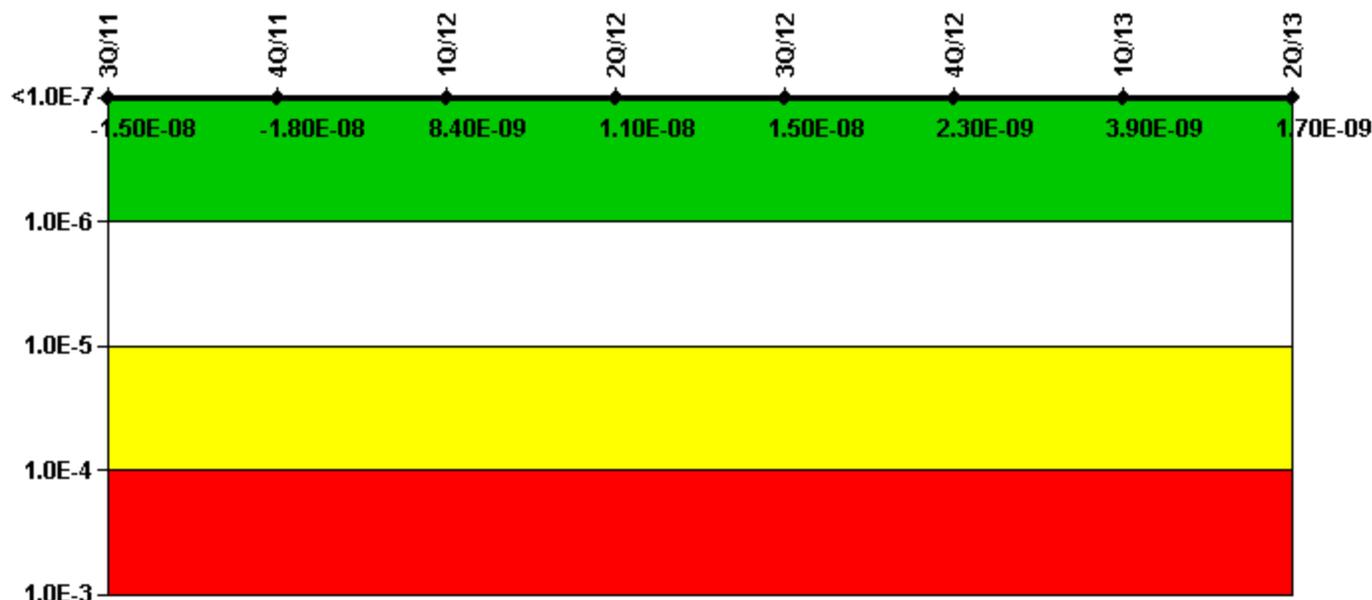

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Cooling Water Systems	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
UAI (Δ CDF)	1.13E-08	8.18E-09	3.38E-08	3.69E-08	4.07E-08	4.12E-08	4.25E-08	4.15E-08
URI (Δ CDF)	-2.67E-08	-2.59E-08	-2.54E-08	-2.56E-08	-2.56E-08	-3.89E-08	-3.86E-08	-3.98E-08
PLE	NO							
Indicator value	-1.50E-08	-1.80E-08	8.40E-09	1.10E-08	1.50E-08	2.30E-09	3.90E-09	1.70E-09

Licensee Comments:

3Q/12: An evaluation of an component event previously reported as a MSPI failure in the 2nd quarter 2012 PI data determined that there was not a failure. A change report is being submitted with the 3rd quarter 2012 data submittal to remove this failure based on final evaluation. This change in information has no affect on the PI color, which remains GREEN.

2Q/12: An evaluation of an component event that was reported as a MSPI failure in the 2nd quarter 2012 PI data based on preliminary information has determined that there was not a failure. A change report is being submitted with the 3rd quarter 2012 data submittal to remove this failure. This change in information has no affect on the PI color, which remains GREEN.

Reactor Coolant System Activity

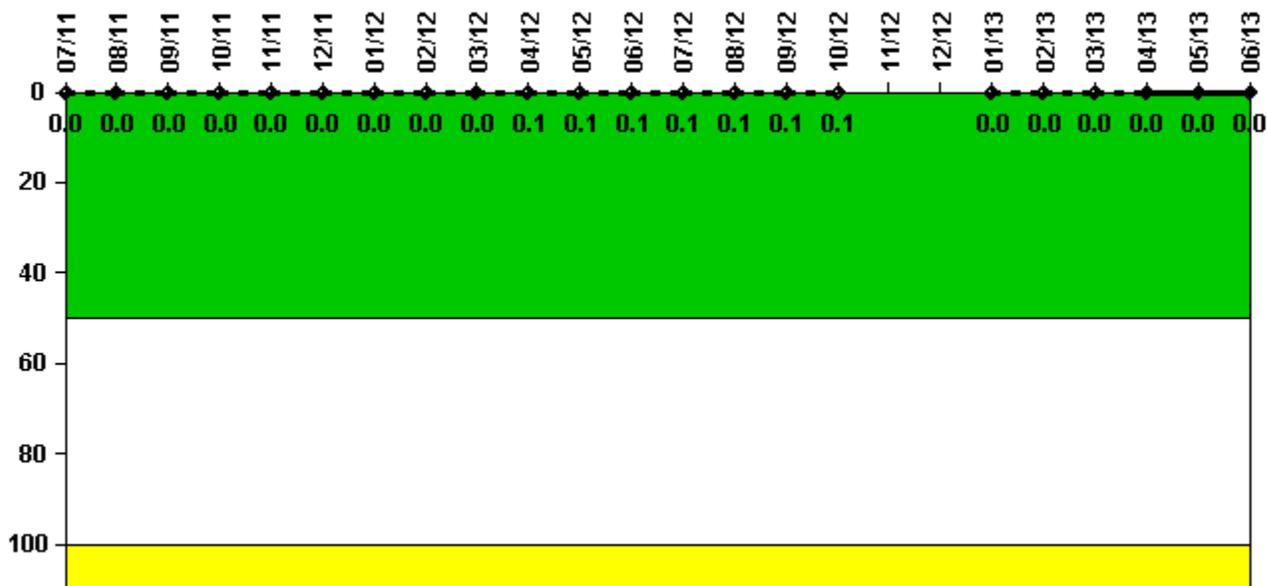

Thresholds: White > 50.0 Yellow > 100.0


Notes

Reactor Coolant System Activity	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum activity	0.000436	0.000424	0.000413	0.000307	0.000449	0.000314	0.000499	0.000331	0.000355	0.000522	0.000580	0.000657
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0.1	0.1	0.1

Reactor Coolant System Activity	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum activity	0.000634	0.000614	0.000622	0.000671	N/A	N/A	0.000103	0.000187	0.000201	0.000221	0.000211	0.000246
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0.1	0.1	0.1	0.1	N/A	N/A	0	0	0	0	0	0

Licensee Comments: none

Reactor Coolant System Leakage

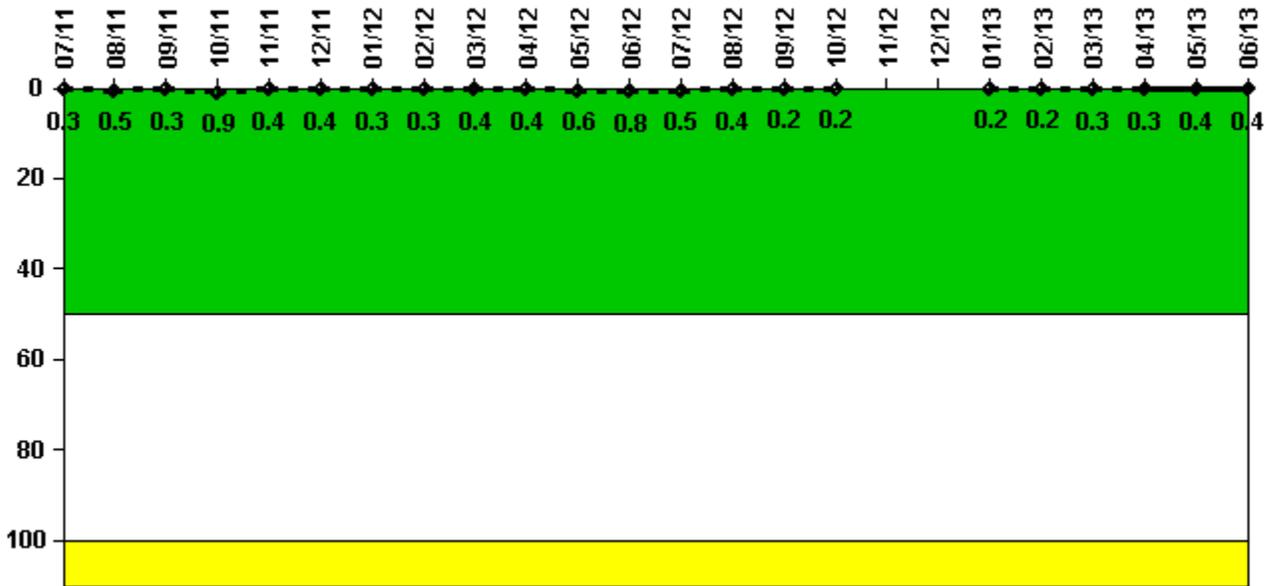


Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	7/11	8/11	9/11	10/11	11/11	12/11	1/12	2/12	3/12	4/12	5/12	6/12
Maximum leakage	0.030	0.050	0.030	0.090	0.040	0.040	0.030	0.030	0.040	0.040	0.060	0.080
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.3	0.5	0.3	0.9	0.4	0.4	0.3	0.3	0.4	0.4	0.6	0.8
Reactor Coolant System Leakage	7/12	8/12	9/12	10/12	11/12	12/12	1/13	2/13	3/13	4/13	5/13	6/13
Maximum leakage	0.050	0.040	0.020	0.020	N/A	N/A	0.020	0.020	0.030	0.030	0.040	0.040
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.4	0.2	0.2	N/A	N/A	0.2	0.2	0.3	0.3	0.4	0.4

Licensee Comments: none

Drill/Exercise Performance

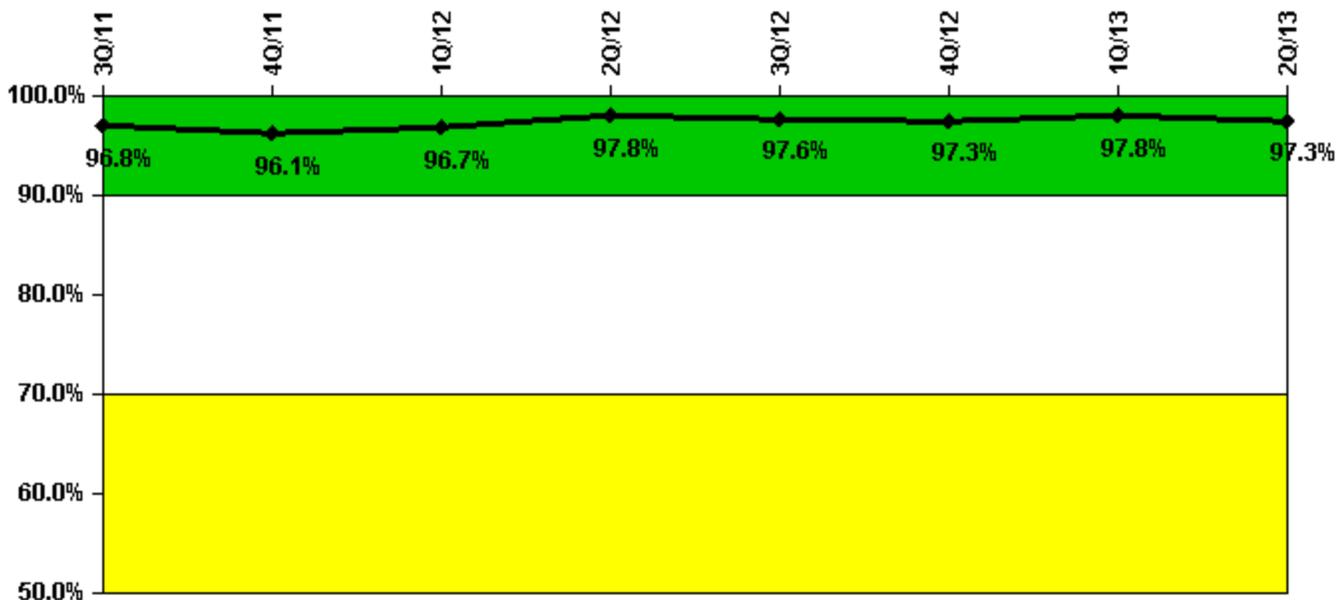


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Successful opportunities	17.0	37.0	36.0	62.0	32.0	0	23.0	46.0
Total opportunities	18.0	40.0	36.0	62.0	32.0	0	24.0	48.0
Indicator value	96.8%	96.1%	96.7%	97.8%	97.6%	97.3%	97.8%	97.3%

Licensee Comments: none

ERO Drill Participation

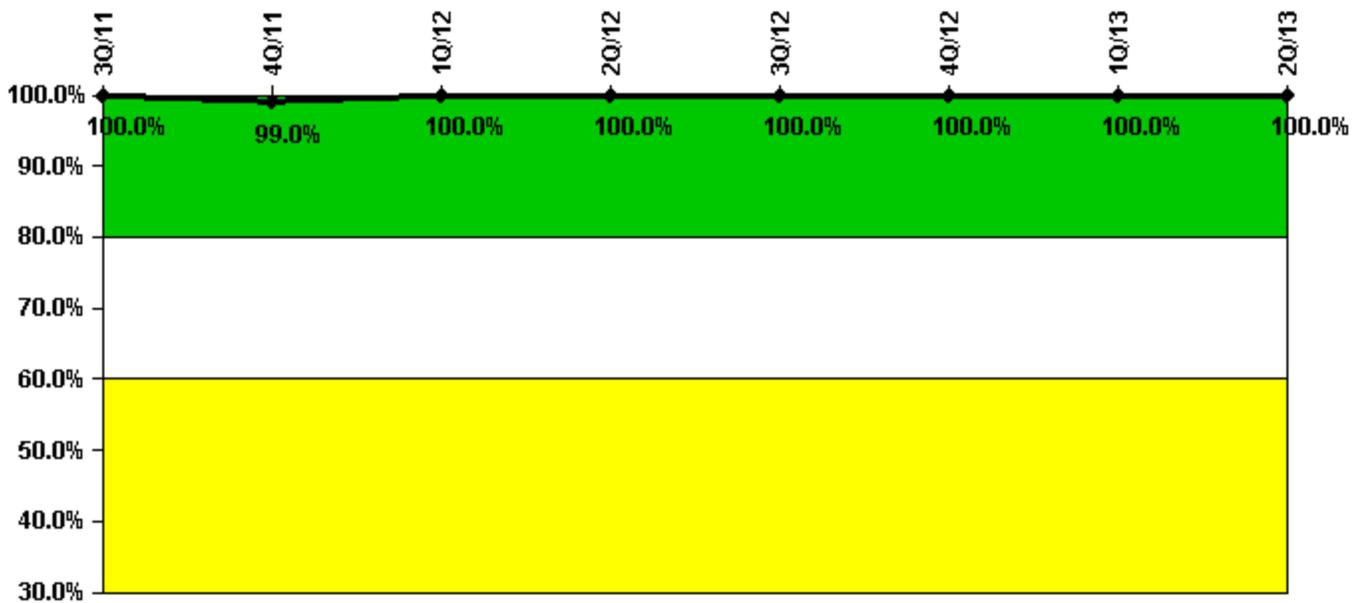


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Participating Key personnel	92.0	97.0	93.0	94.0	95.0	96.0	98.0	100.0
Total Key personnel	92.0	98.0	93.0	94.0	95.0	96.0	98.0	100.0
Indicator value	100.0%	99.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

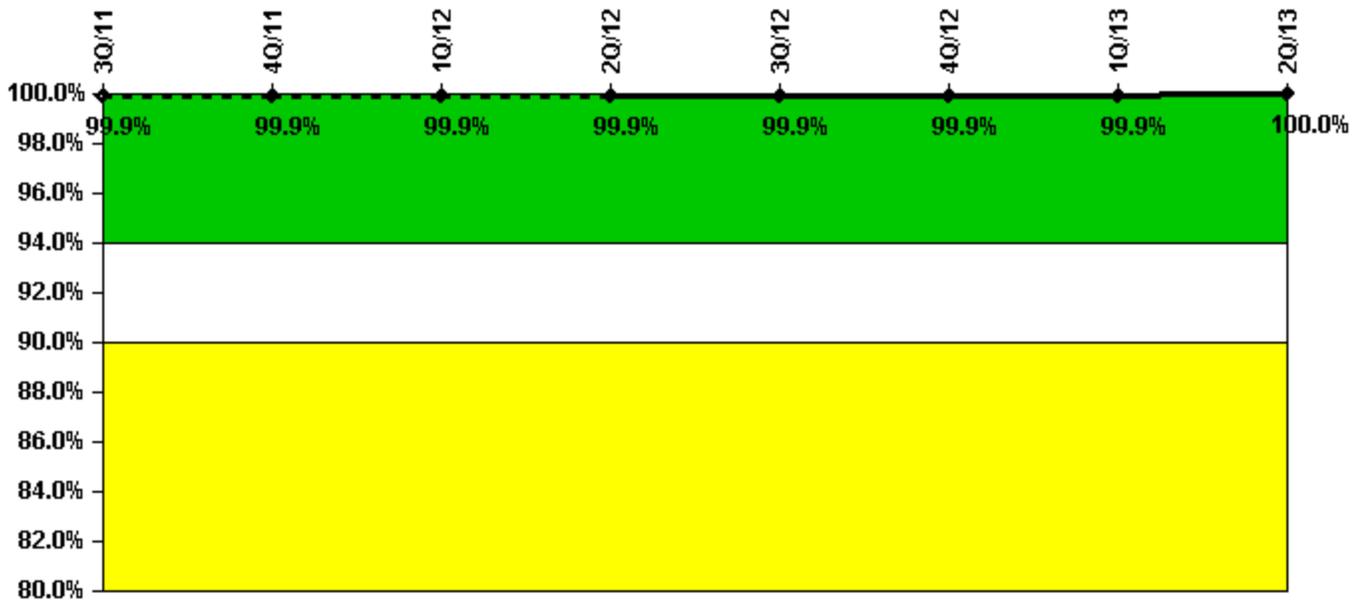


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
Successful siren-tests	437	438	438	437	438	438	438	438
Total sirens-tests	438	438	438	438	438	438	438	438
Indicator value	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	99.9%	100.0%

Licensee Comments: none

Occupational Exposure Control Effectiveness

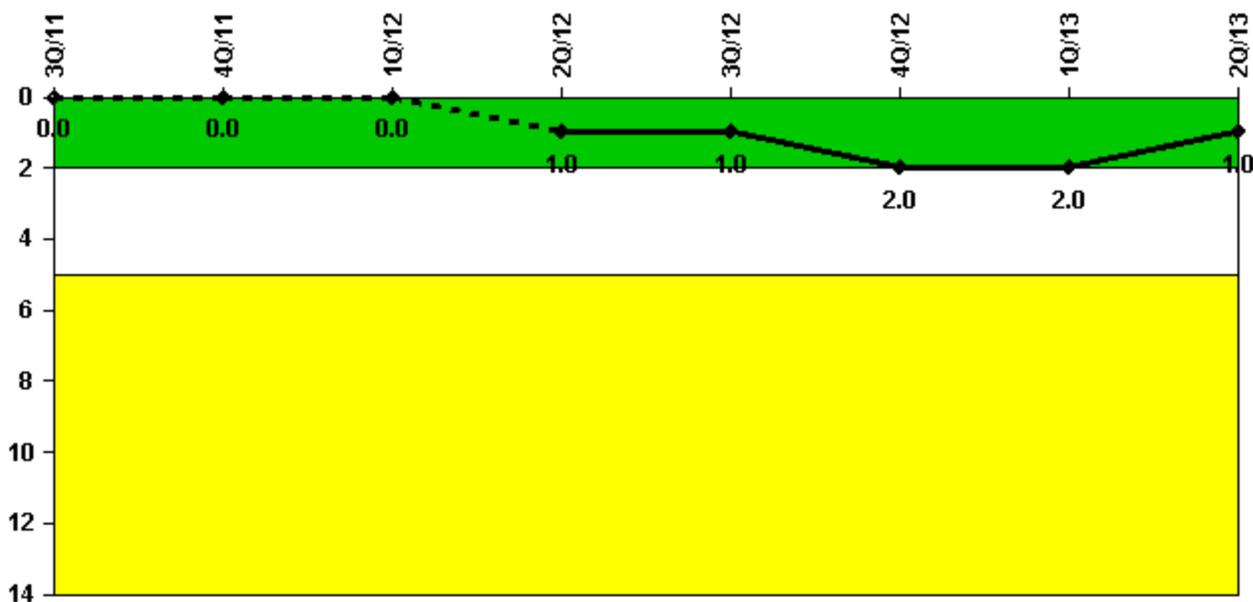

Thresholds: White > 2.0 Yellow > 5.0


Notes

Occupational Exposure Control Effectiveness	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
High radiation area occurrences	0	0	0	1	0	1	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	1	1	2	2	1

Licensee Comments:

4Q/12: The high radiation area occurrence reported in the 4th Quarter 2012 data submittal has been conservatively reported while a FAQ is developed based on other approved FAQs that address similar situations.

RETS/ODCM Radiological Effluent

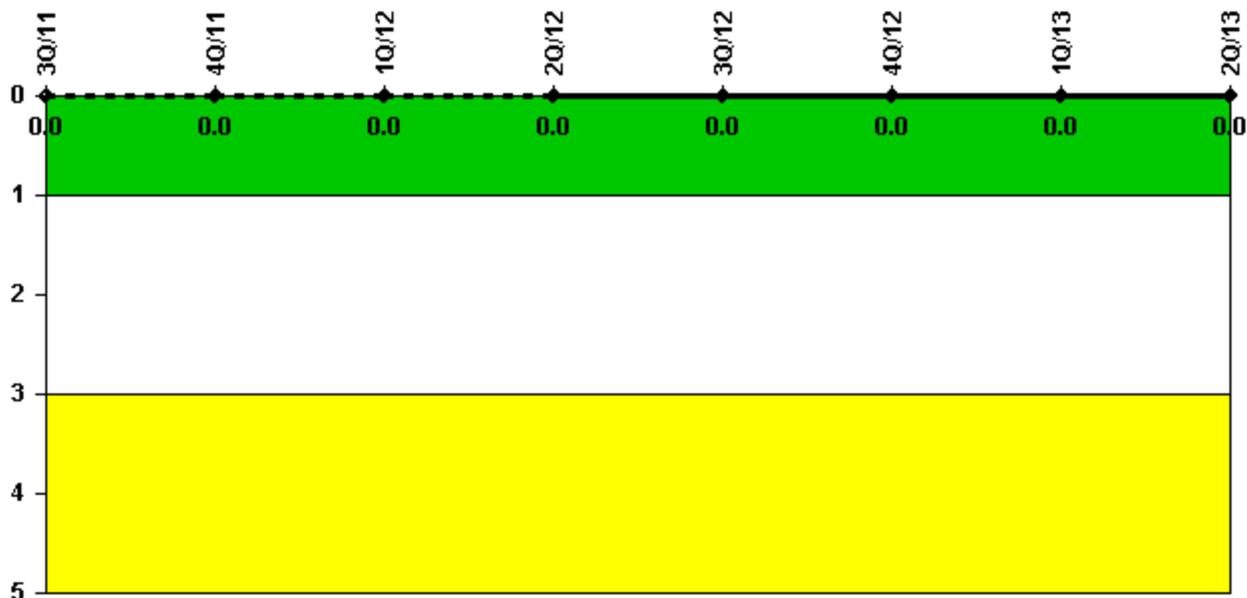

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	3Q/11	4Q/11	1Q/12	2Q/12	3Q/12	4Q/12	1Q/13	2Q/13
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0							

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: August 19, 2013