


## Comanche Peak 2

### 3Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

#### Unplanned Scrams per 7000 Critical Hrs

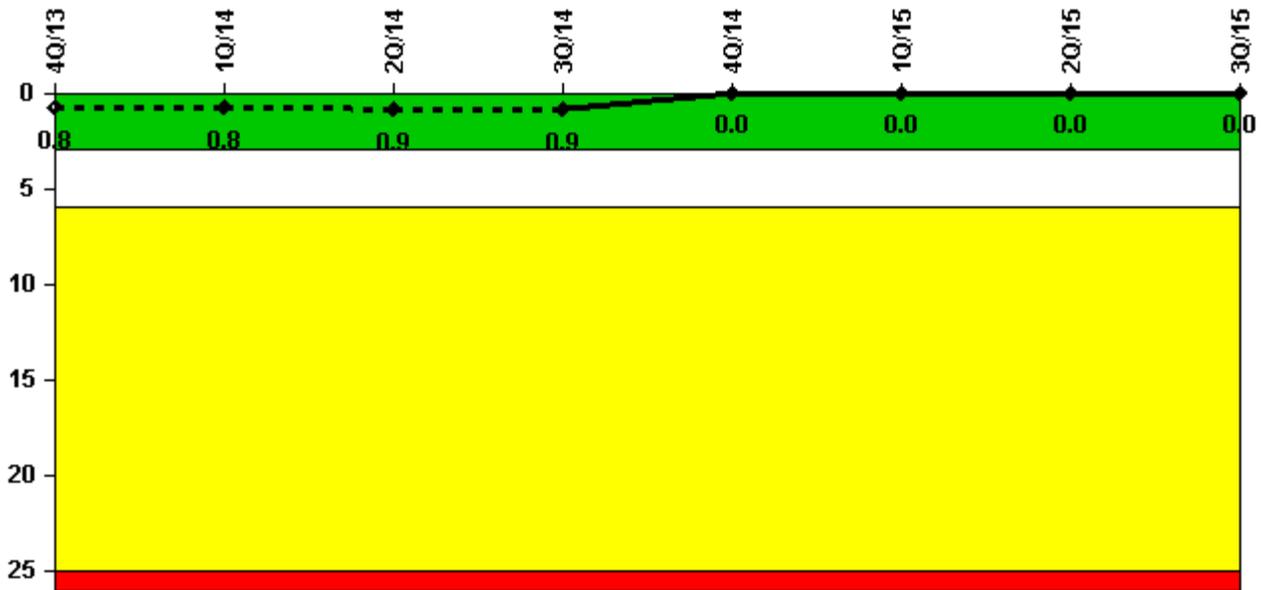


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

#### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned scrams	1.0	0	0	0	0	0	0	0
Critical hours	2177.3	2099.0	1563.6	2208.0	2209.0	2159.0	2184.0	2208.0
<b>Indicator value</b>	<b>0.8</b>	<b>0.8</b>	<b>0.9</b>	<b>0.9</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments: none

### Unplanned Power Changes per 7000 Critical Hrs

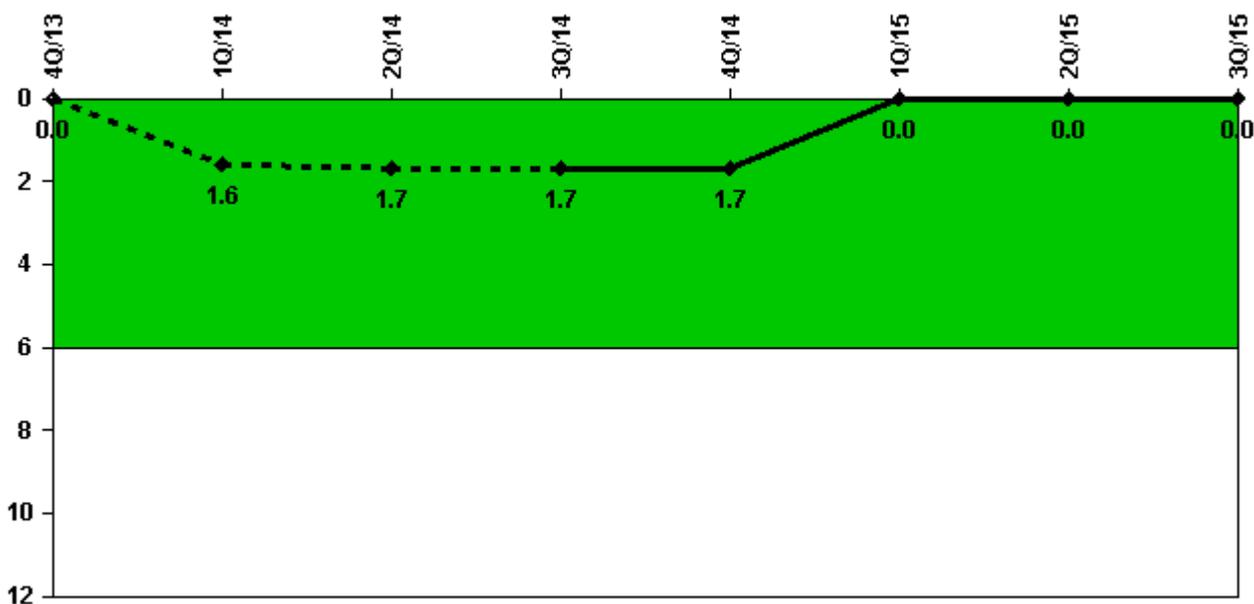

Thresholds: White > 6.0

#### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned power changes	0	2.0	0	0	0	0	0	0
Critical hours	2177.3	2099.0	1563.6	2208.0	2209.0	2159.0	2184.0	2208.0
<b>Indicator value</b>	<b>0</b>	<b>1.6</b>	<b>1.7</b>	<b>1.7</b>	<b>1.7</b>	<b>0</b>	<b>0</b>	<b>0</b>


#### Licensee Comments:

3Q/15: A Notice of Enforcement Discretion has been granted without which the unit would have had an unplanned power change of greater than 20-percent of full power.

1Q/14: One additional unplanned power change for Feb 2014 was identified. This change does not affect the ??? color??? of the indicator.

4Q/13: The NRC granted an NOED during this quarter, which, if not granted, may have resulted in an unplanned power change.

### Unplanned Scrams with Complications

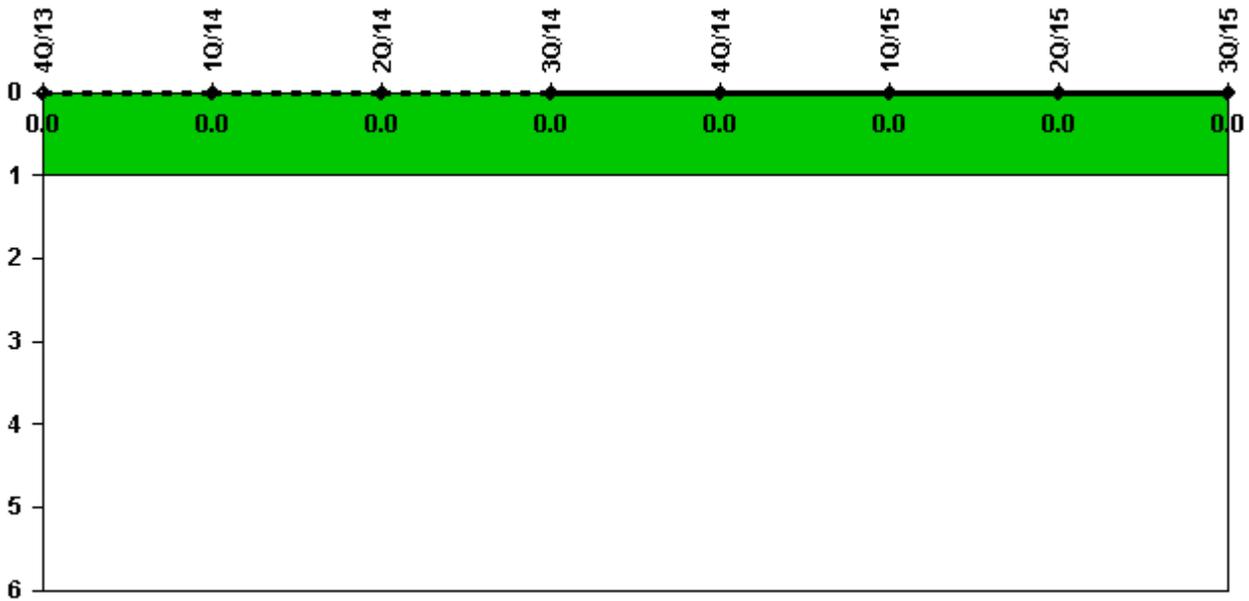


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0.0</b>							

Licensee Comments: none

### Safety System Functional Failures (PWR)

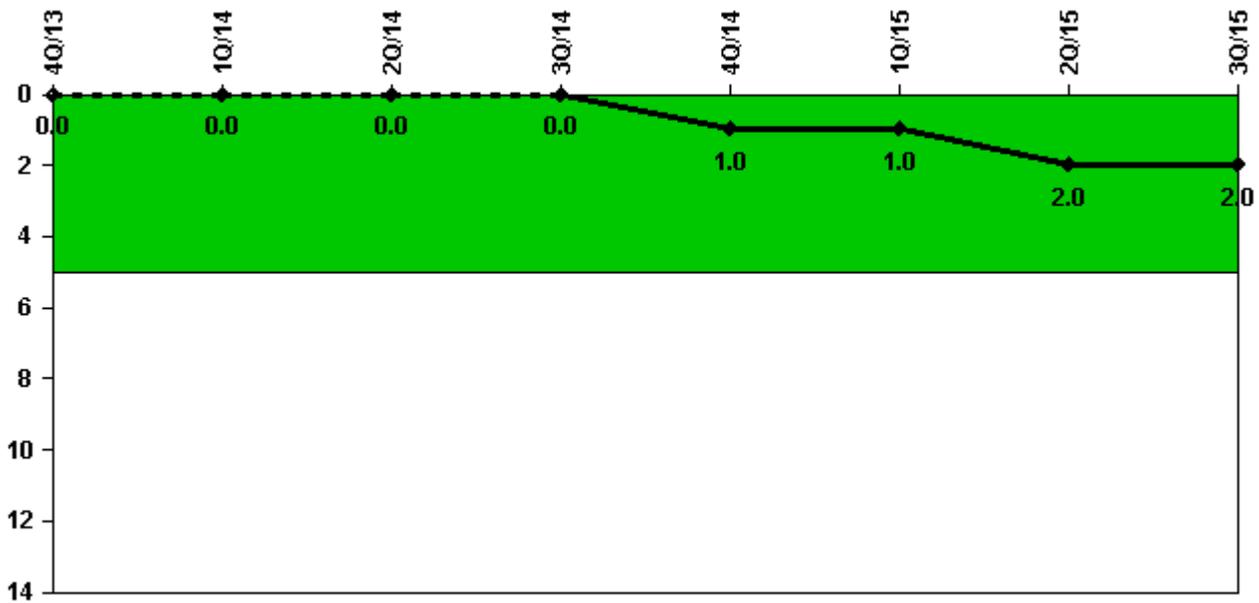

Thresholds: White > 5.0

#### Notes


Safety System Functional Failures (PWR)	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Safety System Functional Failures	0	0	0	0	1	0	1	0
<b>Indicator value</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>1</b>	<b>1</b>	<b>2</b>	<b>2</b>

Licensee Comments:

2Q/15: LER 1-15-001.

4Q/14: LER 446/14-005-00

### Mitigating Systems Performance Index, Emergency AC Power System

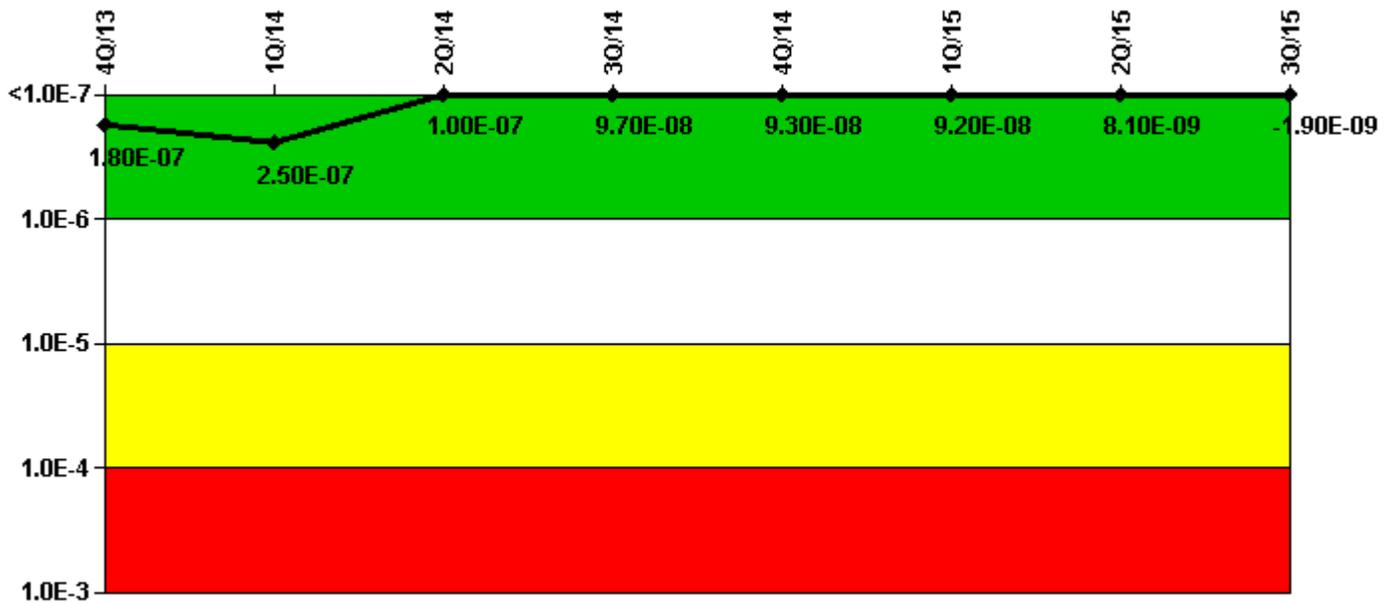

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	4.57E-08	4.95E-08	4.62E-08	4.14E-08	4.05E-08	4.05E-08	2.98E-08	2.14E-08
URI ( $\Delta$ CDF)	1.31E-07	2.03E-07	5.73E-08	5.54E-08	5.22E-08	5.14E-08	-2.18E-08	-2.33E-08
PLE	NO	NO						
Indicator value	1.80E-07	2.50E-07	1.00E-07	9.70E-08	9.30E-08	9.20E-08	8.10E-09	-1.90E-09

Licensee Comments:

2Q/14: Added 1.7 hours of unavailability for EDG 2-02 in June 2014 that was previously overlooked. This change did not affect the color of the indicator.

### Mitigating Systems Performance Index, High Pressure Injection System

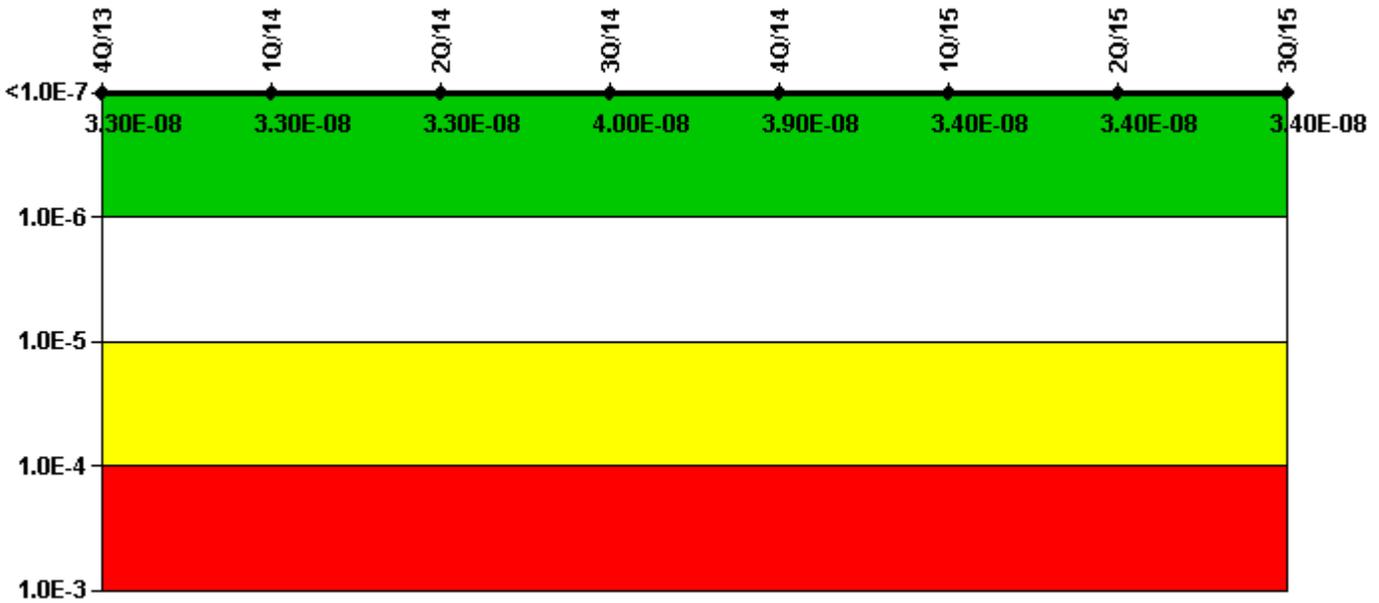


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	3.99E-12	1.57E-11	1.54E-11	1.73E-09	1.73E-09	1.45E-09	1.45E-09	1.50E-09
URI ( $\Delta$ CDF)	3.35E-08	3.33E-08	3.33E-08	3.78E-08	3.76E-08	3.29E-08	3.27E-08	3.26E-08
PLE	NO							
Indicator value	3.30E-08	3.30E-08	3.30E-08	4.00E-08	3.90E-08	3.40E-08	3.40E-08	3.40E-08

Licensee Comments: none

### Mitigating Systems Performance Index, Heat Removal System

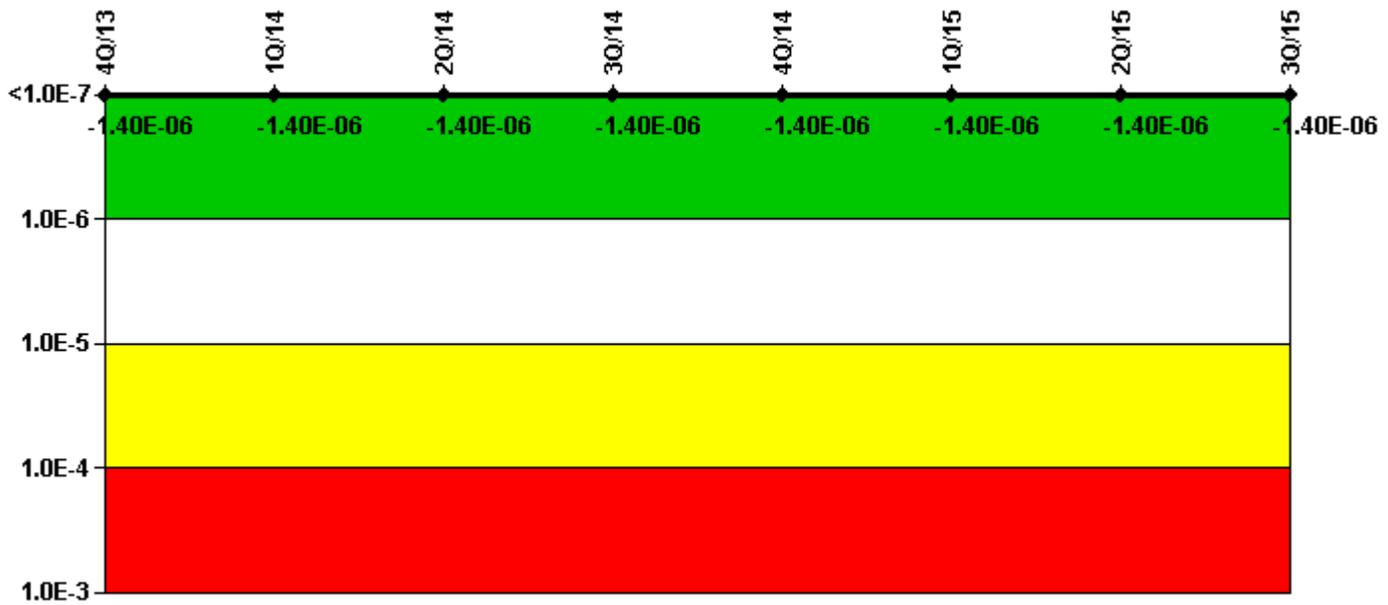

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-1.08E-06	-1.07E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06	-1.09E-06
URI ( $\Delta$ CDF)	-2.92E-07	-2.99E-07	-2.97E-07	-2.96E-07	-2.95E-07	-3.02E-07	-3.01E-07	-3.08E-07
PLE	NO							
Indicator value	-1.40E-06							

Licensee Comments: none

### Mitigating Systems Performance Index, Residual Heat Removal System




Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-8.59E-10	-8.59E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10	-8.41E-10
URI ( $\Delta$ CDF)	-2.47E-09	-2.47E-09	-2.48E-09	-2.47E-09	-2.47E-09	-2.47E-09	-2.47E-09	-2.47E-09
PLE	NO							
Indicator value	-3.30E-09							

Licensee Comments: none

### Mitigating Systems Performance Index, Cooling Water Systems

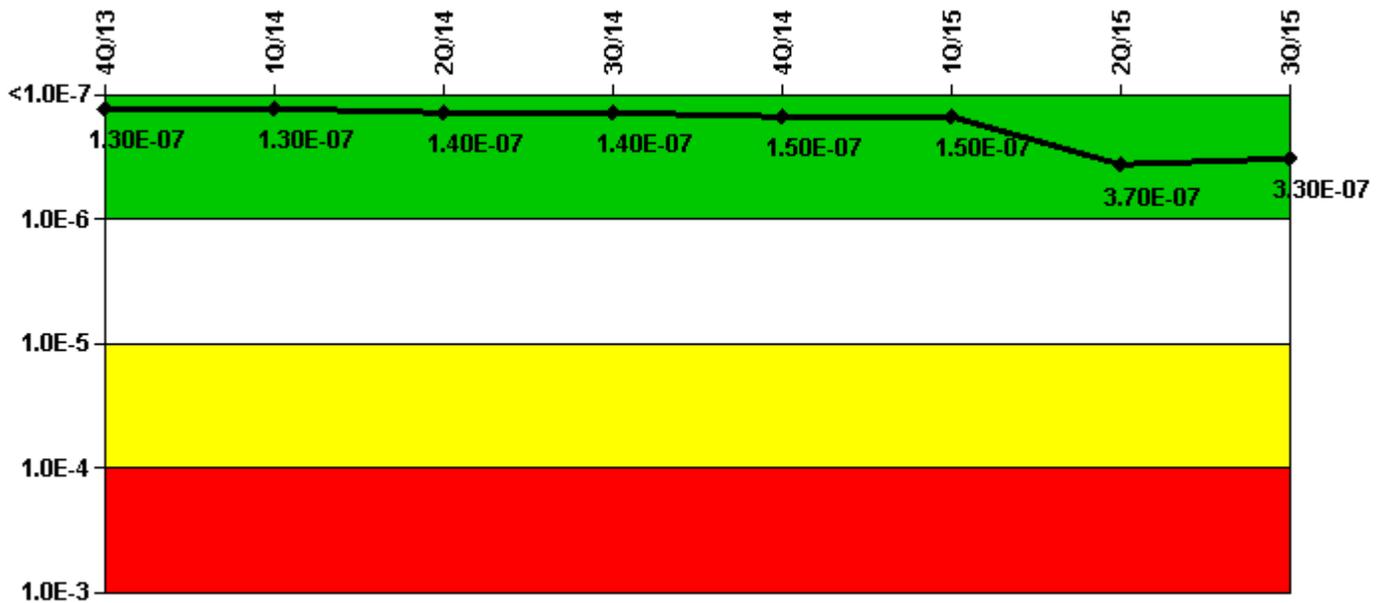

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes


Mitigating Systems Performance Index, Cooling Water Systems	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-1.32E-08	-9.93E-09	2.39E-09	1.69E-09	9.18E-09	8.66E-09	1.57E-08	-2.97E-08
URI ( $\Delta$ CDF)	1.40E-07	1.38E-07	1.40E-07	1.40E-07	1.39E-07	1.37E-07	3.56E-07	3.57E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	1.30E-07	1.30E-07	1.40E-07	1.40E-07	1.50E-07	1.50E-07	3.70E-07	3.30E-07

#### Licensee Comments:

2Q/15: The MS10 Cooling Water System data for 2Q15 was corrected for an ICES report on a Service Water pump breaker issue that needed to be included as a failure. This change did not affect the color of the indicator.

4Q/13: The Unit 2 Cooling Water System data for 4Q2013 has been corrected to include a failure record (ICES 307922). This is an MSPI failure and is reported for OE criteria. This data change did not result in a change to the indicator color.

### Reactor Coolant System Activity

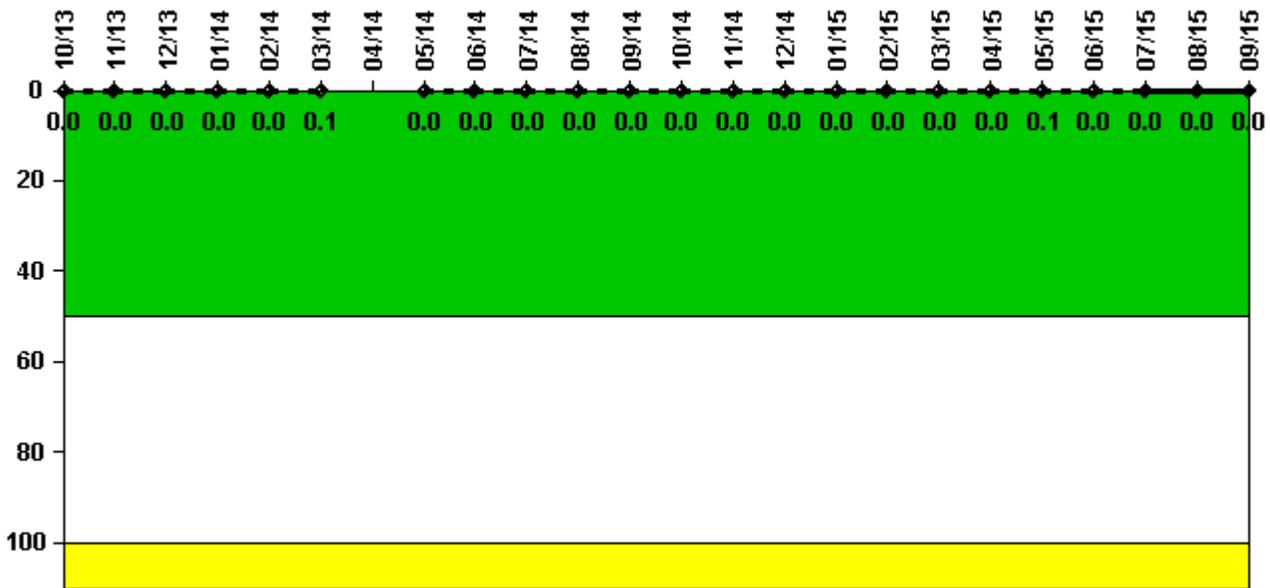

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum activity	0.000123	0.000223	0.000142	0.000168	0.000158	0.000439	N/A	0.000098	0.000097	0.000113	0.000146	0.000140
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0.1	N/A	0	0	0	0	0

Reactor Coolant System Activity	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum activity	0.000133	0.000170	0.000130	0.000140	0.000161	0.000156	0.000158	0.000566	0.000145	0.000177	0.000156	0.000185
Technical specification limit	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5	0.5
Indicator value	0	0	0	0	0	0	0	0.1	0	0	0	0

Licensee Comments: none

### Reactor Coolant System Leakage

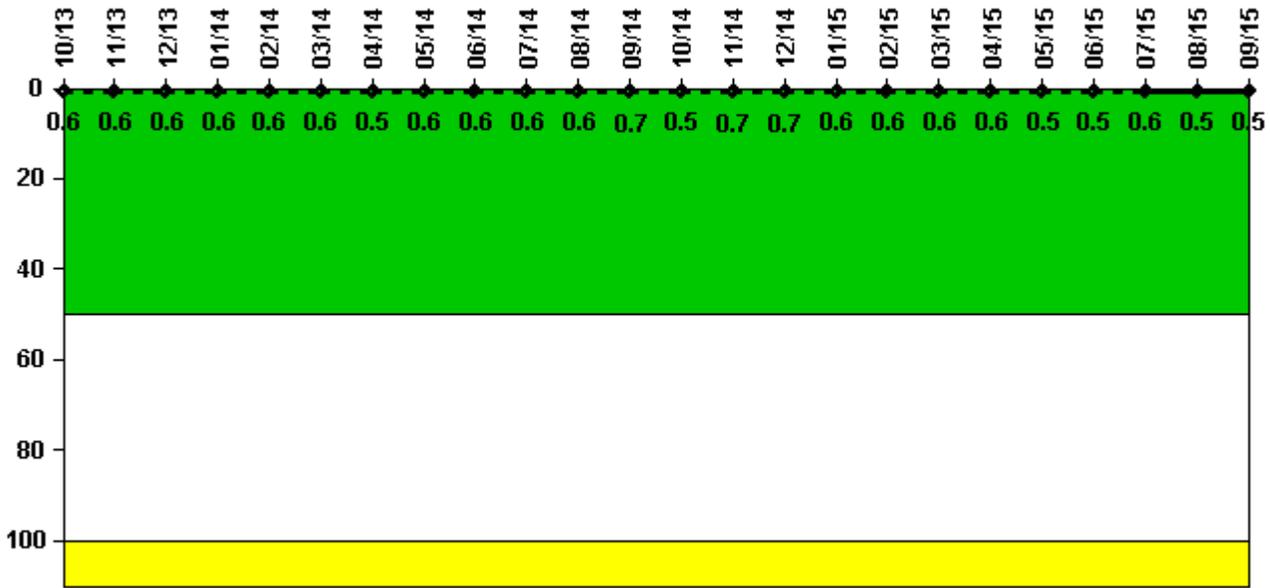

Thresholds: White > 50.0 Yellow > 100.0

#### Notes

Reactor Coolant System Leakage	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum leakage	0.059	0.059	0.060	0.060	0.059	0.064	0.054	0.060	0.055	0.060	0.060	0.067
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.5</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.7</b>

Reactor Coolant System Leakage	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum leakage	0.053	0.069	0.065	0.064	0.055	0.061	0.059	0.052	0.053	0.056	0.050	0.050
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
<b>Indicator value</b>	<b>0.5</b>	<b>0.7</b>	<b>0.7</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.6</b>	<b>0.5</b>	<b>0.5</b>	<b>0.6</b>	<b>0.5</b>	<b>0.5</b>


#### Licensee Comments:

- 9/15: RCS total leakage is being reported as identified leakage.
- 6/15: RCS total leakage is being reported as identified leakage.
- 3/15: RCS total leakage is being reported as identified leakage.
- 12/14: RCS total leakage is being reported as identified leakage.
- 9/14: RCS total leakage is being reported as identified leakage.
- 6/14: RCS total leakage is being reported as identified leakage.

3/14: RCS total leakage is being reported as identified leakage.

12/13: RCS total leakage is being reported as identified leakage.

### Drill/Exercise Performance

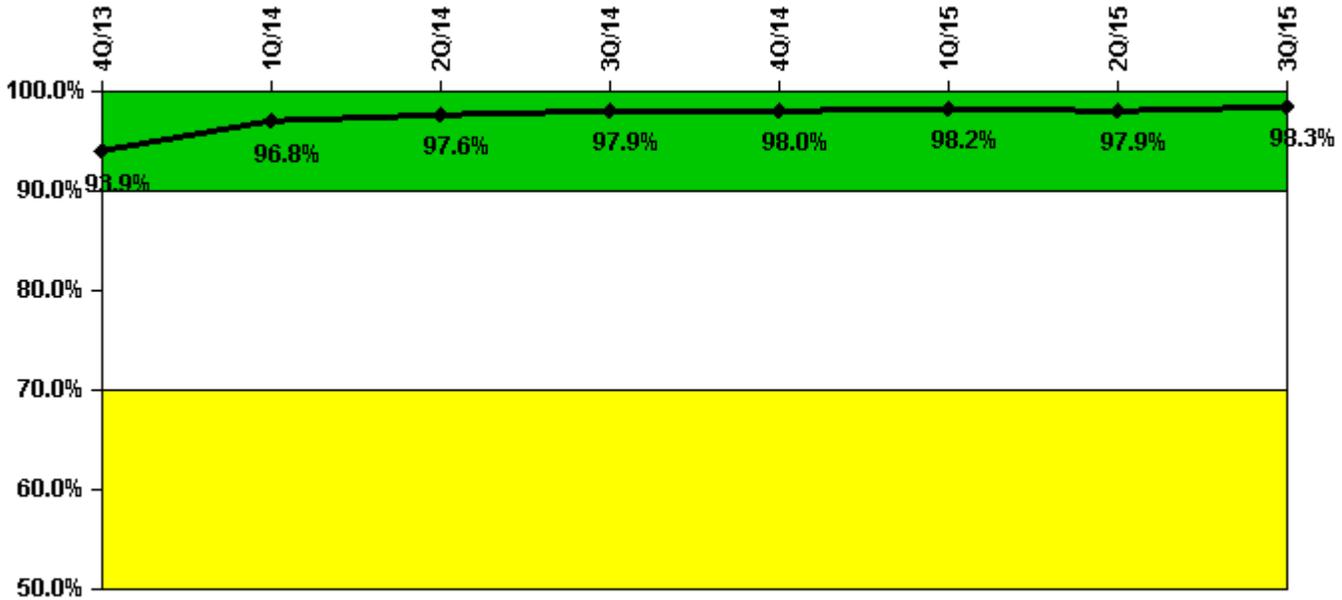


Thresholds: White < 90.0% Yellow < 70.0%

### Notes

Drill/Exercise Performance	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful opportunities	29.0	36.0	43.0	58.0	13.0	63.0	76.0	76.0
Total opportunities	32.0	36.0	43.0	58.0	13.0	63.0	79.0	77.0
Indicator value	93.9%	96.8%	97.6%	97.9%	98.0%	98.2%	97.9%	98.3%

Licensee Comments: none

### ERO Drill Participation

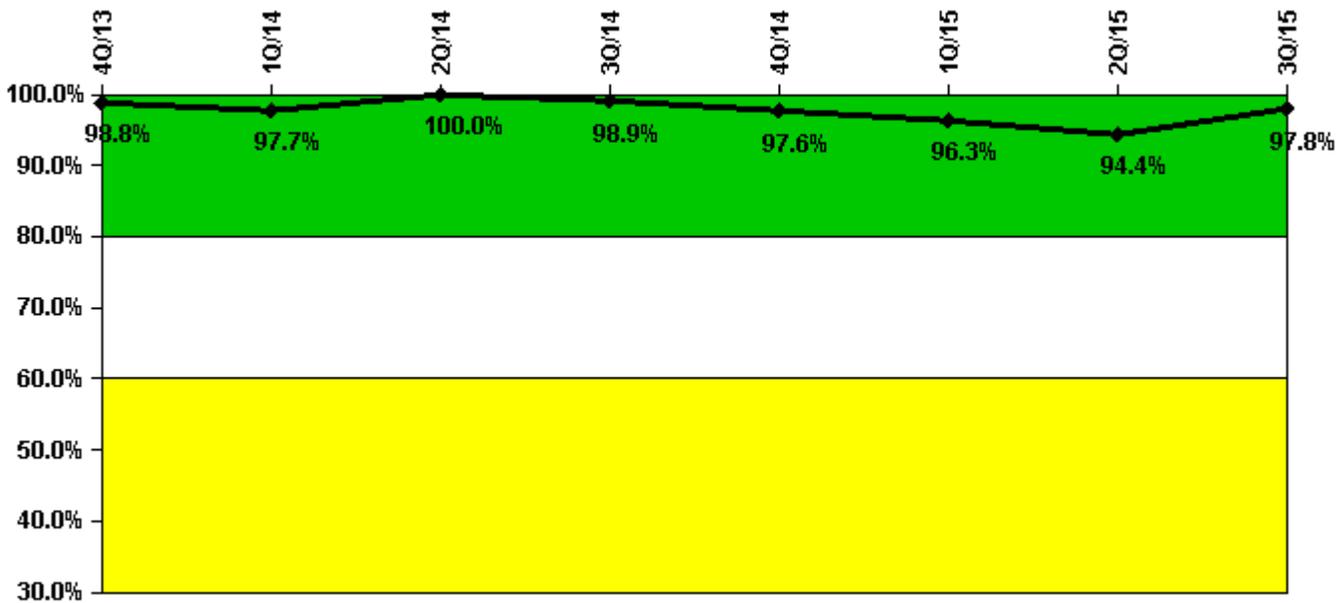


Thresholds: White < 80.0% Yellow < 60.0%

#### Notes

ERO Drill Participation	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Participating Key personnel	84.0	85.0	87.0	86.0	83.0	77.0	84.0	90.0
Total Key personnel	85.0	87.0	87.0	87.0	85.0	80.0	89.0	92.0
Indicator value	98.8%	97.7%	100.0%	98.9%	97.6%	96.3%	94.4%	97.8%

Licensee Comments: none

### Alert & Notification System

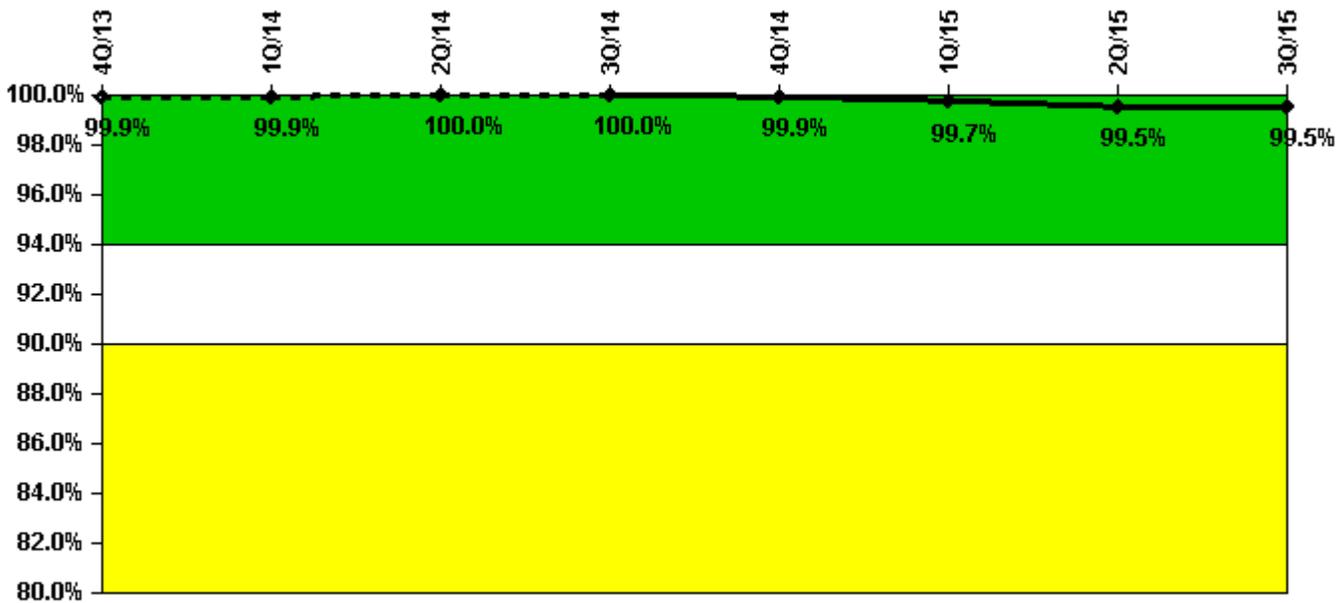


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful siren-tests	432	432	432	432	431	428	429	432
Total sirens-tests	432	432	432	432	432	432	432	432
Indicator value	99.9%	99.9%	100.0%	100.0%	99.9%	99.7%	99.5%	99.5%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

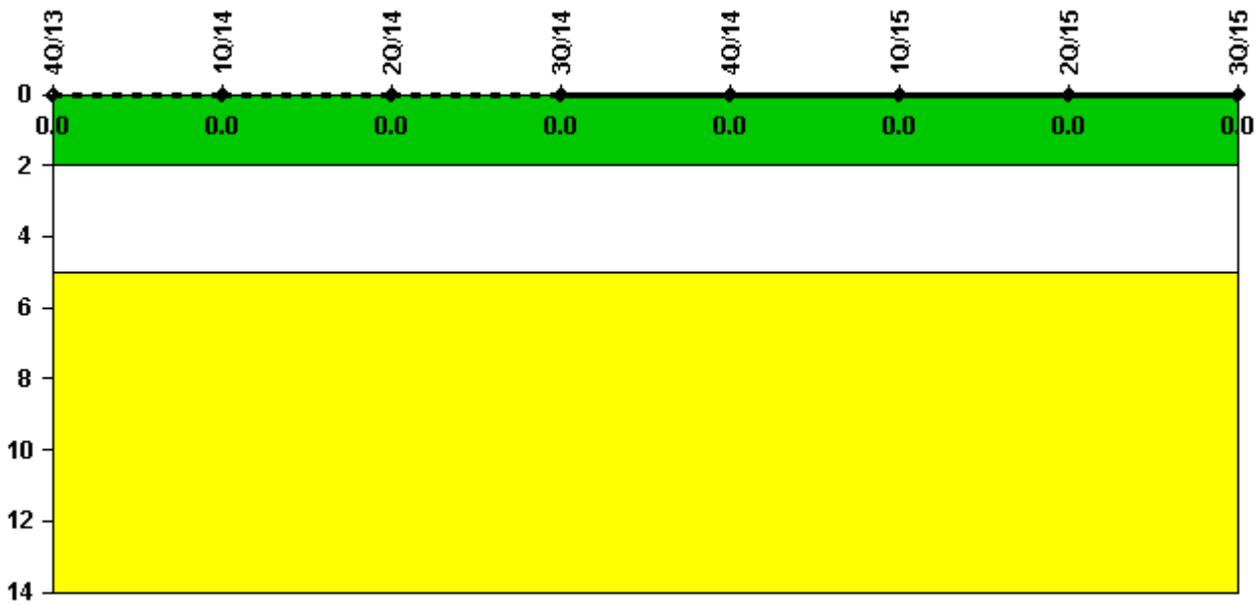


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>							

Licensee Comments: none

### RETS/ODCM Radiological Effluent

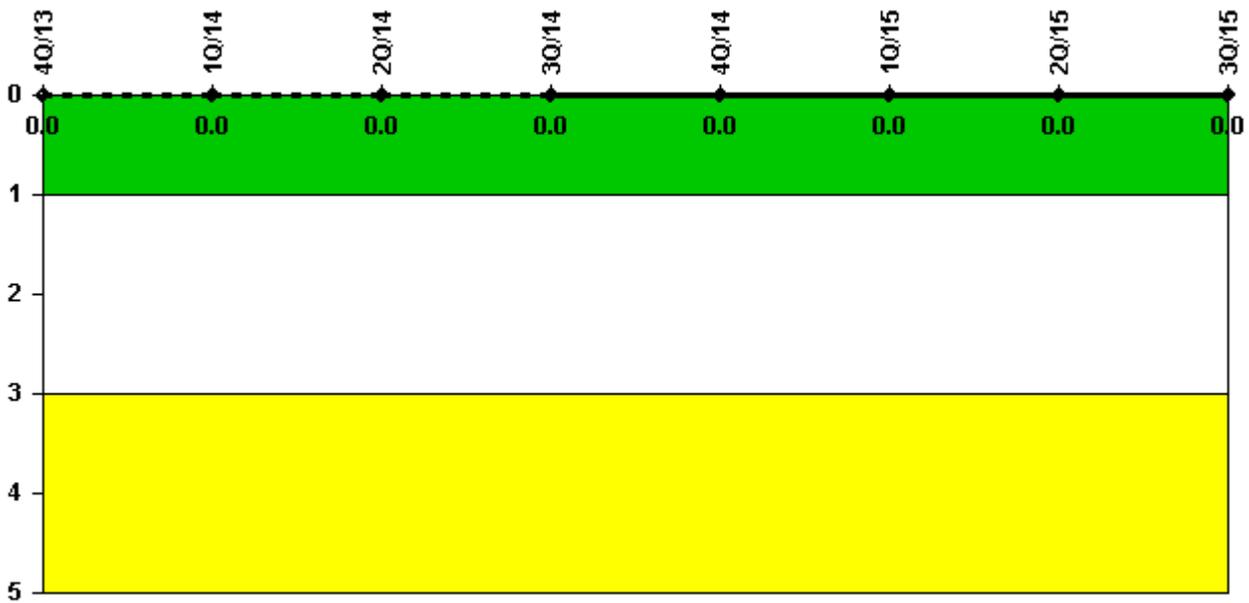

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	0	0	0	0

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: December 15, 2015*