


# La Salle 1

## 3Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

### Unplanned Scrams per 7000 Critical Hrs

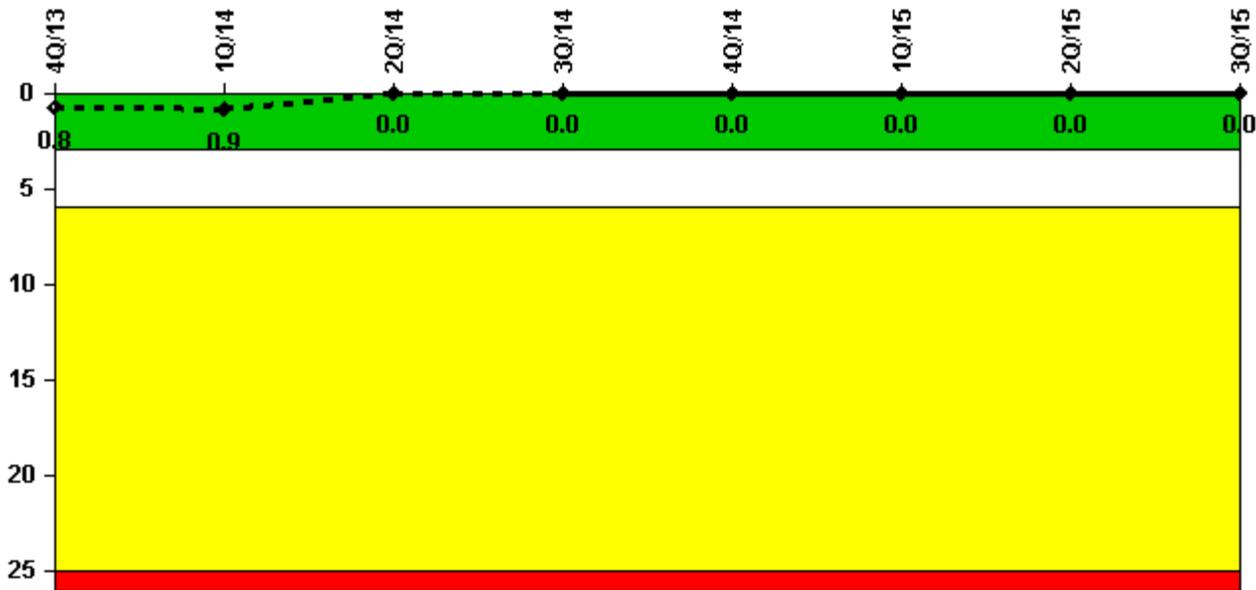

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0


### Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned scrams	0	0	0	0	0	0	0	0
Critical hours	2209.0	1754.0	2184.0	2208.0	2041.7	2159.0	2184.0	2208.0
<b>Indicator value</b>	<b>0.8</b>	<b>0.9</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>	<b>0</b>

Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Unplanned Power Changes per 7000 Critical Hrs

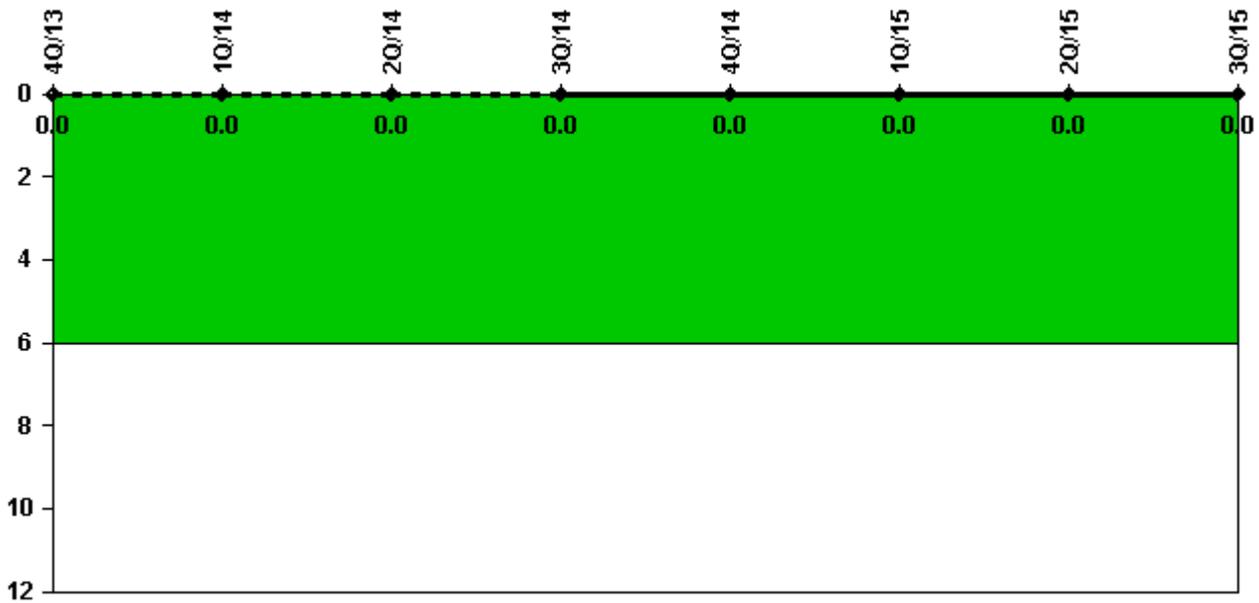

Thresholds: White > 6.0


#### Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	2209.0	1754.0	2184.0	2208.0	2041.7	2159.0	2184.0	2208.0
<b>Indicator value</b>	<b>0</b>							

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Unplanned Scrams with Complications

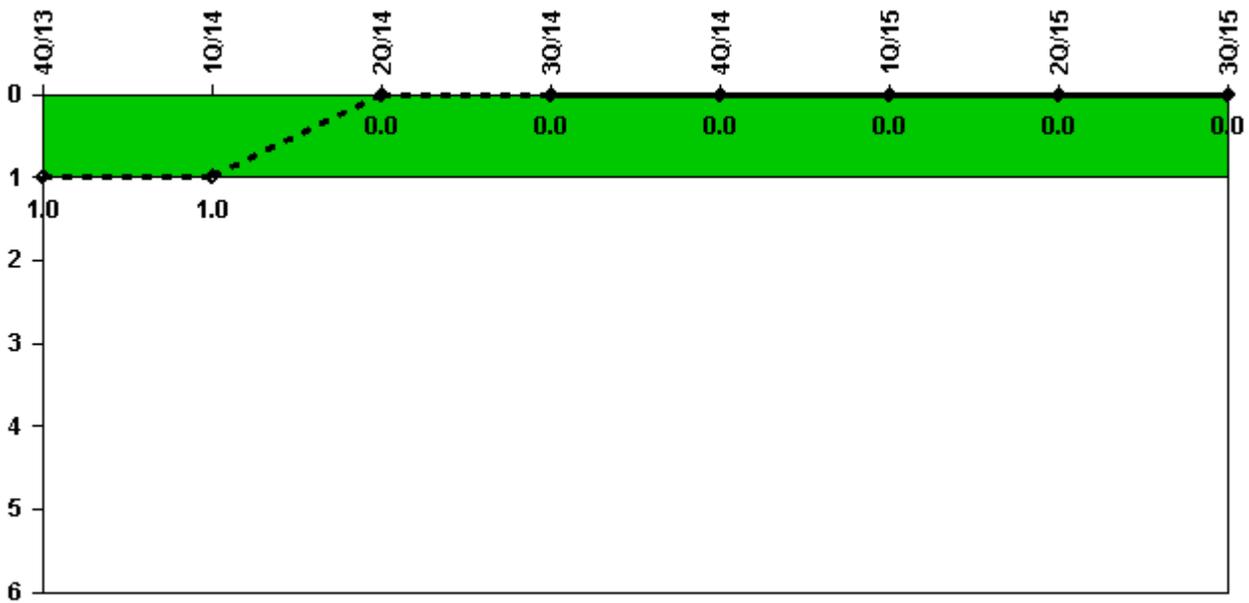


Thresholds: White > 1.0

#### Notes

Unplanned Scrams with Complications	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Scrams with complications	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>1.0</b>	<b>1.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>	<b>0.0</b>

Licensee Comments: none

### Safety System Functional Failures (BWR)

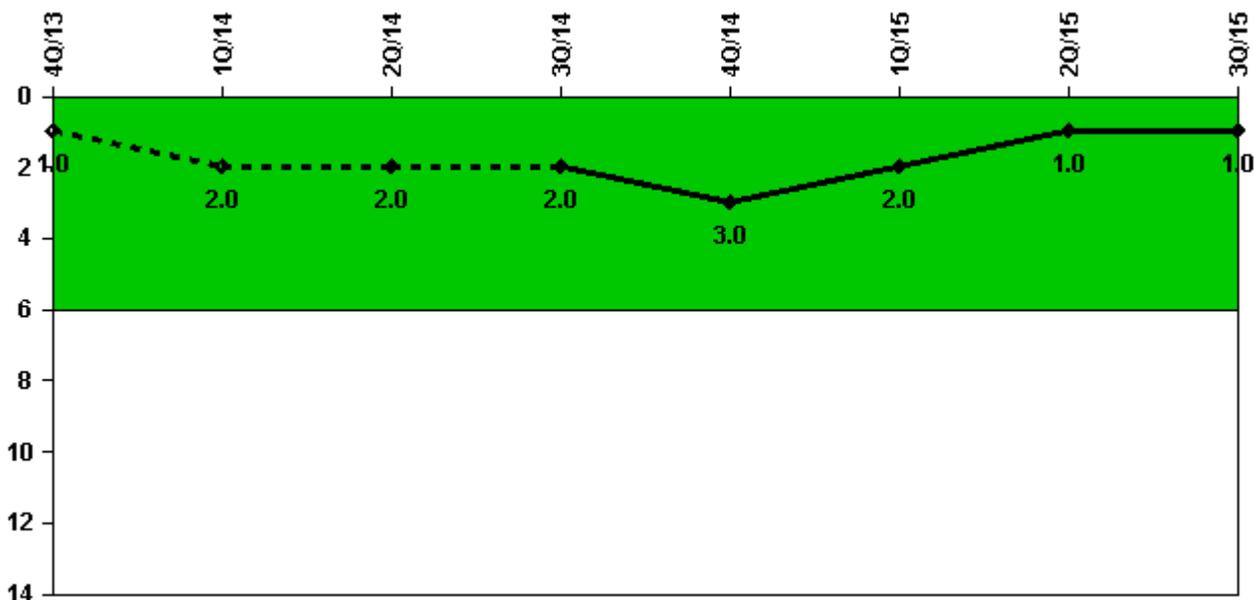

Thresholds: White > 6.0

#### Notes

Safety System Functional Failures (BWR)	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Safety System Functional Failures	0	1	1	0	1	0	0	0
<b>Indicator value</b>	<b>1</b>	<b>2</b>	<b>2</b>	<b>2</b>	<b>3</b>	<b>2</b>	<b>1</b>	<b>1</b>

Licensee Comments:

4Q/14: LER 373-2014-004


2Q/14: LER 373-2014-002-00.

1Q/14: LER 373-2013-008-00. Also, Unit 1 Safety System Functional Failures for April 2013 were changed from 1 to 0, as an engineering evaluation determined that the secondary containment inoperability did not result in a loss of safety function as defined by NEI 99-02. See LER 373-2013-001-02. Unit 1 Safety System Functional Failures for June 2013 were changed from 2 to 1, as further review determined that the April LOOP event was not reportable under 10 CFR 50.73(a)(2)(v)(D). See LER 373-2013-002-02. Unit 1 Safety System Functional Failures for December 2013 were changed from 1 to 0, as an engineering evaluation determined that the secondary containment inoperability did not result in a loss of safety function as defined by NEI 99-02. See LER 373-2013-007-01.

4Q/13: LER 373-2013-007-00

4Q/13: LER 373-2013-007

### Mitigating Systems Performance Index, Emergency AC Power System

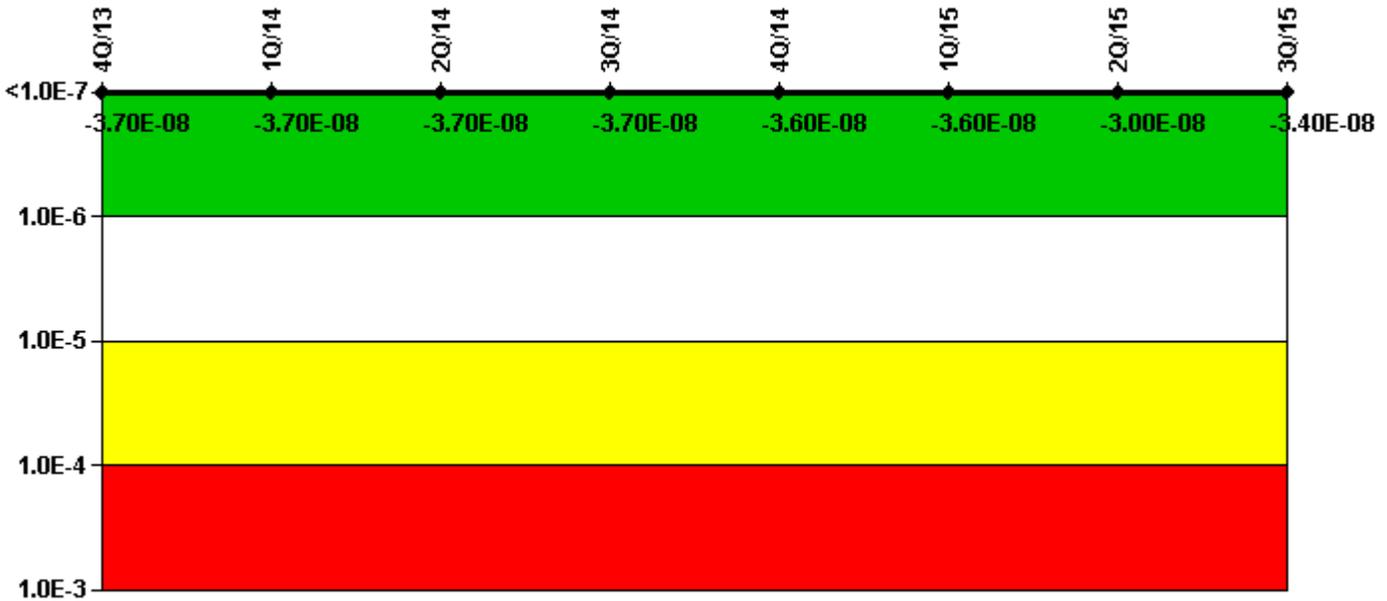


Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

#### Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-6.29E-09	-6.29E-09	-6.29E-09	-6.29E-09	-6.29E-09	-6.29E-09	-3.74E-10	-4.38E-09
URI ( $\Delta$ CDF)	-3.12E-08	-3.09E-08	-3.06E-08	-3.02E-08	-2.99E-08	-2.99E-08	-2.99E-08	-2.99E-08
PLE	NO							
Indicator value	-3.70E-08	-3.70E-08	-3.70E-08	-3.70E-08	-3.60E-08	-3.60E-08	-3.00E-08	-3.40E-08

Licensee Comments: none

### Mitigating Systems Performance Index, High Pressure Injection System

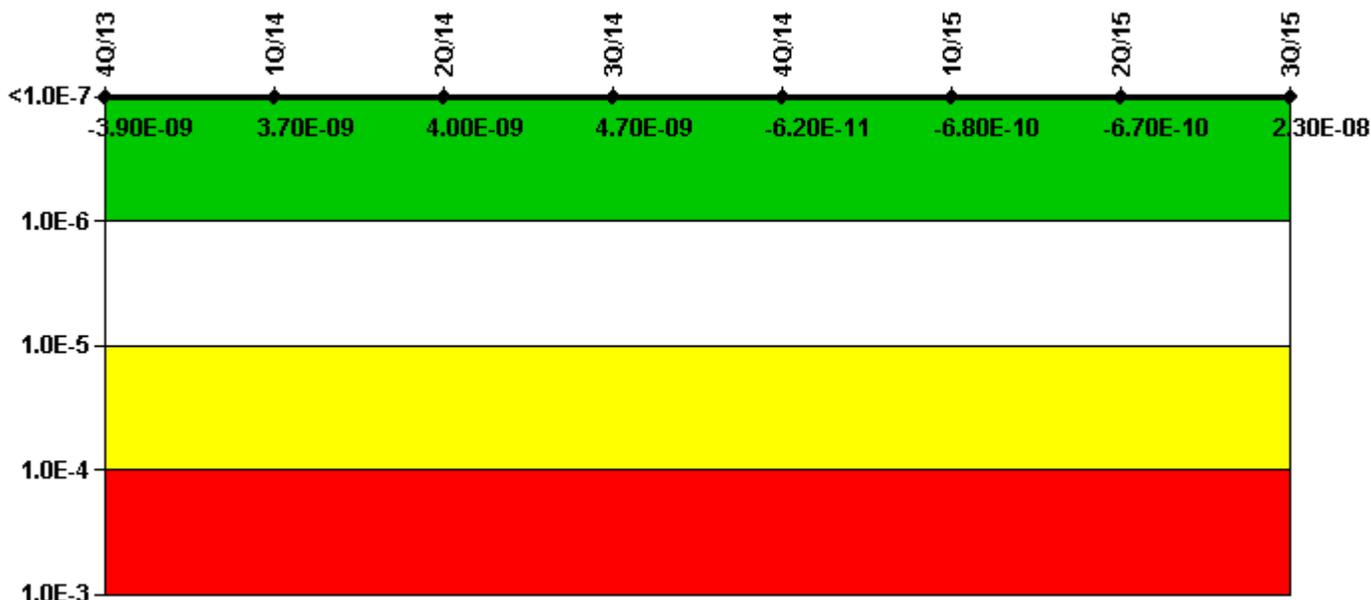

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, High Pressure Injection System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	1.01E-08	1.75E-08	1.75E-08	1.79E-08	1.29E-08	1.23E-08	1.23E-08	3.58E-08
URI ( $\Delta$ CDF)	-1.40E-08	-1.37E-08	-1.35E-08	-1.32E-08	-1.30E-08	-1.30E-08	-1.30E-08	-1.30E-08
PLE	NO							
Indicator value	-3.90E-09	3.70E-09	4.00E-09	4.70E-09	-6.20E-11	-6.80E-10	-6.70E-10	2.30E-08

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Mitigating Systems Performance Index, Heat Removal System

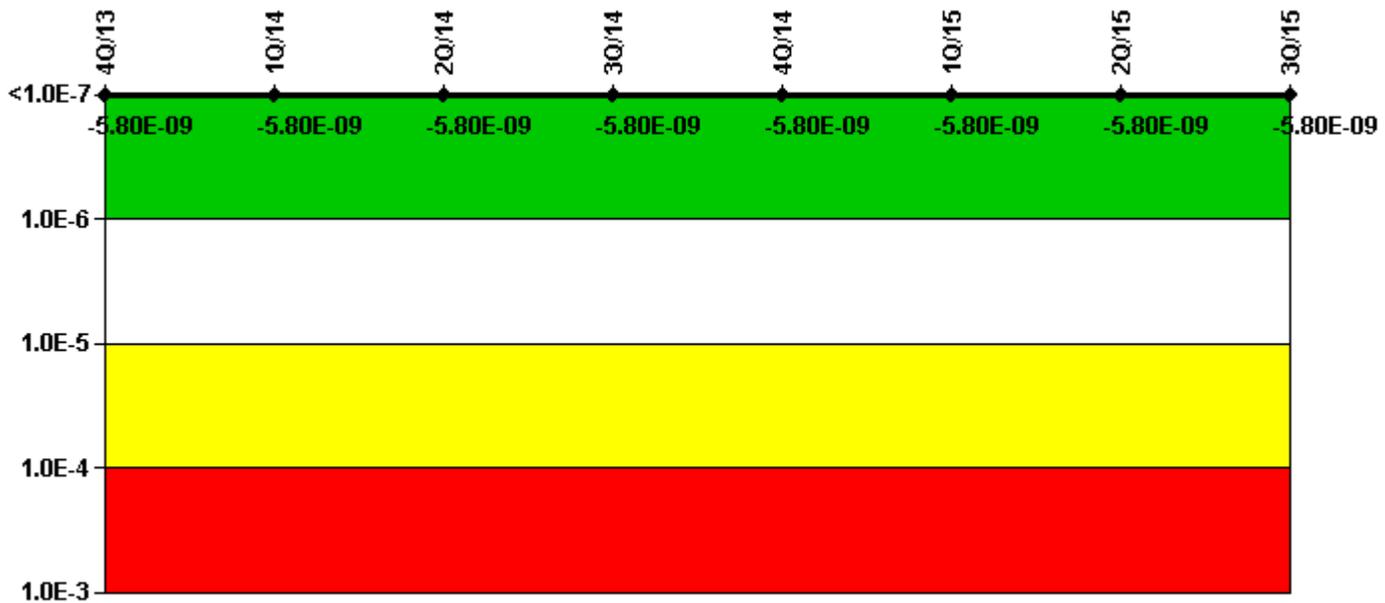

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-1.16E-09	-1.15E-09	-1.15E-09	-1.15E-09	-1.15E-09	-1.16E-09	-1.16E-09	-1.16E-09
URI ( $\Delta$ CDF)	-4.66E-09							
PLE	NO							
Indicator value	-5.80E-09							

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Mitigating Systems Performance Index, Residual Heat Removal System

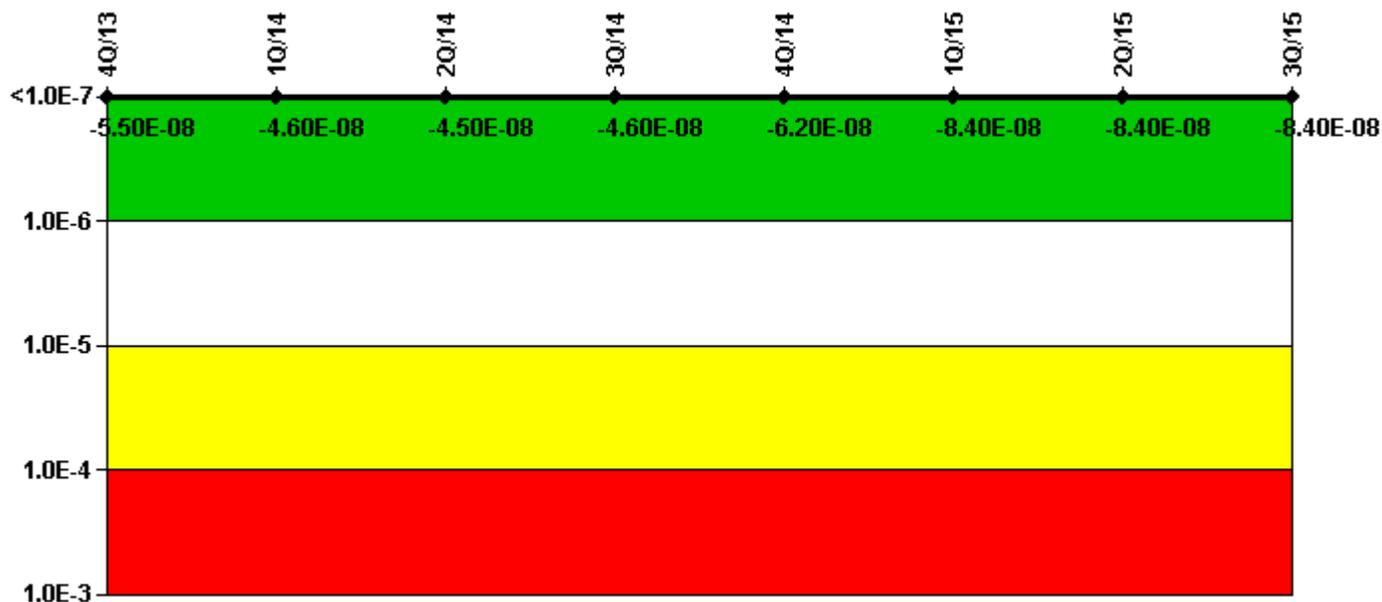

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Residual Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	-5.60E-09	3.52E-09	4.07E-09	3.40E-09	-1.31E-08	-3.50E-08	-3.50E-08	-3.50E-08
URI ( $\Delta$ CDF)	-4.94E-08							
PLE	NO							
Indicator value	-5.50E-08	-4.60E-08	-4.50E-08	-4.60E-08	-6.20E-08	-8.40E-08	-8.40E-08	-8.40E-08

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Mitigating Systems Performance Index, Cooling Water Systems

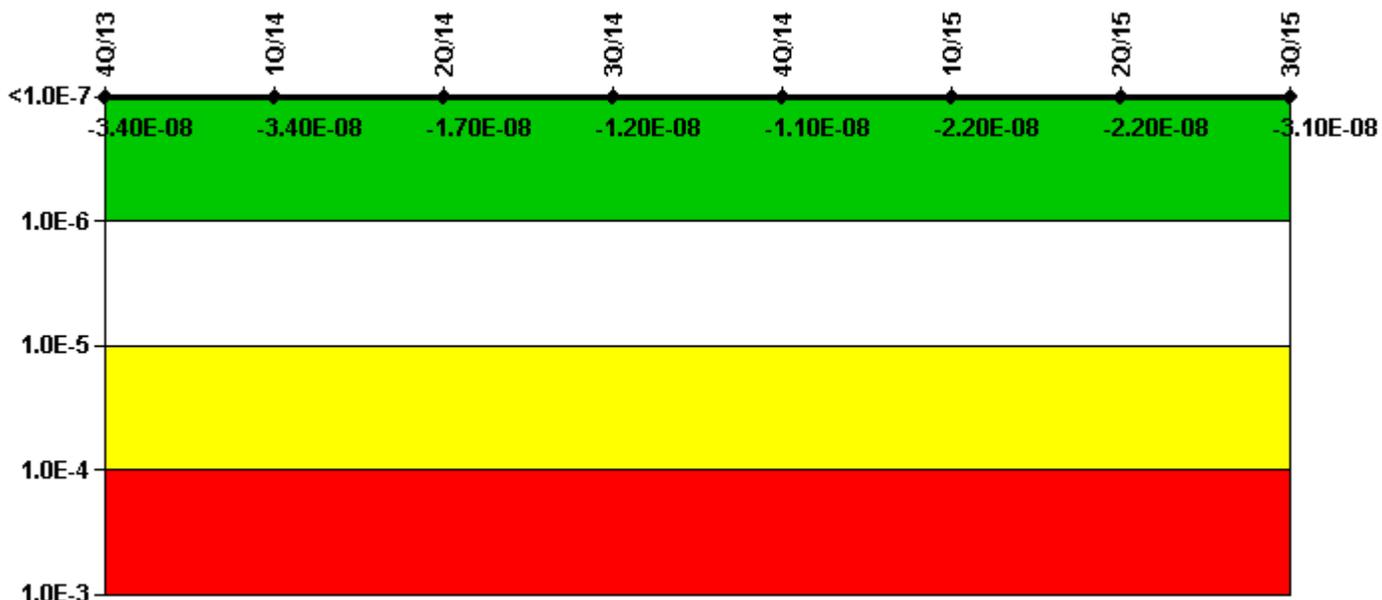

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4


#### Notes

Mitigating Systems Performance Index, Cooling Water Systems	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI ( $\Delta$ CDF)	2.89E-08	2.95E-08	4.62E-08	5.11E-08	5.23E-08	4.11E-08	4.11E-08	3.22E-08
URI ( $\Delta$ CDF)	-6.33E-08							
PLE	NO							
Indicator value	-3.40E-08	-3.40E-08	-1.70E-08	-1.20E-08	-1.10E-08	-2.20E-08	-2.20E-08	-3.10E-08

#### Licensee Comments:

1Q/14: An internal review identified a data entry error in 2nd Qtr 2013 critical hours for both Units. On Unit 1, the critical hours for April 2013 were increased from 432.5 to 490.2 hours. This changed the critical hours input into the Unplanned Scrams and Unplanned Power Changes per 7,000 Critical Hours indicators, and the MSPI indicators, as shown in the 1st Qtr 2014 Change File. Correction of the error did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### Reactor Coolant System Activity

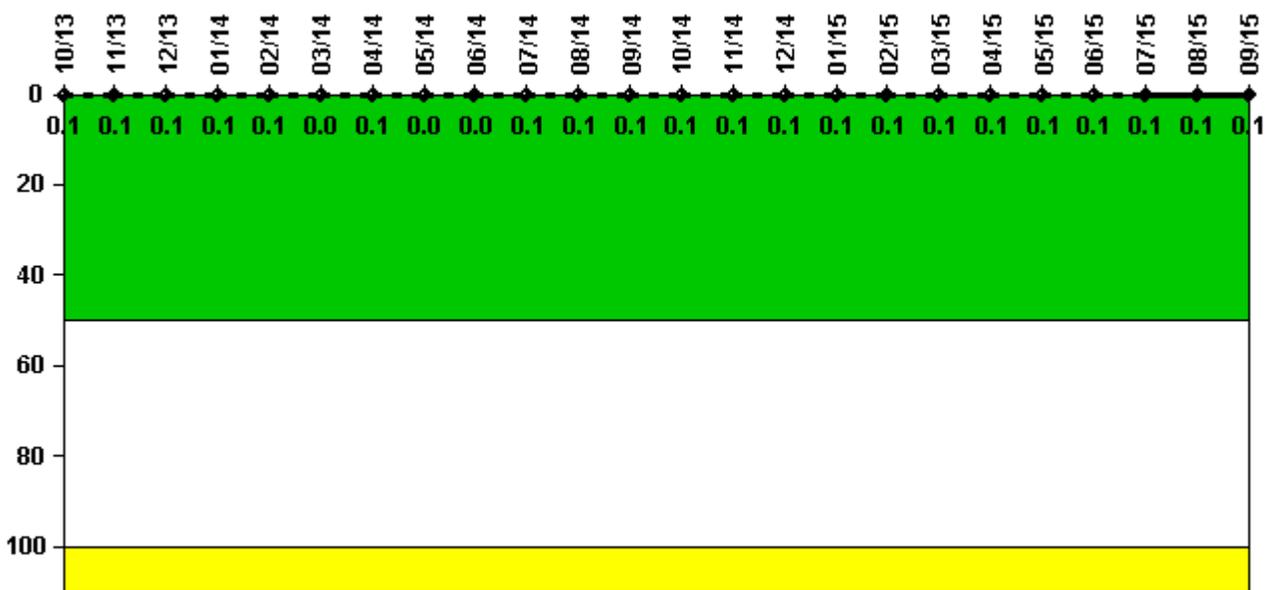

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Activity	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum activity	0.000170	0.000167	0.000212	0.000151	0.000132	0.000059	0.000122	0.000078	0.000093	0.000161	0.000132	0.000123
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0	0.1	0	0	0.1	0.1	0.1

Reactor Coolant System Activity	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum activity	0.000130	0.000128	0.000108	0.000105	0.000122	0.000118	0.000142	0.000145	0.000190	0.000152	0.000187	0.000160
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1	0.1

Licensee Comments: none

### Reactor Coolant System Leakage

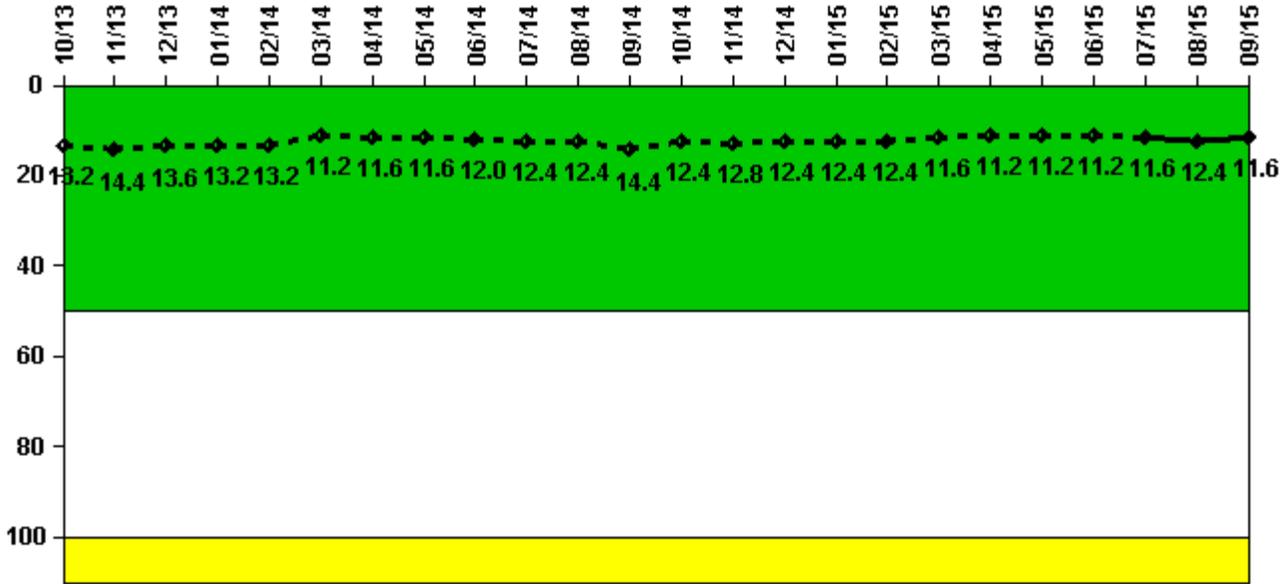

Thresholds: White > 50.0 Yellow > 100.0

#### Notes


Reactor Coolant System Leakage	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum leakage	3.300	3.600	3.400	3.300	3.300	2.800	2.900	2.900	3.000	3.100	3.100	3.600
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	13.2	14.4	13.6	13.2	13.2	11.2	11.6	11.6	12.0	12.4	12.4	14.4

Reactor Coolant System Leakage	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum leakage	3.100	3.200	3.100	3.100	3.100	2.900	2.800	2.800	2.800	2.900	3.100	2.900
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	12.4	12.8	12.4	12.4	12.4	11.6	11.2	11.2	11.2	11.6	12.4	11.6

Licensee Comments: none

### Drill/Exercise Performance

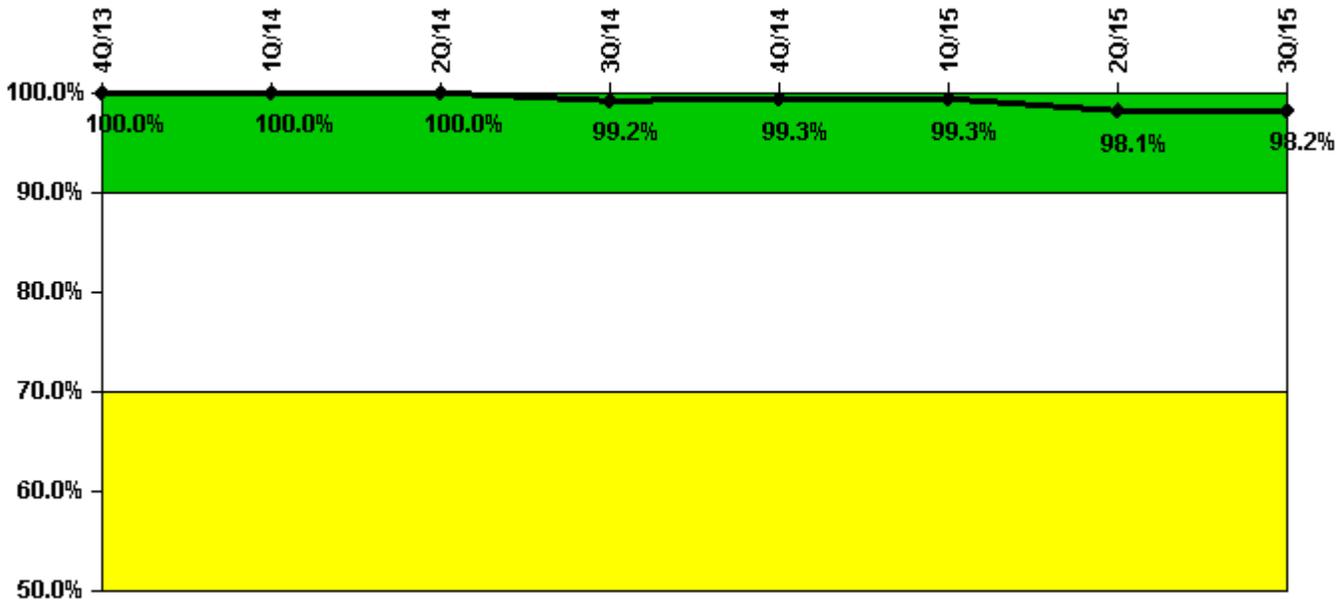

Thresholds: White < 90.0% Yellow < 70.0%


#### Notes

Drill/Exercise Performance	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful opportunities	34.0	17.0	36.0	48.0	42.0	46.0	105.0	62.0
Total opportunities	34.0	17.0	36.0	50.0	42.0	46.0	110.0	62.0
Indicator value	100.0%	100.0%	100.0%	99.2%	99.3%	99.3%	98.1%	98.2%

#### Licensee Comments:

2Q/14: An internal review identified additional drill/exercise performance opportunities that should have been counted in the 4th quarter 2013. For October 2013 the number of both the total and successful opportunities was increased from 12 to 16. This correction did not result in a color change for any indicator. The occurrence has been entered into the corrective action program.

### ERO Drill Participation

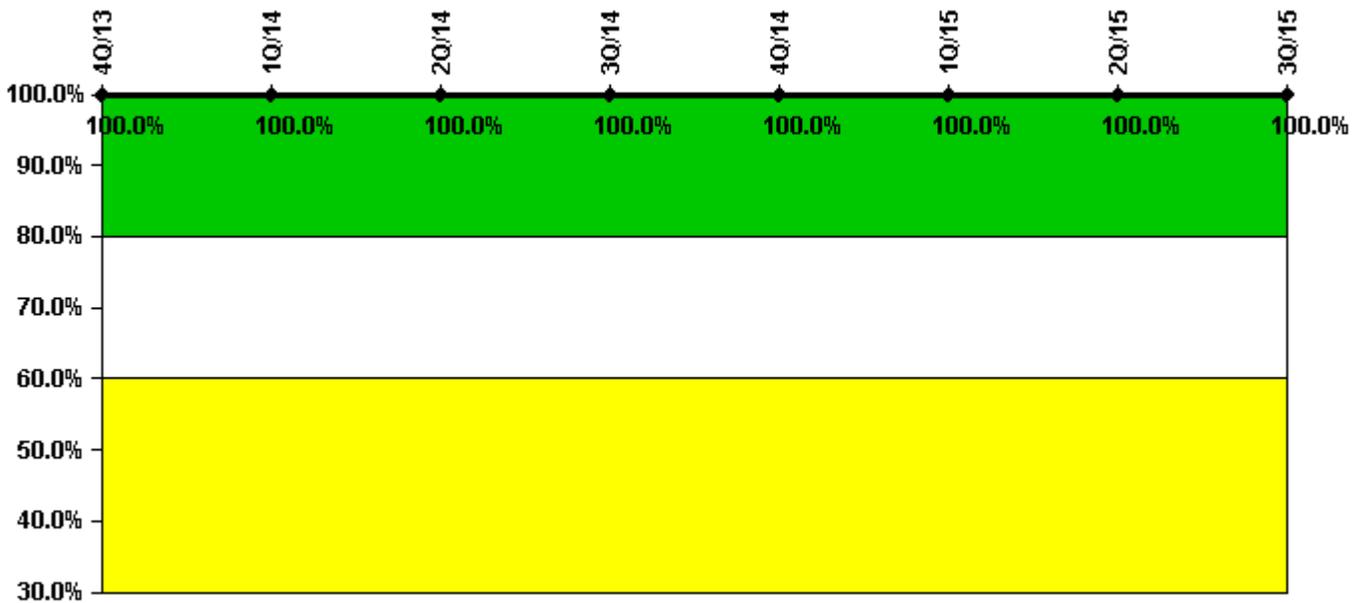

Thresholds: White < 80.0% Yellow < 60.0%


#### Notes

ERO Drill Participation	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Participating Key personnel	67.0	65.0	62.0	65.0	69.0	69.0	68.0	68.0
Total Key personnel	67.0	65.0	62.0	65.0	69.0	69.0	68.0	68.0
Indicator value	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%	100.0%

#### Licensee Comments:

1Q/15: During an internal assessment, it was discovered that one individual was inadvertently counted as a participating ERO member from May to December 2014. This was corrected by decreasing the number of total and participating key personnel by one for the months in question. This issue, which did not result in a change to performance indicator color, has been entered into the corrective action program.

### Alert & Notification System

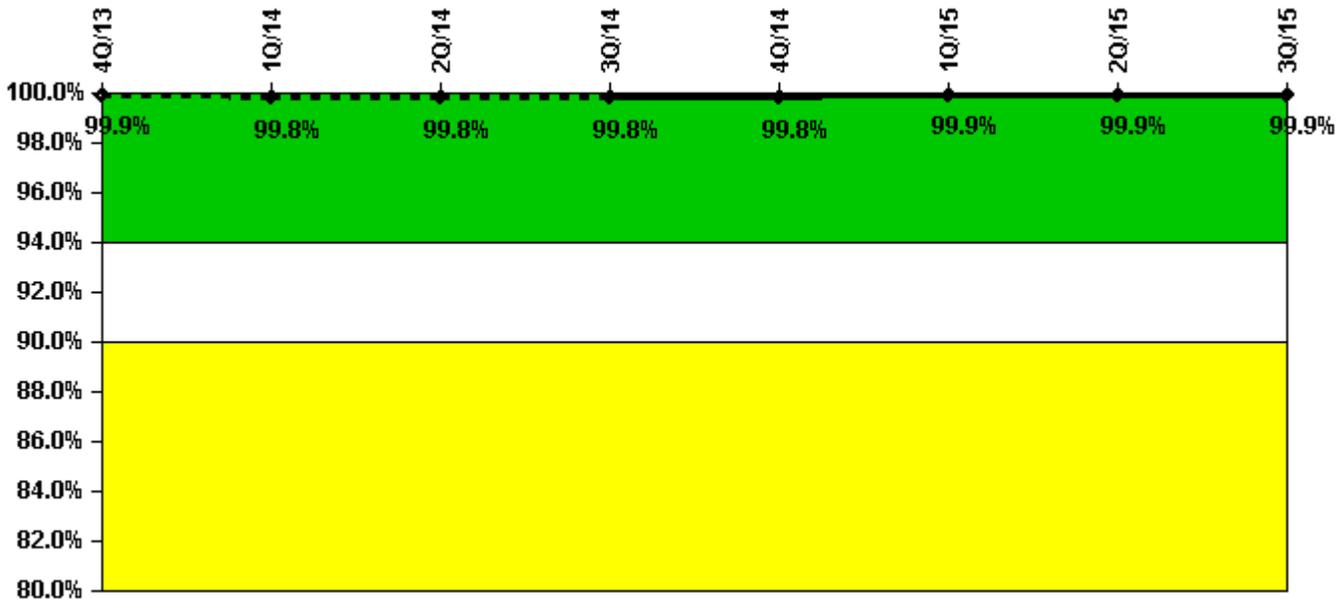


Thresholds: White < 94.0% Yellow < 90.0%

#### Notes

Alert & Notification System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful siren-tests	2175	2131	2171	2174	2175	2138	2173	2208
Total sirens-tests	2176	2142	2176	2176	2176	2142	2176	2210
Indicator value	99.9%	99.8%	99.8%	99.8%	99.8%	99.9%	99.9%	99.9%

Licensee Comments: none

### Occupational Exposure Control Effectiveness

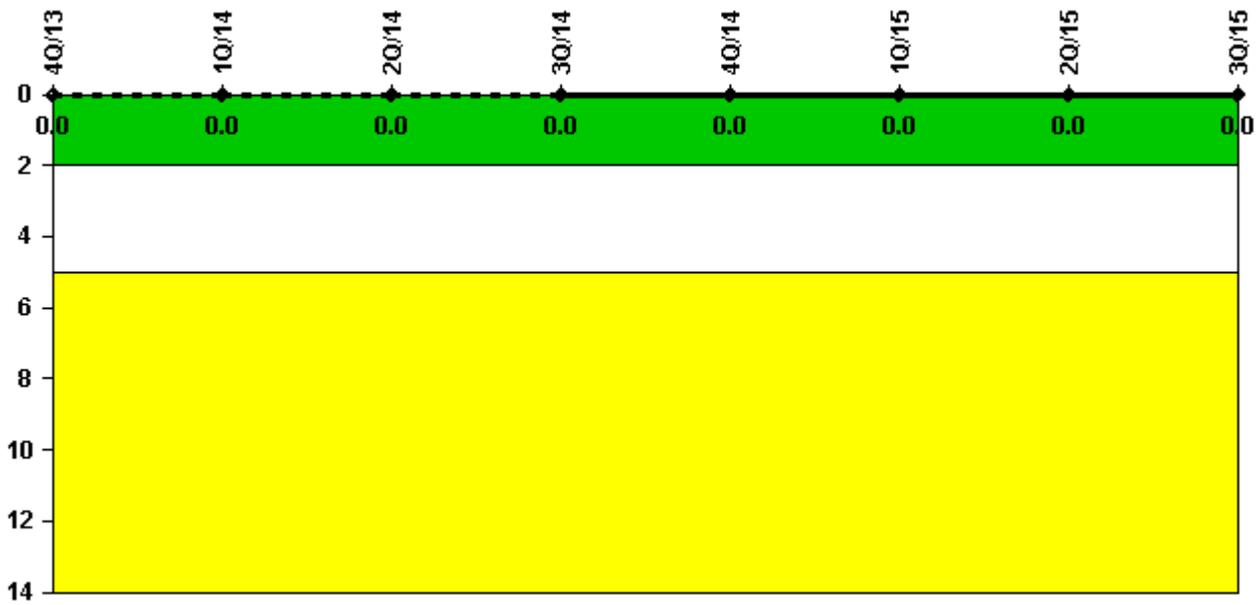


Thresholds: White > 2.0 Yellow > 5.0

#### Notes

Occupational Exposure Control Effectiveness	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>							

Licensee Comments: none

### RETS/ODCM Radiological Effluent

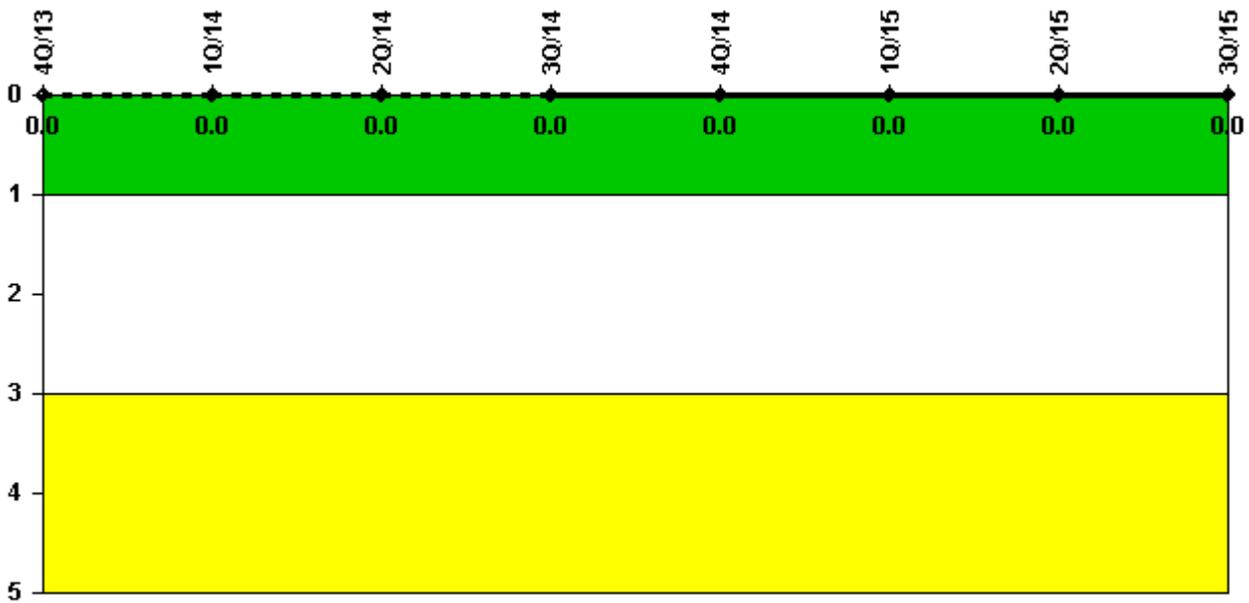

Thresholds: White > 1.0 Yellow > 3.0

#### Notes

RETS/ODCM Radiological Effluent	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
<b>Indicator value</b>	<b>0</b>							

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

*Last Modified: December 15, 2015*