


Salem 2

3Q/2015 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

Unplanned Scrams per 7000 Critical Hrs

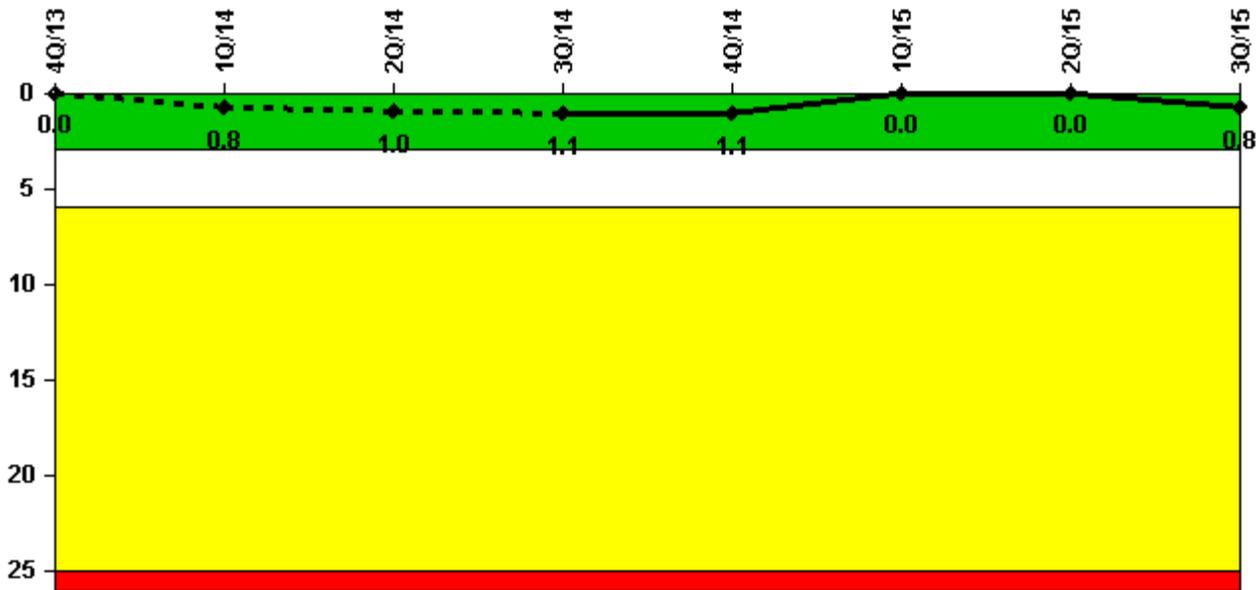


Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned scrams	0	1.0	0	0	0	0	0	1.0
Critical hours	2209.0	2121.9	284.0	1913.8	2209.0	2159.0	2184.0	2136.3
Indicator value	0	0.8	1.0	1.1	1.1	0	0	0.8

Licensee Comments: none

Unplanned Power Changes per 7000 Critical Hrs

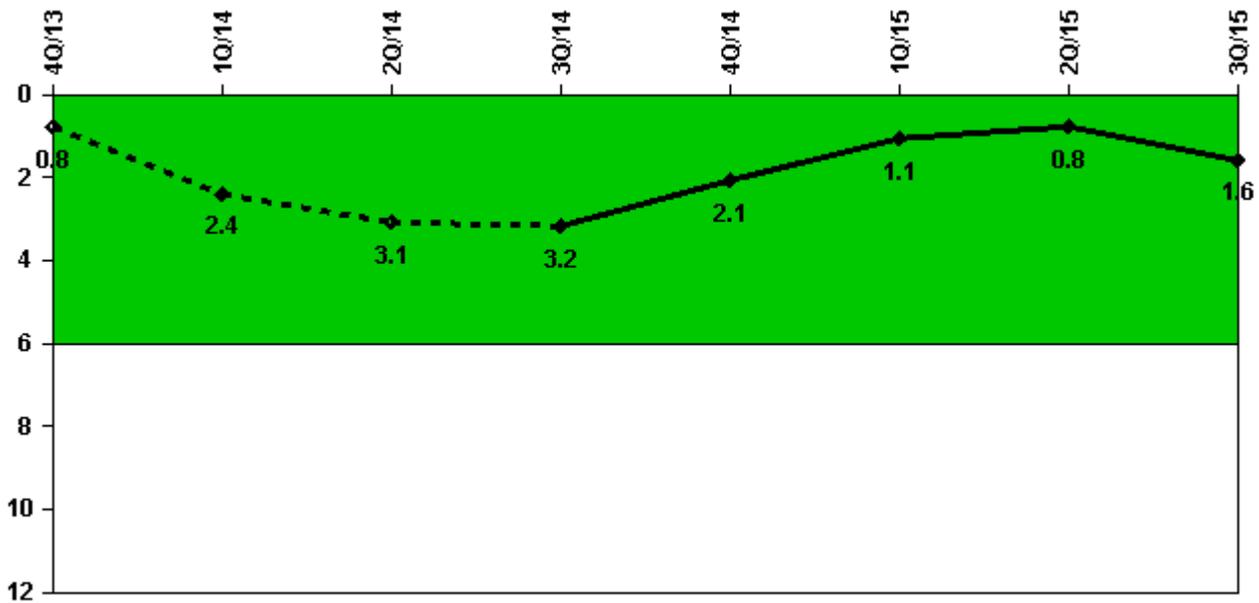

Thresholds: White > 6.0


Notes

Unplanned Power Changes per 7000 Critical Hrs	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Unplanned power changes	1.0	2.0	0	0	0	1.0	0	1.0
Critical hours	2209.0	2121.9	284.0	1913.8	2209.0	2159.0	2184.0	2136.3
Indicator value	0.8	2.4	3.1	3.2	2.1	1.1	0.8	1.6

Licensee Comments:

1Q/14: NRC granted a NOED during the quarter (Feb 2014), which if not granted, may have resulted in an unplanned power change.

Unplanned Scrams with Complications

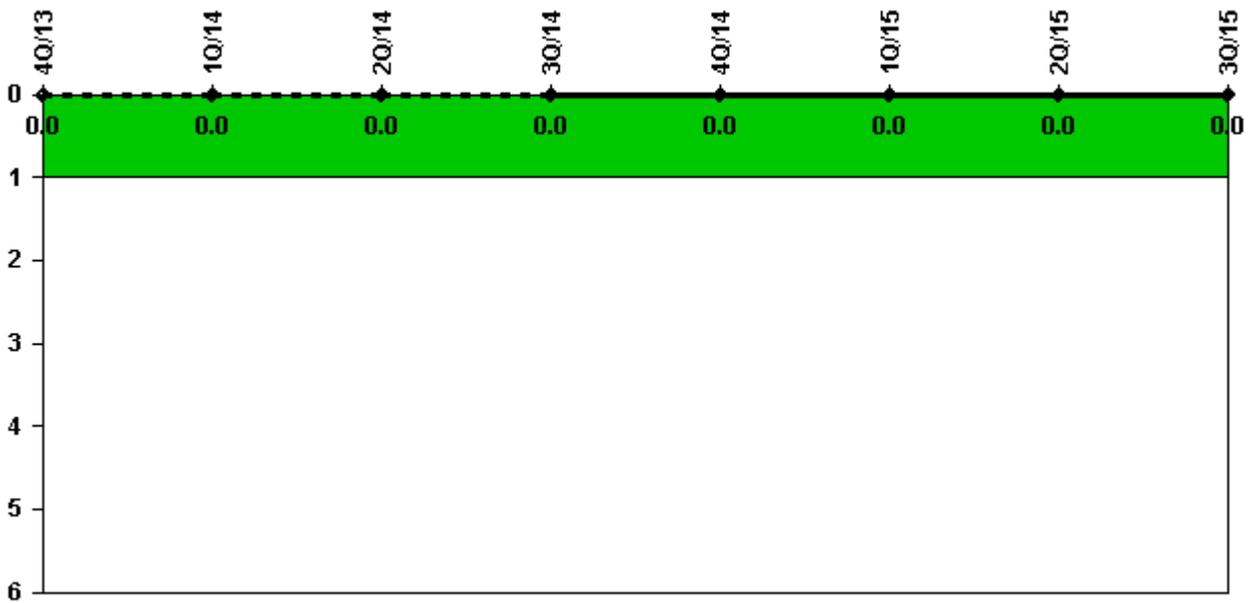


Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	0.0							

Licensee Comments: none

Safety System Functional Failures (PWR)

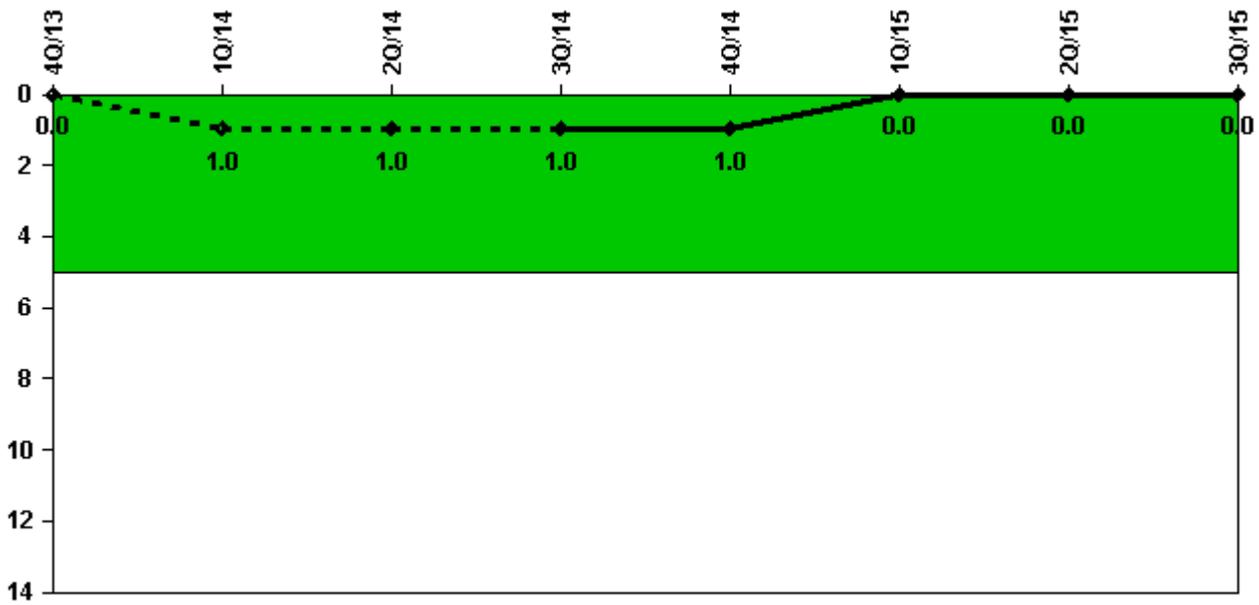

Thresholds: White > 5.0


Notes

Safety System Functional Failures (PWR)	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Safety System Functional Failures	0	1	0	0	0	0	0	0
Indicator value	0	1	1	1	1	0	0	0

Licensee Comments:

1Q/14: LER 272/2014-001-00.

Mitigating Systems Performance Index, Emergency AC Power System

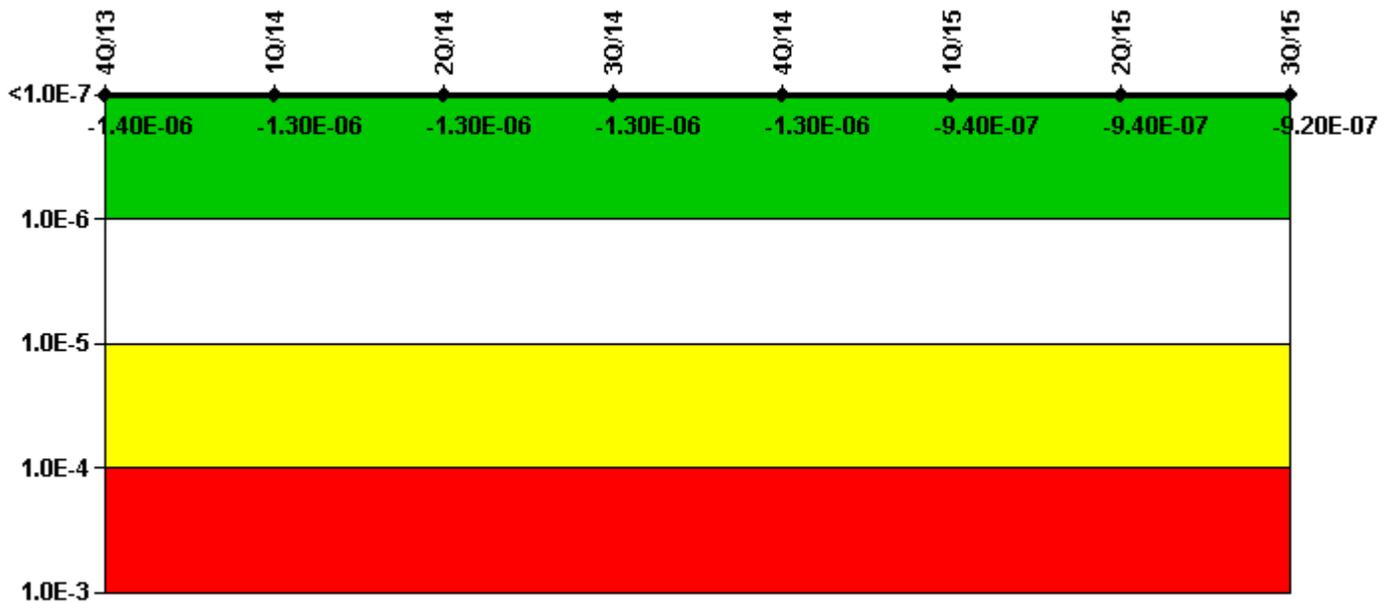

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI (Δ CDF)	-1.62E-07	-1.62E-07	-1.62E-07	-1.62E-07	-1.62E-07	-1.66E-07	-1.66E-07	-1.50E-07
URI (Δ CDF)	-1.23E-06	-1.12E-06	-1.17E-06	-1.15E-06	-1.13E-06	-7.74E-07	-7.73E-07	-7.74E-07
PLE	NO							
Indicator value	-1.40E-06	-1.30E-06	-1.30E-06	-1.30E-06	-1.30E-06	-9.40E-07	-9.40E-07	-9.20E-07

Licensee Comments:

2Q/15: 4Q12 through 4Q14 data was revised due to an error in the demand and run time calculations. This PI remained green during all time periods following the changes.

1Q/15: Changed PRA Parameter(s). Revised MSPI basis data due to incorrect accounting of post maintenance testing


4Q/14: Changed PRA Parameter(s).

1Q/14: Hours counted due to 2B EDG K1C discovered condition. Hours were originally under "Unplanned". Review of NEI 99-02 considers this "Planned": "electively removed from service to correct a degraded condition that had not resulted in loss of function.

1Q/14: Hours counted due to 2B EDG K1C discovered condition. Hours were originally under "Unplanned". Review of NEI 99-02 considers this "Planned": "electively removed from service to correct a degraded condition

that had not resulted in loss of function.

Mitigating Systems Performance Index, High Pressure Injection System

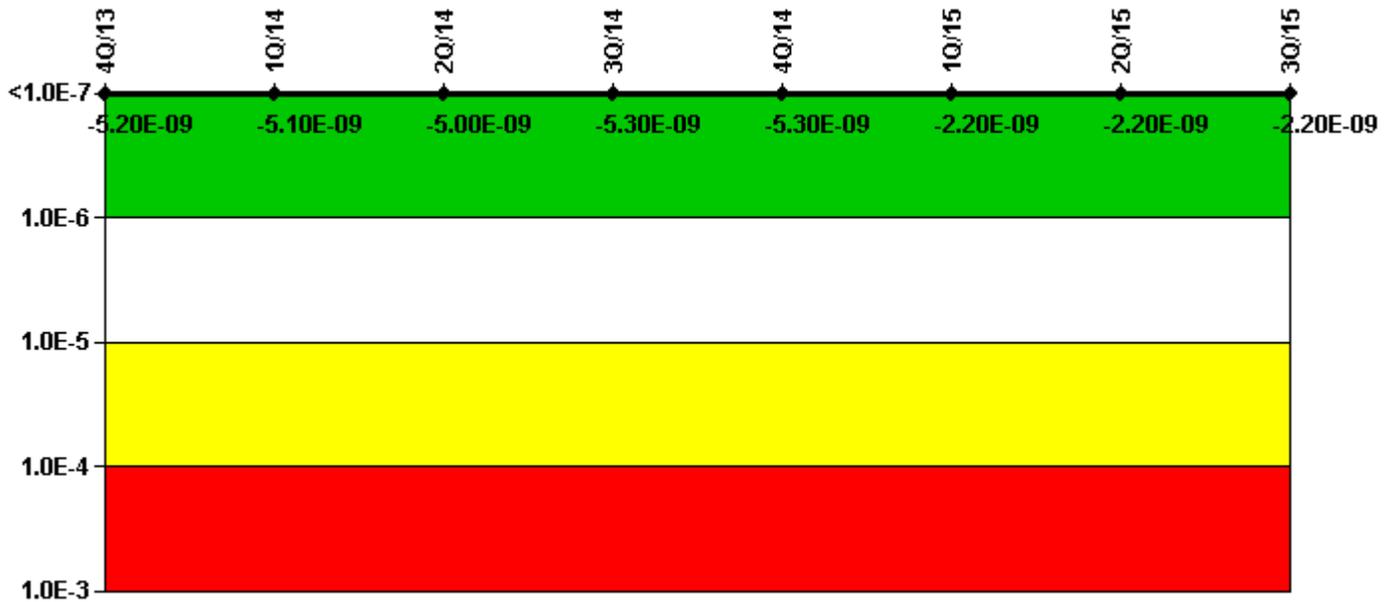

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, High Pressure Injection System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI (Δ CDF)	-5.77E-10	-4.93E-10	-4.67E-10	-7.22E-10	-7.22E-10	-5.15E-10	-5.15E-10	-5.14E-10
URI (Δ CDF)	-4.59E-09	-4.59E-09	-4.57E-09	-4.56E-09	-4.55E-09	-1.70E-09	-1.70E-09	-1.70E-09
PLE	NO							
Indicator value	-5.20E-09	-5.10E-09	-5.00E-09	-5.30E-09	-5.30E-09	-2.20E-09	-2.20E-09	-2.20E-09

Licensee Comments:

2Q/15: 1Q13 through 4Q14 data was revised due to an error in the demand and run time calculations. This PI remained green during all time periods following the changes.

4Q/14: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Heat Removal System

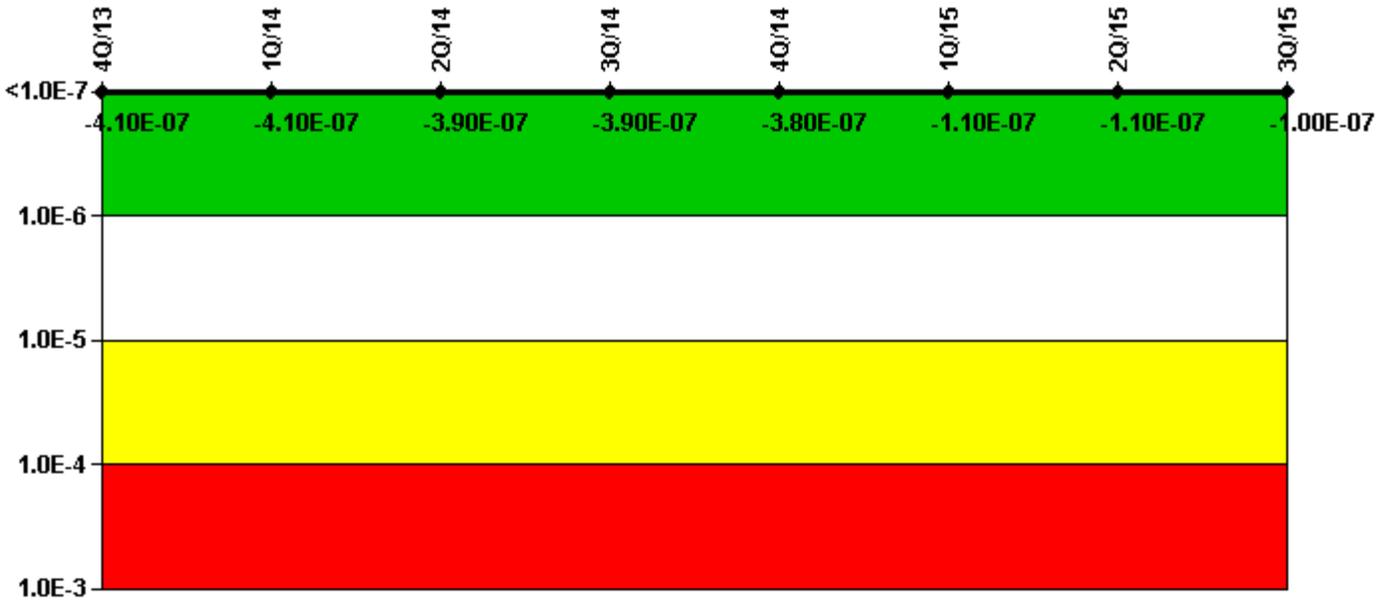

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI (Δ CDF)	-6.21E-08	-6.21E-08	-6.21E-08	-6.21E-08	-6.21E-08	-1.72E-08	-1.69E-08	-1.69E-08
URI (Δ CDF)	-3.51E-07	-3.44E-07	-3.31E-07	-3.27E-07	-3.18E-07	-9.03E-08	-8.88E-08	-8.73E-08
PLE	NO							
Indicator value	-4.10E-07	-4.10E-07	-3.90E-07	-3.90E-07	-3.80E-07	-1.10E-07	-1.10E-07	-1.00E-07

Licensee Comments:

2Q/15: 2Q12 through 4Q14 data was revised due to an error in the demand and run time calculations. This PI remained green during all time periods following the changes.

4Q/14: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Residual Heat Removal System

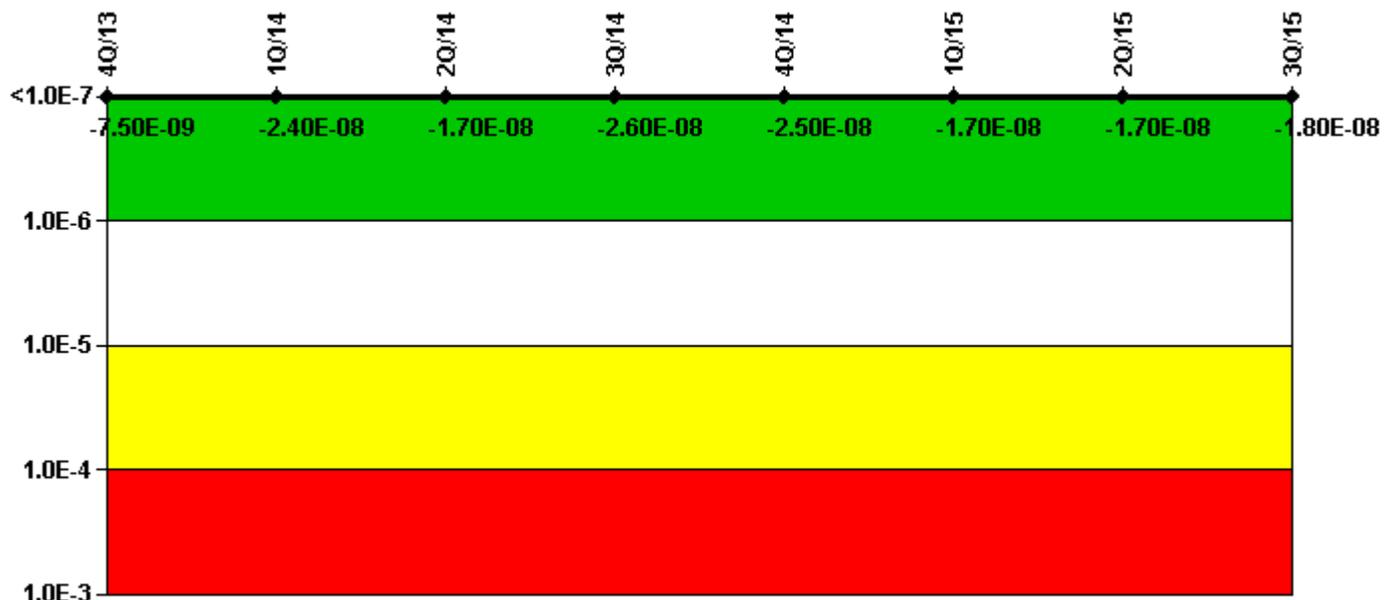

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Residual Heat Removal System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI (Δ CDF)	4.97E-08	3.31E-08	3.86E-08	3.10E-08	3.24E-08	1.56E-09	1.56E-09	1.38E-11
URI (Δ CDF)	-5.72E-08	-5.72E-08	-5.53E-08	-5.69E-08	-5.74E-08	-1.81E-08	-1.81E-08	-1.79E-08
PLE	NO							
Indicator value	-7.50E-09	-2.40E-08	-1.70E-08	-2.60E-08	-2.50E-08	-1.70E-08	-1.70E-08	-1.80E-08

Licensee Comments:

2Q/15: 1Q13 through 4Q14 data was revised due to an error in the demand and run time calculations. This PI remained green during all time periods following the changes.

4Q/14: Changed PRA Parameter(s).

Mitigating Systems Performance Index, Cooling Water Systems

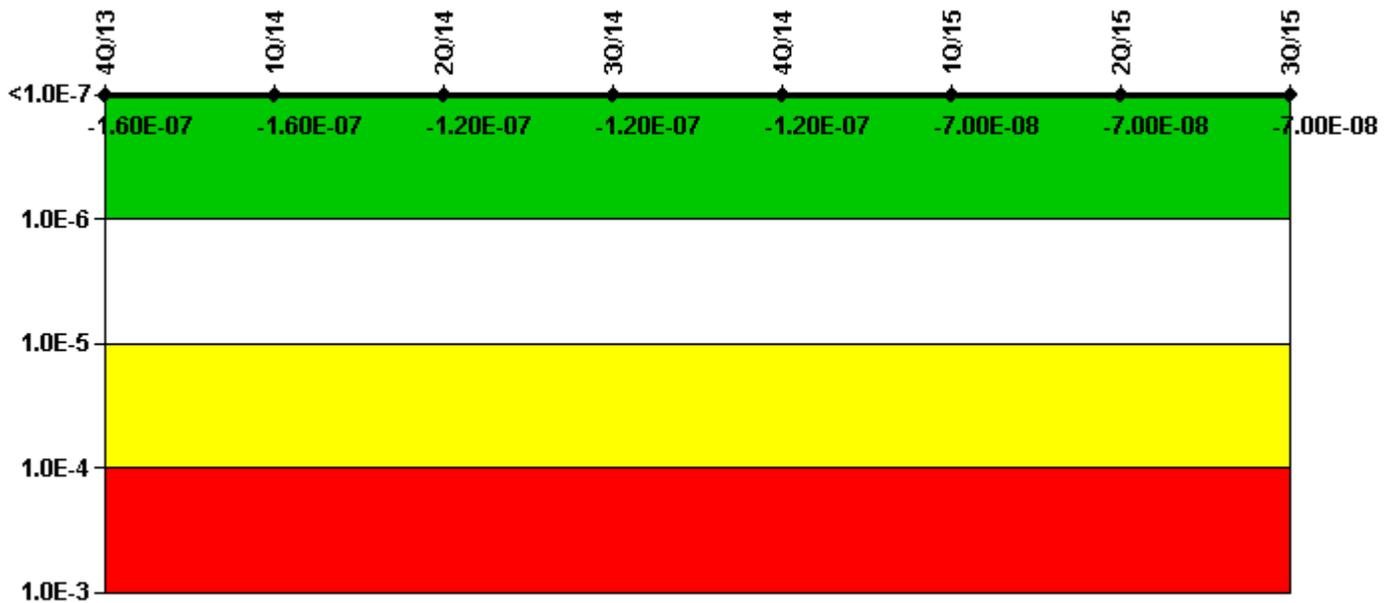

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes


Mitigating Systems Performance Index, Cooling Water Systems	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
UAI (Δ CDF)	-1.45E-07	-1.45E-07	-1.45E-07	-1.45E-07	-1.45E-07	-6.87E-08	-6.87E-08	-6.87E-08
URI (Δ CDF)	-1.73E-08	-1.73E-08	2.27E-08	2.27E-08	2.27E-08	-1.19E-09	-1.19E-09	-1.19E-09
PLE	NO							
Indicator value	-1.60E-07	-1.60E-07	-1.20E-07	-1.20E-07	-1.20E-07	-7.00E-08	-7.00E-08	-7.00E-08

Licensee Comments:

4Q/14: Changed PRA Parameter(s).

2Q/14: 21SW127 failed to automatically respond to any signal (cascade, manual, auto). This condition was not identified during or prior to post-maintenance testing (PMT) and was therefore unable to be corrected prior to being returned to operable status.

Reactor Coolant System Activity

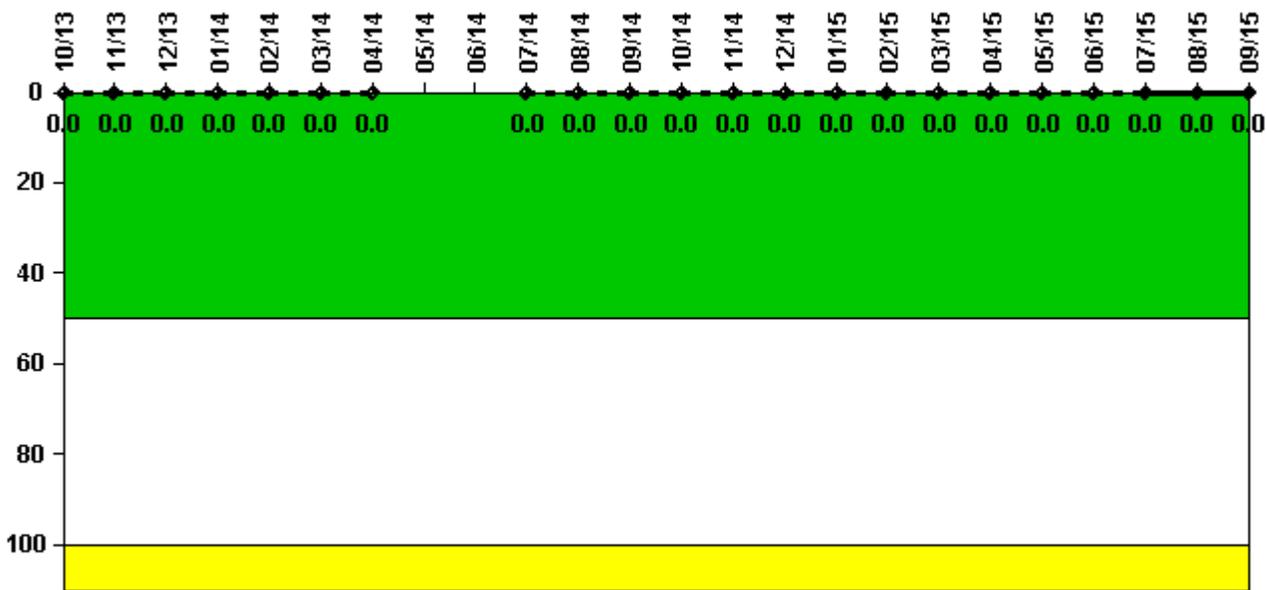

Thresholds: White > 50.0 Yellow > 100.0

Notes


Reactor Coolant System Activity	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum activity	0.000198	0.000239	0.000117	0.000211	0.000123	0.000373	0.000269	N/A	N/A	0.000065	0.000065	0.000065
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	N/A	N/A	0	0	0

Reactor Coolant System Activity	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum activity	0.000071	0.000099	0.000075	0.000129	0.000186	0.000133	0.000155	0.000141	0.000094	0.000092	0.000283	0.000174
Technical specification limit	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0	1.0
Indicator value	0	0	0	0	0	0	0	0	0	0	0	0

Licensee Comments:

6/14: The Unit was in an extended outage due to RCP Pump Vane bolt failures.

Reactor Coolant System Leakage

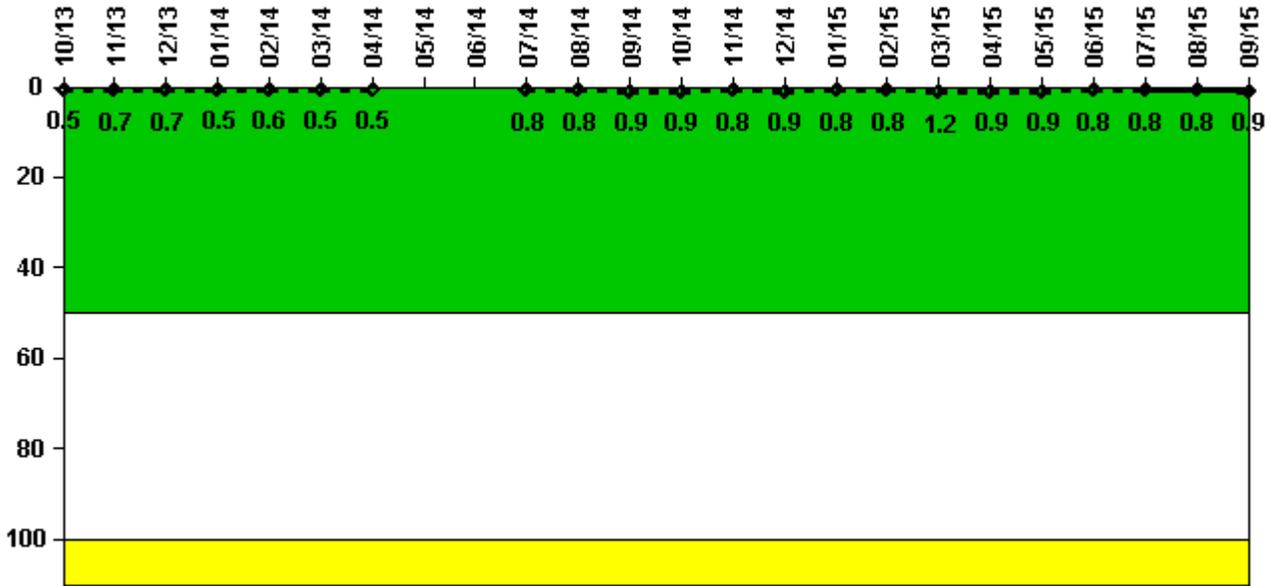

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	10/13	11/13	12/13	1/14	2/14	3/14	4/14	5/14	6/14	7/14	8/14	9/14
Maximum leakage	0.053	0.065	0.073	0.048	0.056	0.051	0.053	N/A	N/A	0.080	0.081	0.085
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.5	0.7	0.7	0.5	0.6	0.5	0.5	N/A	N/A	0.8	0.8	0.9


Reactor Coolant System Leakage	10/14	11/14	12/14	1/15	2/15	3/15	4/15	5/15	6/15	7/15	8/15	9/15
Maximum leakage	0.085	0.084	0.085	0.084	0.084	0.122	0.087	0.088	0.083	0.084	0.082	0.085
Technical specification limit	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0	10.0
Indicator value	0.9	0.8	0.9	0.8	0.8	1.2	0.9	0.9	0.8	0.8	0.8	0.9

Licensee Comments:

3/15: One data point for the month was at the value .1224. Remainder were values around the previously identified leakrate values.

6/14: The Unit was in an extended outage due to RCP Pump Vane bolt failures.

Drill/Exercise Performance

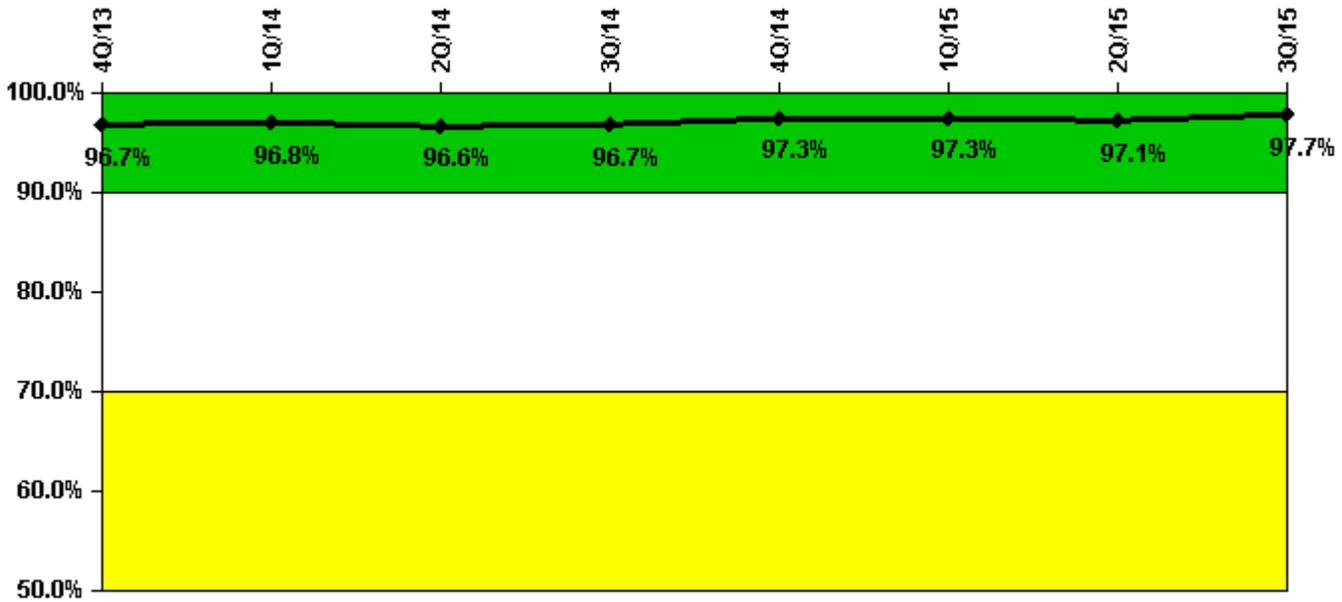


Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful opportunities	29.0	41.0	34.0	58.0	27.0	34.0	29.0	41.0
Total opportunities	30.0	42.0	35.0	59.0	27.0	36.0	30.0	41.0
Indicator value	96.7%	96.8%	96.6%	96.7%	97.3%	97.3%	97.1%	97.7%

Licensee Comments: none

ERO Drill Participation

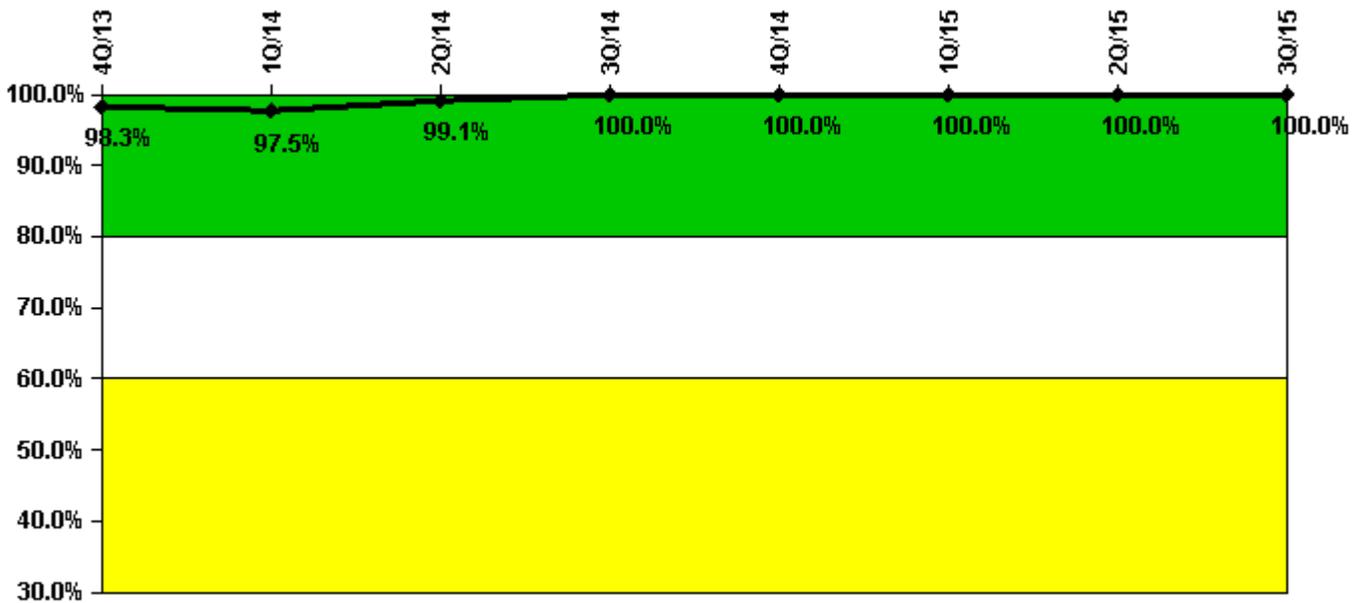


Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Participating Key personnel	116.0	117.0	111.0	116.0	120.0	116.0	119.0	125.0
Total Key personnel	118.0	120.0	112.0	116.0	120.0	116.0	119.0	125.0
Indicator value	98.3%	97.5%	99.1%	100.0%	100.0%	100.0%	100.0%	100.0%

Licensee Comments: none

Alert & Notification System

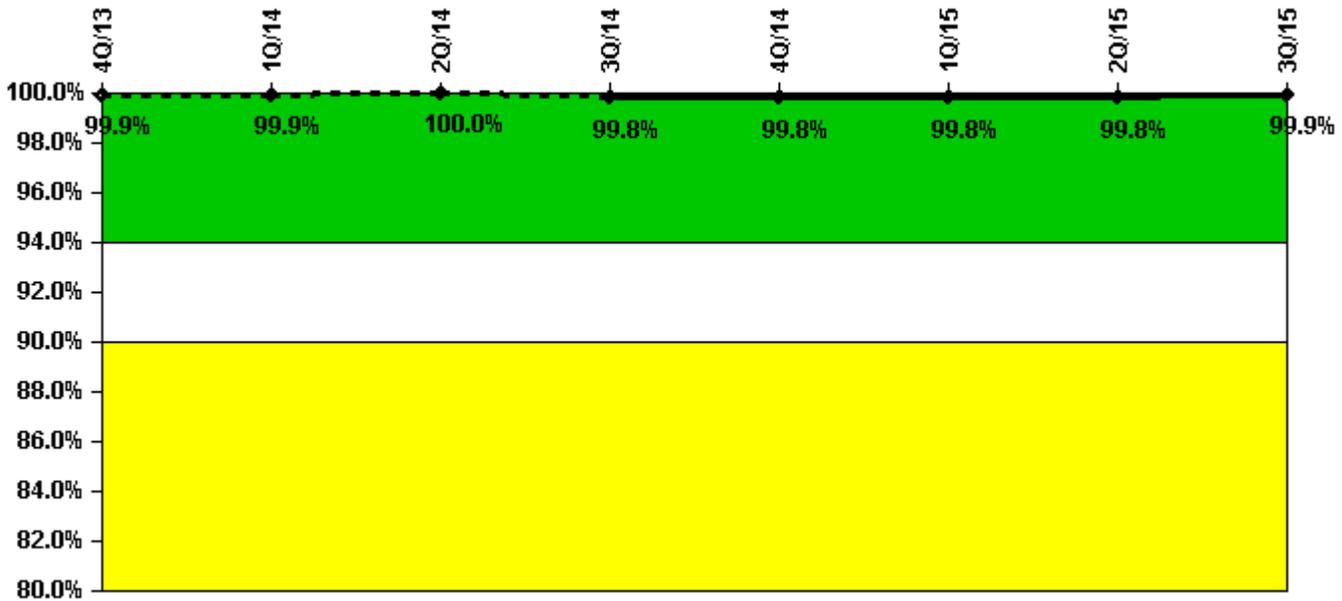


Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
Successful siren-tests	497	497	497	494	497	497	497	496
Total sirens-tests	497	497	497	497	497	497	497	497
Indicator value	99.9%	99.9%	100.0%	99.8%	99.8%	99.8%	99.8%	99.9%

Licensee Comments: none

Occupational Exposure Control Effectiveness

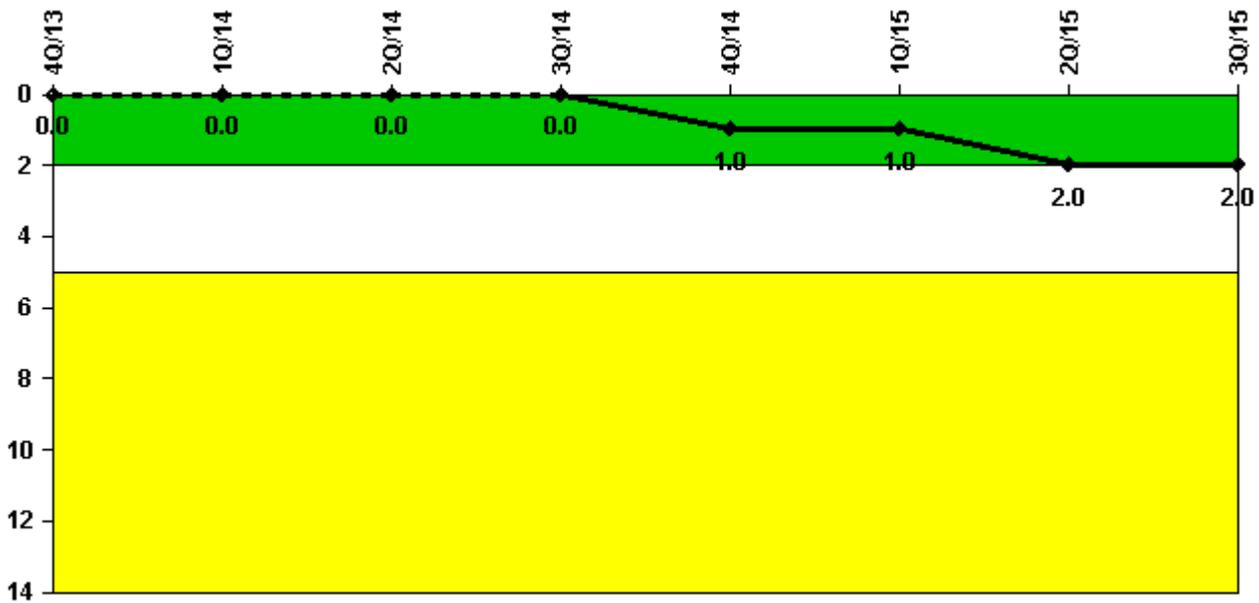


Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
High radiation area occurrences	0	0	0	0	1	0	1	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	0	0	0	0	1	1	2	2

Licensee Comments: none

RETS/ODCM Radiological Effluent

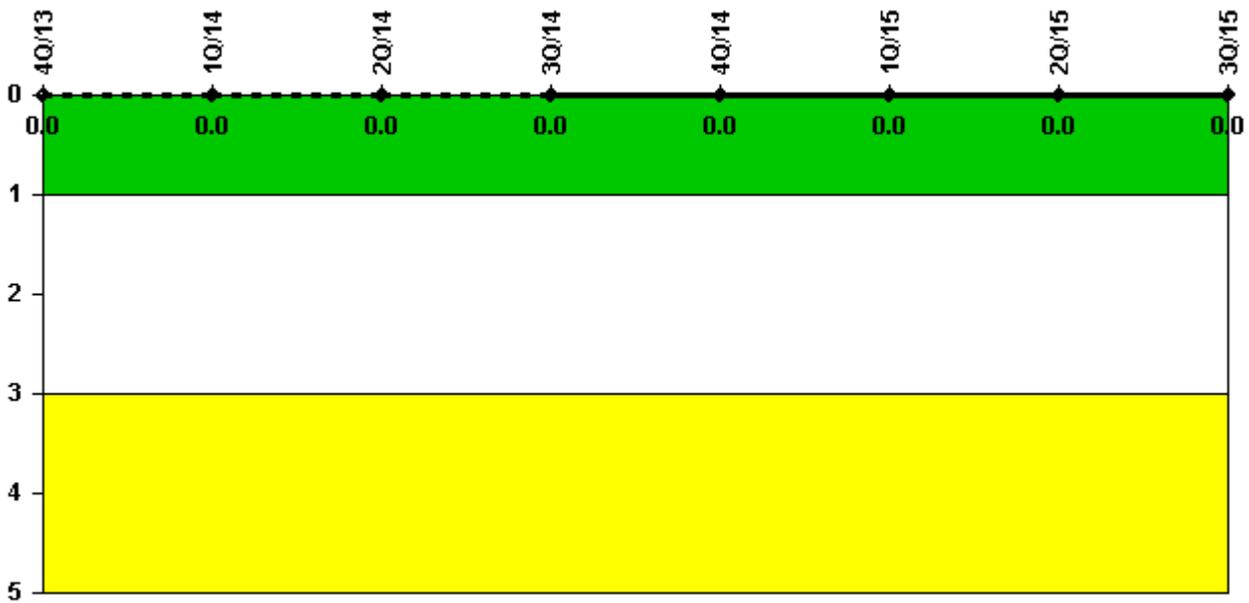

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	4Q/13	1Q/14	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	0							

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

 [Action Matrix Summary](#) | [Inspection Findings Summary](#) | [PI Summary](#) | [Reactor Oversight Process](#)

Last Modified: December 15, 2015