Dresden 2

1Q/2016 Performance Indicators

The solid trend line represents the current reporting period.

Licensee's General Comments: none

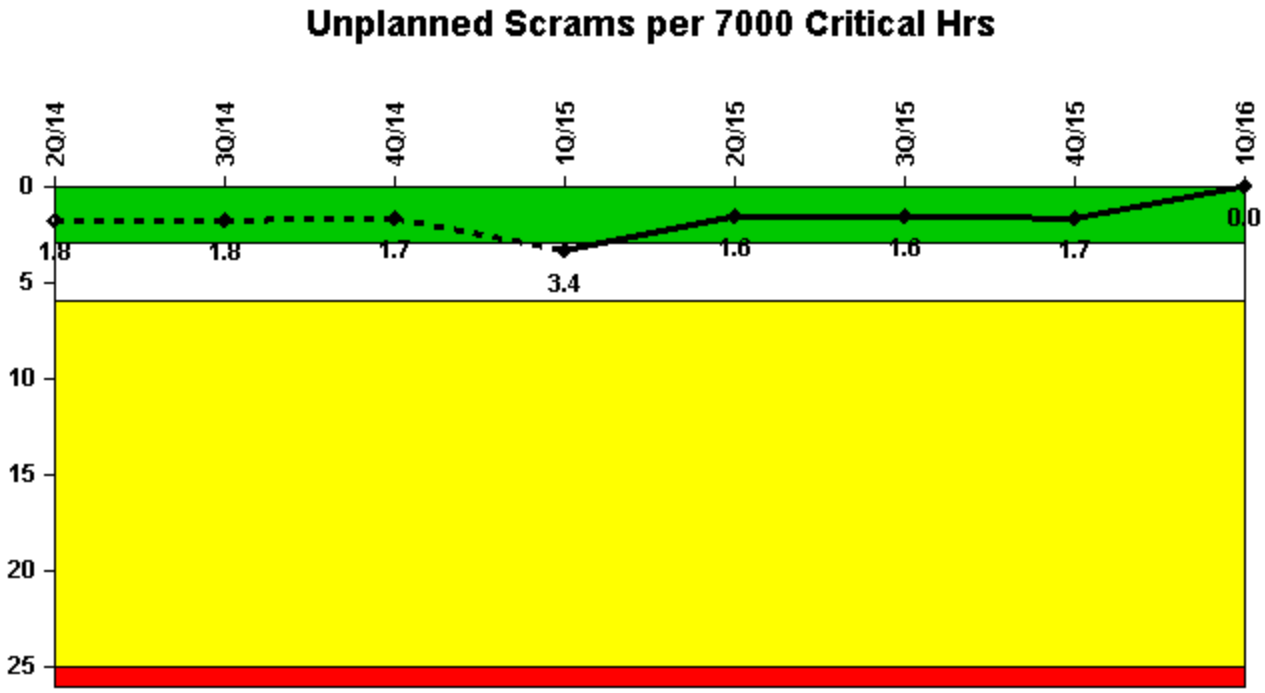

Thresholds: White > 3.0 Yellow > 6.0 Red > 25.0

Notes

Unplanned Scrams per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned scrams	2.0	0	0	2.0	0	0	0	0
Critical hours	1822.7	2208.0	2209.0	1998.0	2184.0	2208.0	1779.6	2183.0
Indicator value	**1.8**	**1.8**	**1.7**	**3.4**	**1.6**	**1.6**	**1.7**	**0**

Licensee Comments: none

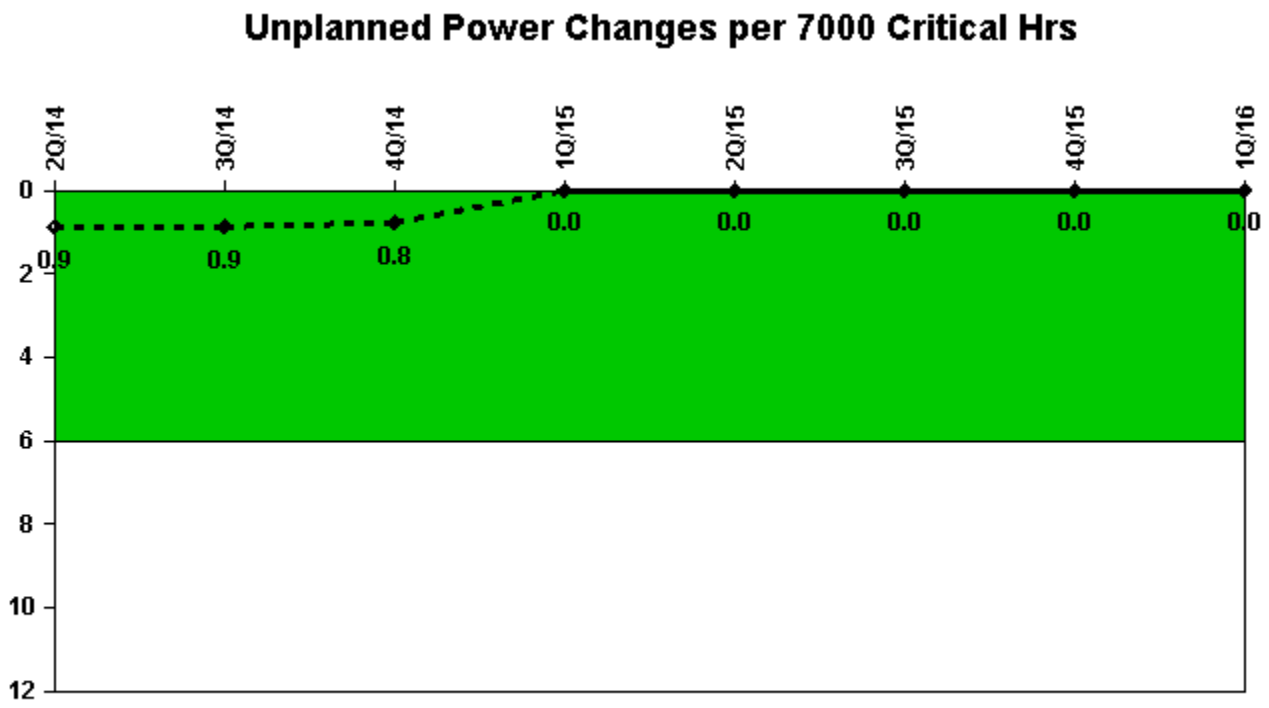

Thresholds: White > 6.0

Notes

Unplanned Power Changes per 7000 Critical Hrs	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Unplanned power changes	0	0	0	0	0	0	0	0
Critical hours	1822.7	2208.0	2209.0	1998.0	2184.0	2208.0	1779.6	2183.0
Indicator value	**0.9**	**0.9**	**0.8**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

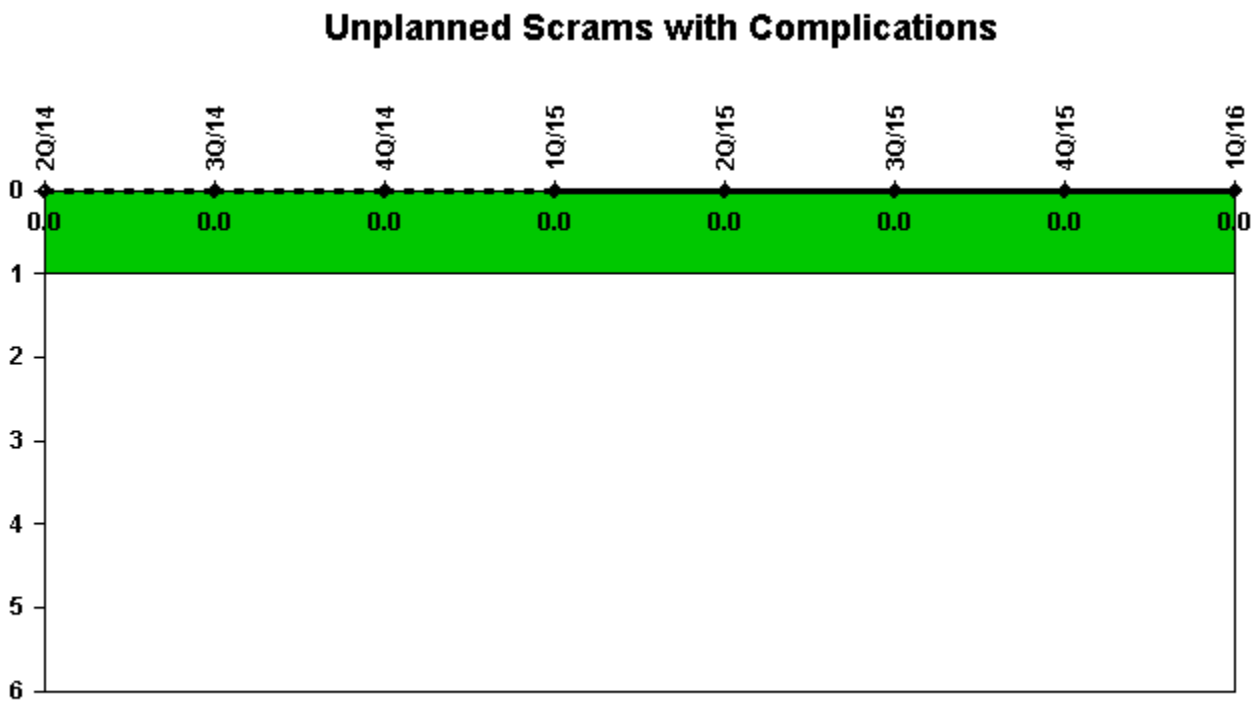

Thresholds: White > 1.0

Notes

Unplanned Scrams with Complications	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Scrams with complications	0	0	0	0	0	0	0	0
Indicator value	**0.0**	**0.0**	**0.0**	**0.0**	**0.0**	**0.0**	**0.0**	**0.0**

Licensee Comments: none

Safety System Functional Failures (BWR)

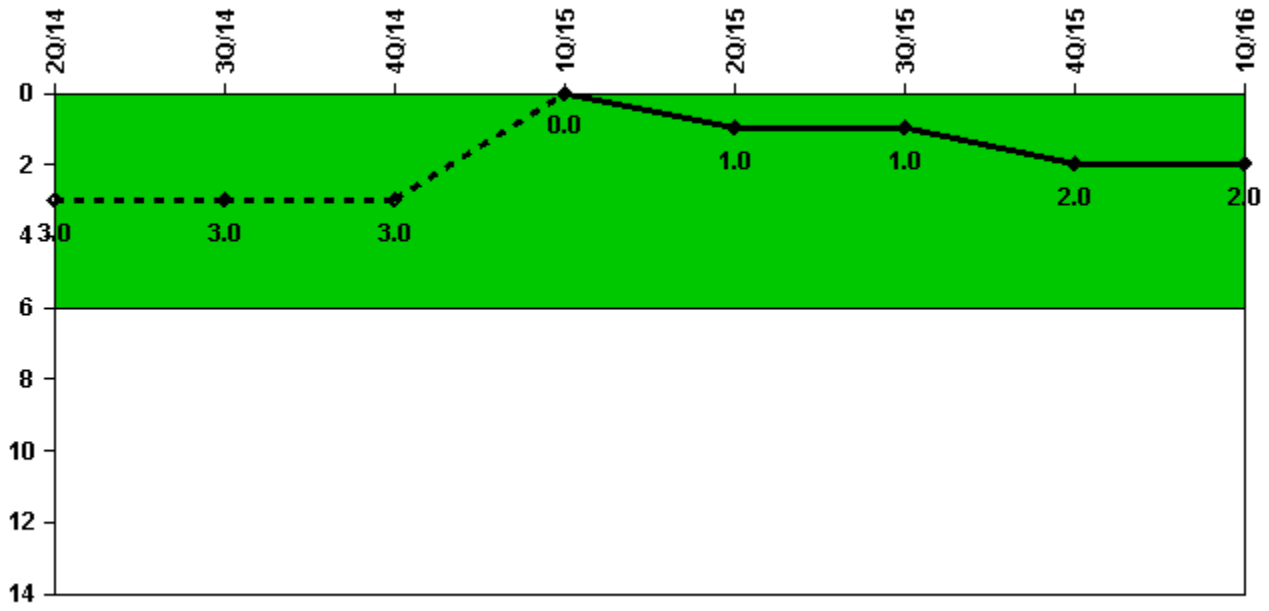

Thresholds: White > 6.0

Notes

Safety System Functional Failures (BWR)	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Safety System Functional Failures	0	0	0	0	1	0	1	0
Indicator value	**3**	**3**	**3**	**0**	**1**	**1**	**2**	**2**

Licensee Comments:

4Q/15: LER 237/2015-003-00 Unit 2 Turbine Building to Reactor Building Interlock Doors Open Simultaneously, dated 10/30/15

2Q/15: LER 237-2015-002-00,"2C ERV Failed to Actuate during Extent of Condition Testing", dated 04-03-2015

Mitigating Systems Performance Index, Emergency AC Power System

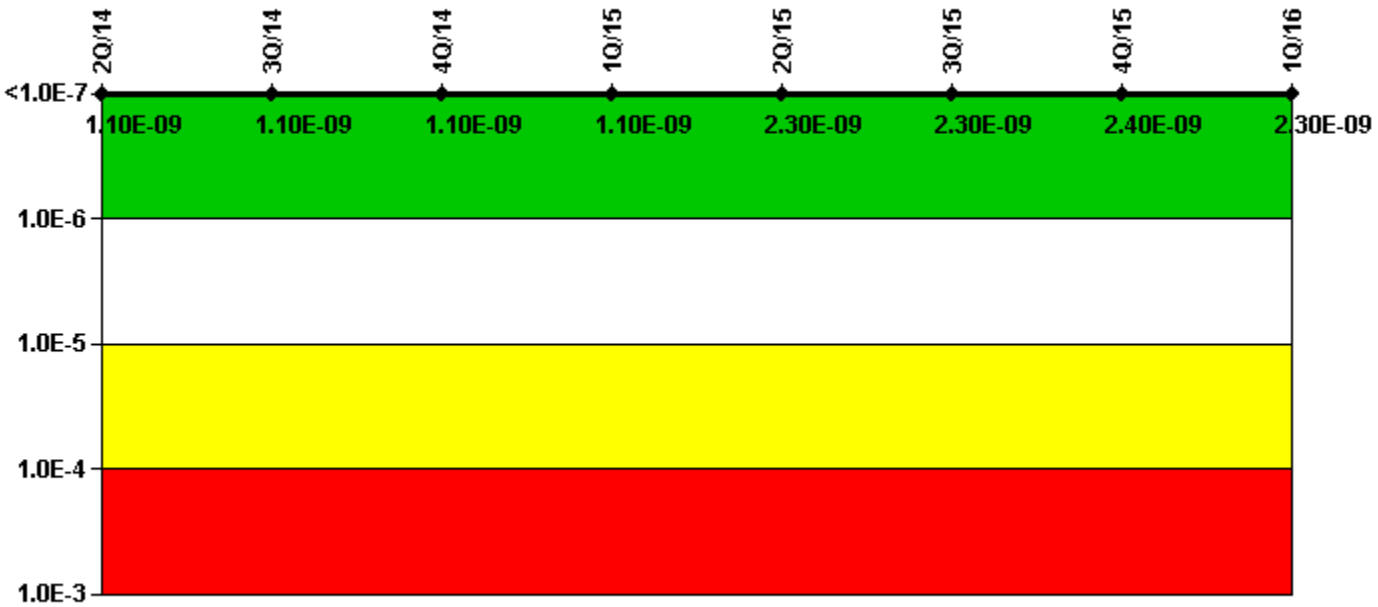

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Emergency AC Power System	**2Q/14**	**3Q/14**	**4Q/14**	**1Q/15**	**2Q/15**	**3Q/15**	**4Q/15**	**1Q/16**
UAI (ΔCDF)	3.53E-10	5.96E-11	-2.38E-11	1.75E-11	2.31E-10	2.01E-10	2.67E-10	2.76E-10
URI (ΔCDF)	7.51E-10	1.09E-09	1.08E-09	1.07E-09	2.11E-09	2.12E-09	2.09E-09	2.02E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	**1.10E-09**	**1.10E-09**	**1.10E-09**	**1.10E-09**	**2.30E-09**	**2.30E-09**	**2.40E-09**	**2.30E-09**

Licensee Comments: none

Mitigating Systems Performance Index, High Pressure Injection System

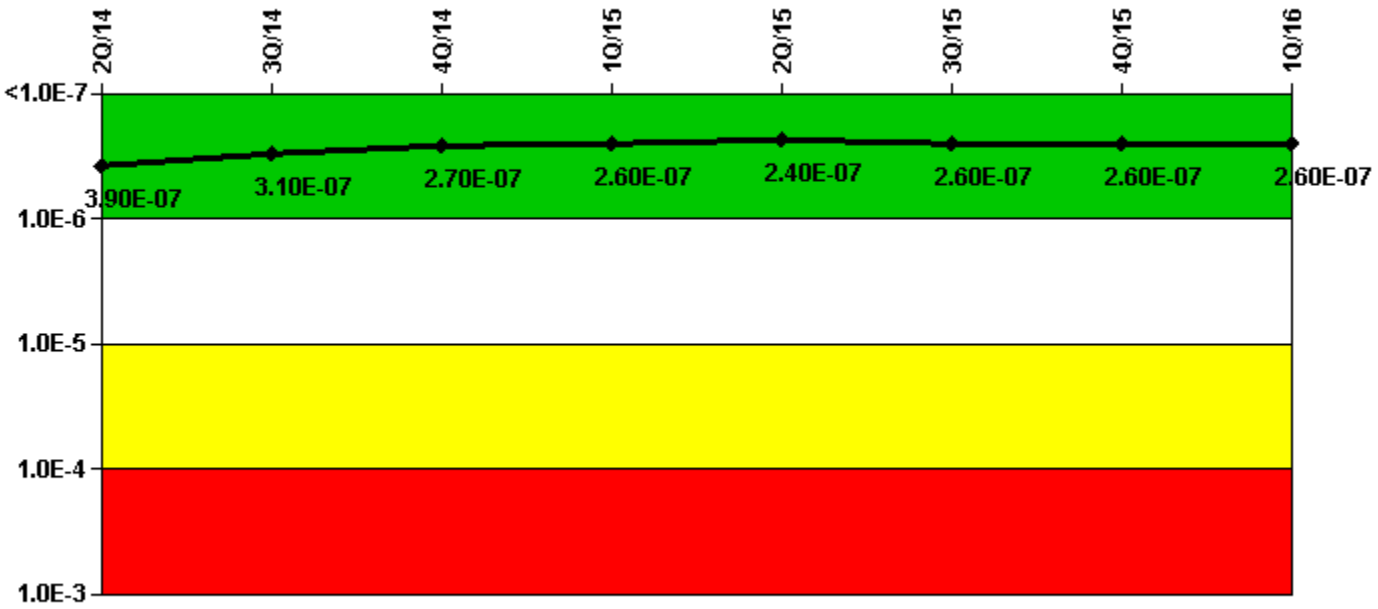

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, High Pressure Injection System	**2Q/14**	**3Q/14**	**4Q/14**	**1Q/15**	**2Q/15**	**3Q/15**	**4Q/15**	**1Q/16**
UAI (ΔCDF)	1.83E-07	1.09E-07	6.97E-08	6.76E-08	4.11E-08	6.30E-08	6.26E-08	6.25E-08
URI (ΔCDF)	2.04E-07	2.04E-07	2.04E-07	1.97E-07	1.97E-07	1.97E-07	1.97E-07	1.97E-07
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	**3.90E-07**	**3.10E-07**	**2.70E-07**	**2.60E-07**	**2.40E-07**	**2.60E-07**	**2.60E-07**	**2.60E-07**

Licensee Comments: none

Mitigating Systems Performance Index, Heat Removal System

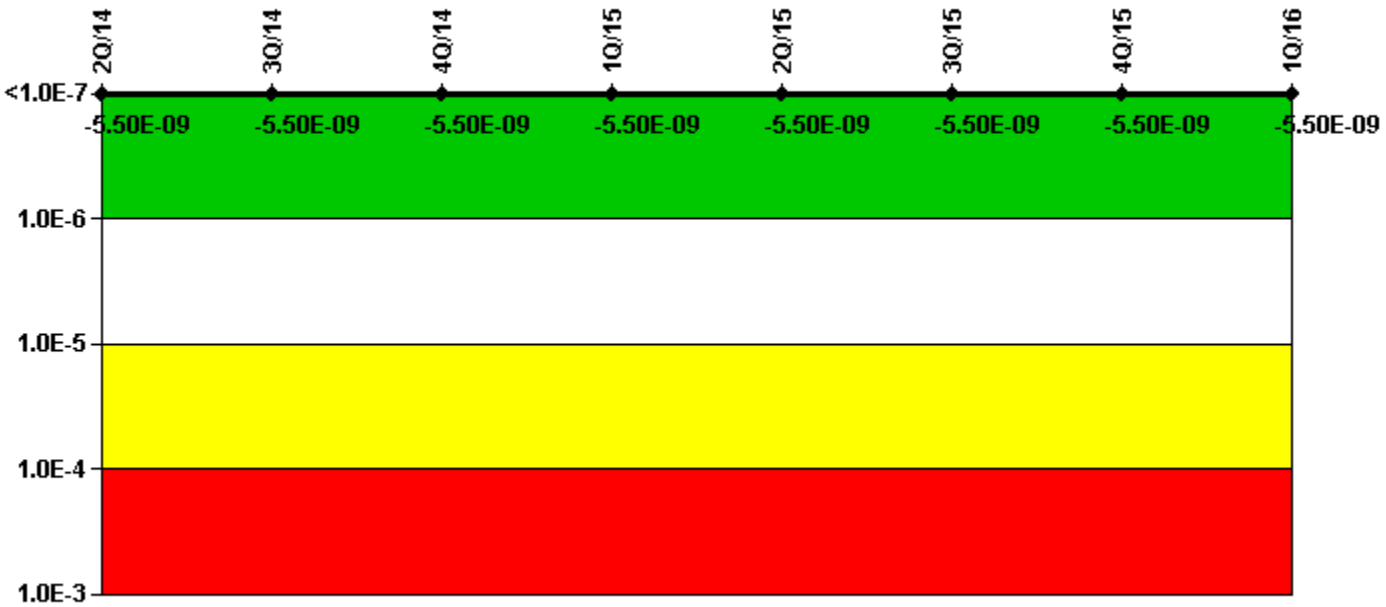

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Heat Removal System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
UAI (ΔCDF)	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09	-5.43E-09
URI (ΔCDF)	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10	-1.01E-10
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**	**-5.50E-09**

Licensee Comments: none

Mitigating Systems Performance Index, Residual Heat Removal System

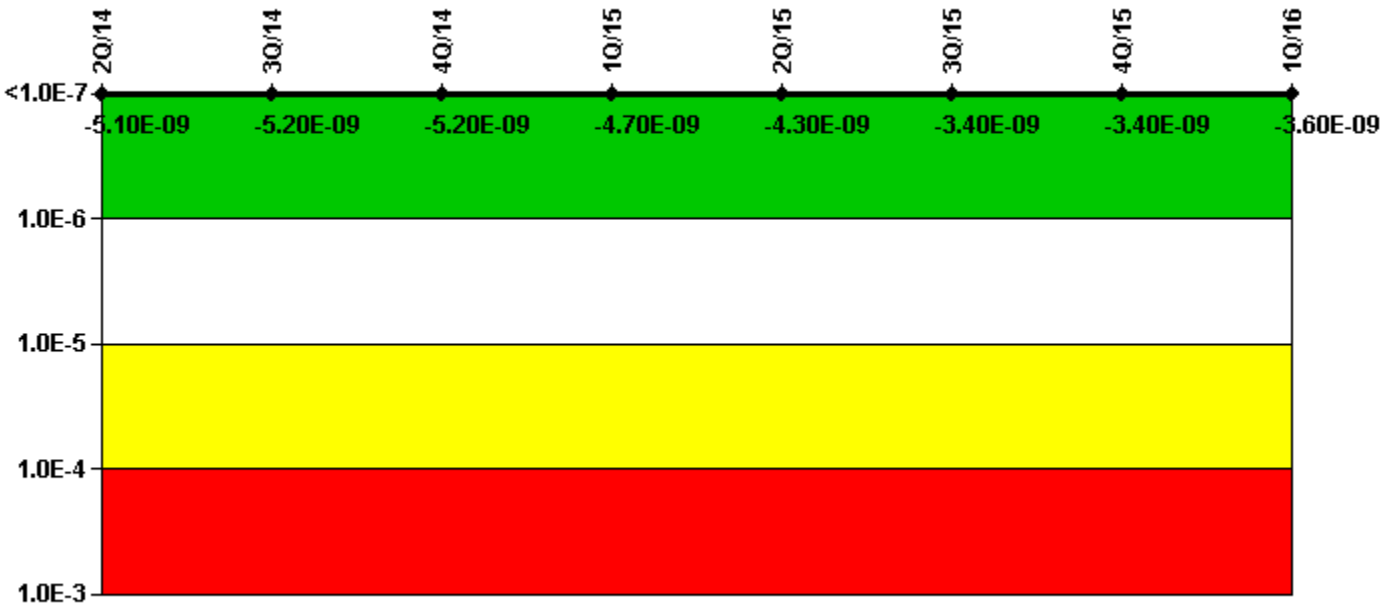

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Residual Heat Removal System	**2Q/14**	**3Q/14**	**4Q/14**	**1Q/15**	**2Q/15**	**3Q/15**	**4Q/15**	**1Q/16**
UAI (ΔCDF)	-1.40E-09	-1.40E-09	-1.40E-09	-7.19E-10	-2.50E-10	8.26E-10	1.02E-09	8.71E-10
URI (ΔCDF)	-3.67E-09	-3.78E-09	-3.84E-09	-3.96E-09	-4.08E-09	-4.24E-09	-4.39E-09	-4.45E-09
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	**-5.10E-09**	**-5.20E-09**	**-5.20E-09**	**-4.70E-09**	**-4.30E-09**	**-3.40E-09**	**-3.40E-09**	**-3.60E-09**

Licensee Comments: none

Mitigating Systems Performance Index, Cooling Water Systems

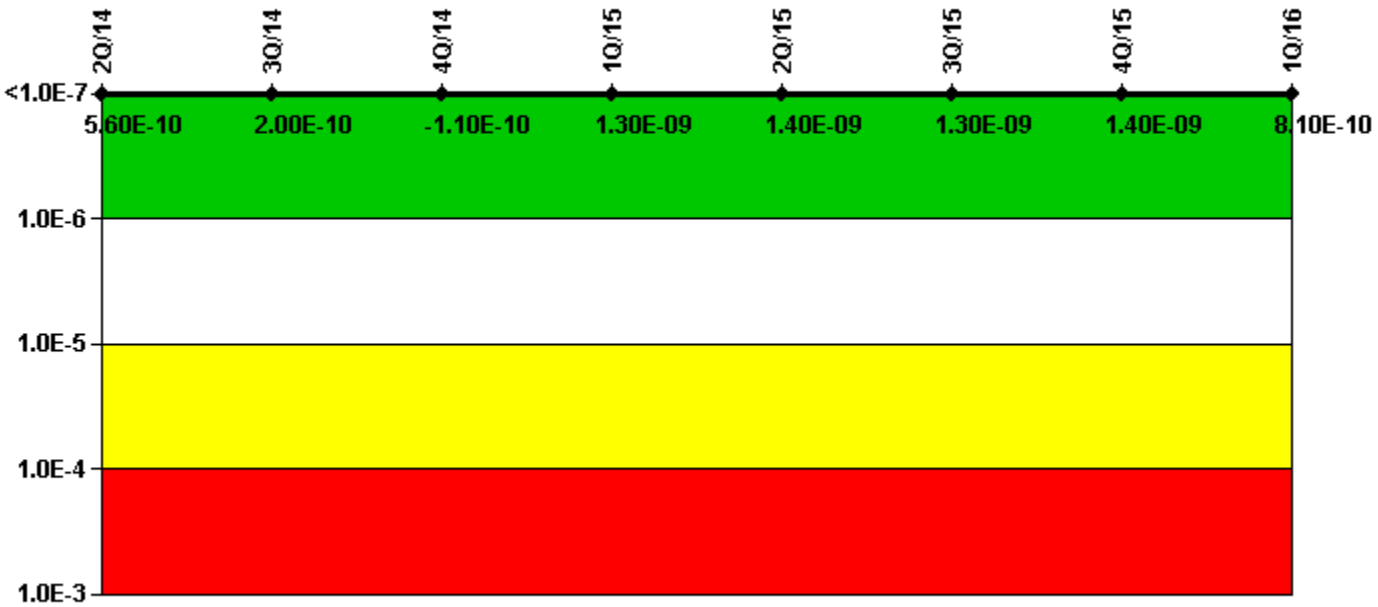

Thresholds: White > 1.00E-6 Yellow > 1.00E-5 Red > 1.00E-4

Notes

Mitigating Systems Performance Index, Cooling Water Systems	**2Q/14**	**3Q/14**	**4Q/14**	**1Q/15**	**2Q/15**	**3Q/15**	**4Q/15**	**1Q/16**
UAI (ΔCDF)	5.92E-10	2.27E-10	-8.03E-11	1.36E-09	1.39E-09	1.36E-09	1.39E-09	8.33E-10
URI (ΔCDF)	-2.79E-11	-2.79E-11	-2.74E-11	-2.74E-11	-2.75E-11	-2.73E-11	-2.74E-11	-2.74E-11
PLE	NO	NO	NO	NO	NO	NO	NO	NO
Indicator value	**5.60E-10**	**2.00E-10**	**-1.10E-10**	**1.30E-09**	**1.40E-09**	**1.30E-09**	**1.40E-09**	**8.10E-10**

Licensee Comments: none

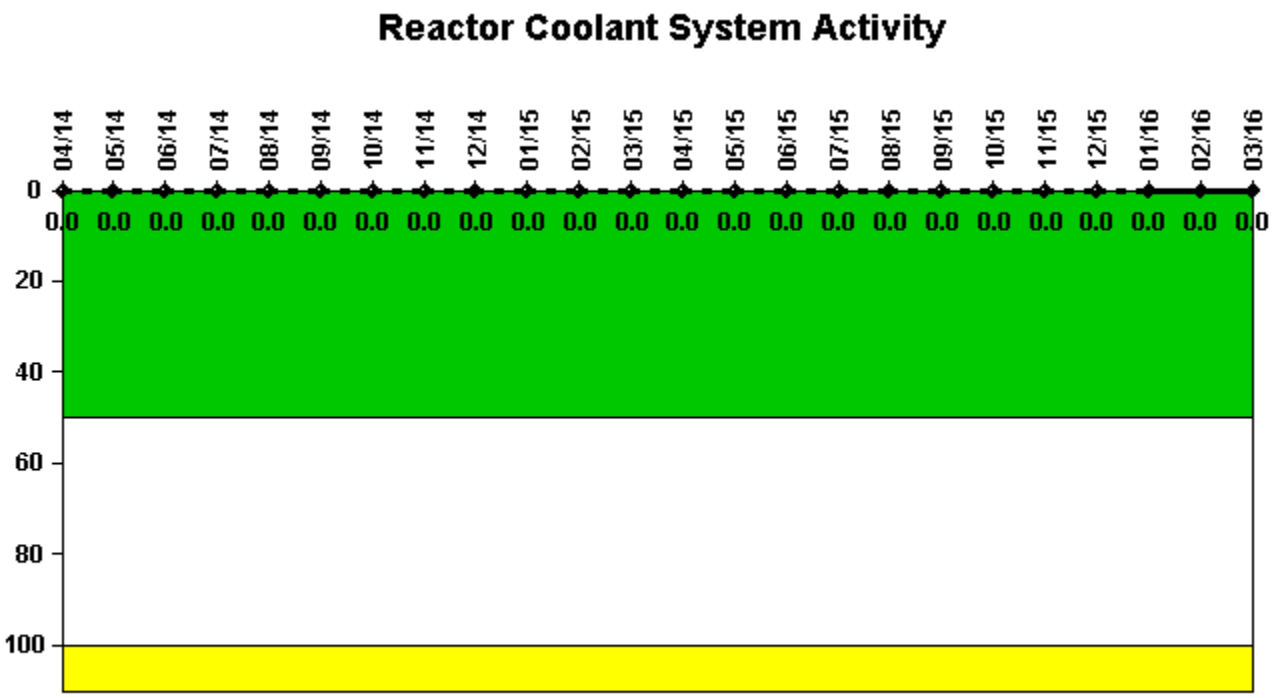

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Activity	**4/14**	**5/14**	**6/14**	**7/14**	**8/14**	**9/14**	**10/14**	**11/14**	**12/14**	**1/15**	**2/15**	**3/15**
Maximum activity	0.000027	0.000011	0.000005	0.000006	0.000005	0.000007	0.000011	0.000006	0.000008	0.000005	0.000007	0.000008
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**
Reactor Coolant System Activity	**4/15**	**5/15**	**6/15**	**7/15**	**8/15**	**9/15**	**10/15**	**11/15**	**12/15**	**1/16**	**2/16**	**3/16**
Maximum activity	0.000007	0.000006	0.000007	0.000006	0.000007	0.000008	0.000010	0.000004	0.000003	0.000003	0.000004	0.000002
Technical specification limit	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2	0.2
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

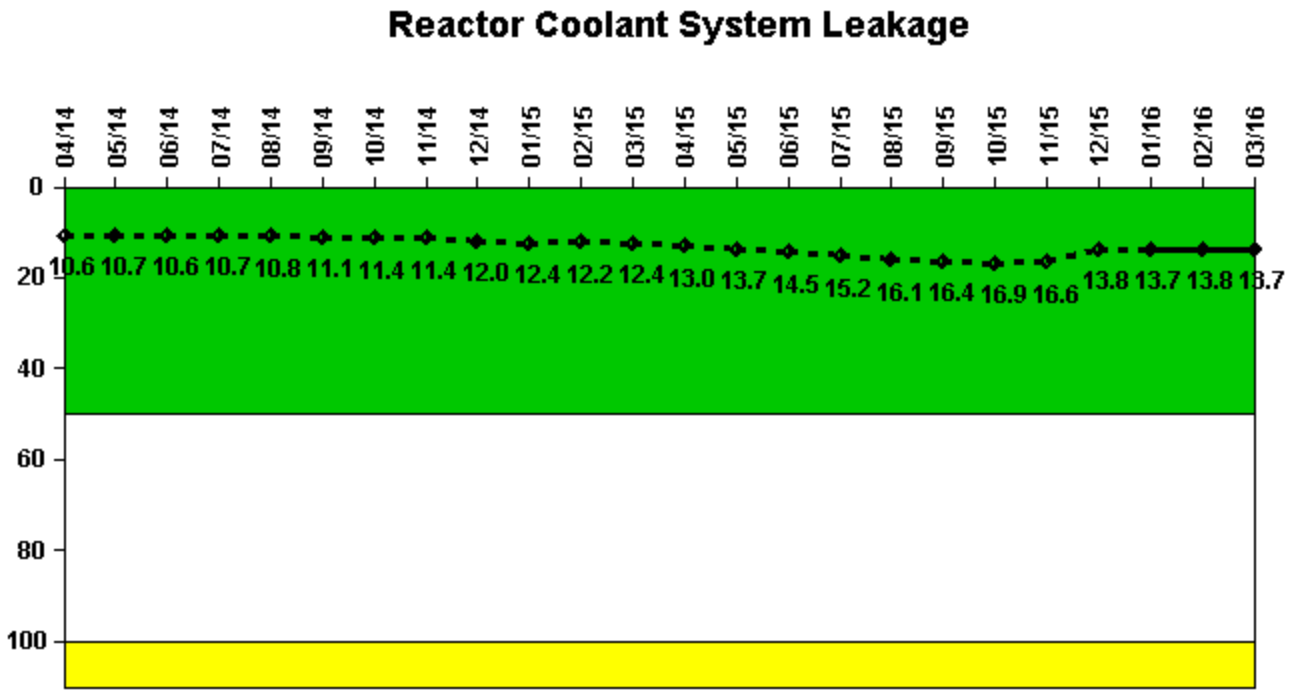

Thresholds: White > 50.0 Yellow > 100.0

Notes

Reactor Coolant System Leakage	**4/14**	**5/14**	**6/14**	**7/14**	**8/14**	**9/14**	**10/14**	**11/14**	**12/14**	**1/15**	**2/15**	**3/15**
Maximum leakage	2.640	2.670	2.643	2.672	2.712	2.775	2.840	2.840	3.003	3.093	3.042	3.095
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	**10.6**	**10.7**	**10.6**	**10.7**	**10.8**	**11.1**	**11.4**	**11.4**	**12.0**	**12.4**	**12.2**	**12.4**
Reactor Coolant System Leakage	**4/15**	**5/15**	**6/15**	**7/15**	**8/15**	**9/15**	**10/15**	**11/15**	**12/15**	**1/16**	**2/16**	**3/16**
Maximum leakage	3.262	3.434	3.630	3.808	4.030	4.088	4.219	4.144	3.444	3.413	3.440	3.430
Technical specification limit	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0	25.0
Indicator value	**13.0**	**13.7**	**14.5**	**15.2**	**16.1**	**16.4**	**16.9**	**16.6**	**13.8**	**13.7**	**13.8**	**13.7**

Licensee Comments: none

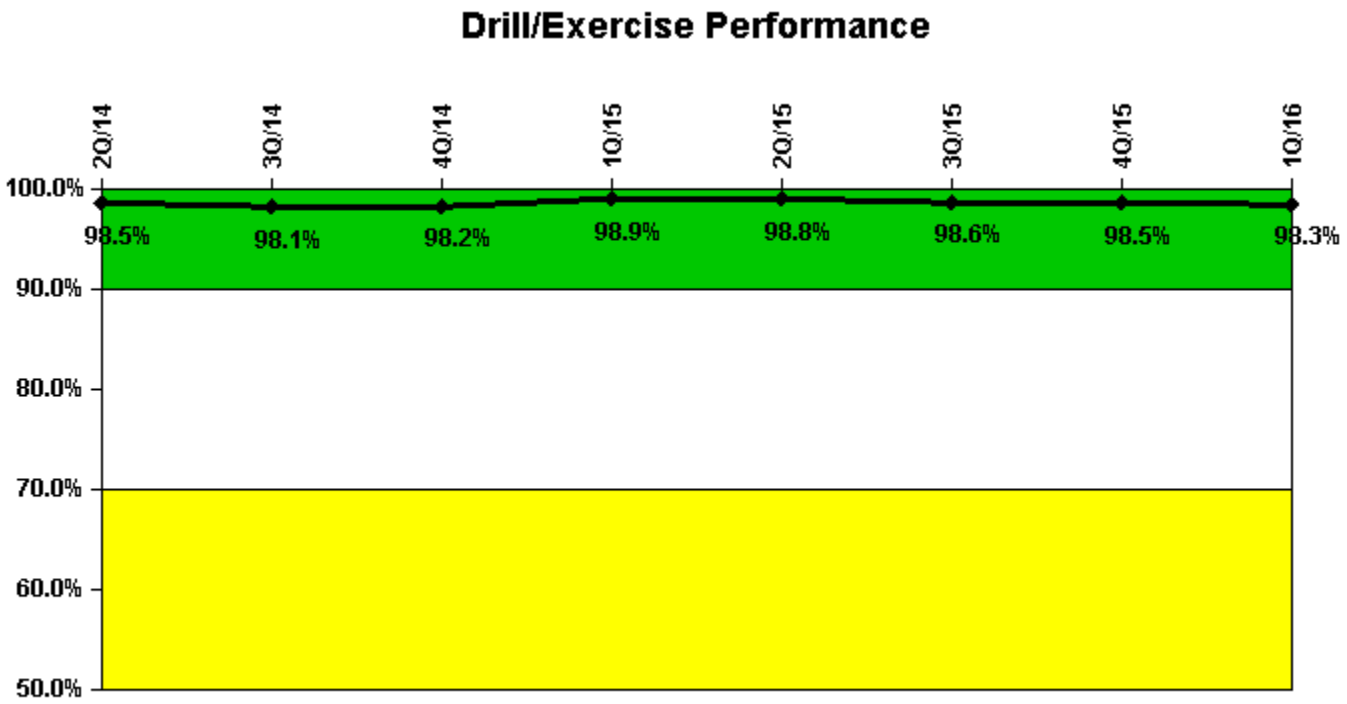

Thresholds: White < 90.0% Yellow < 70.0%

Notes

Drill/Exercise Performance	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful opportunities	79.0	61.0	40.0	47.0	65.0	44.0	27.0	31.0
Total opportunities	80.0	63.0	40.0	47.0	67.0	45.0	27.0	32.0
Indicator value	**98.5%**	**98.1%**	**98.2%**	**98.9%**	**98.8%**	**98.6%**	**98.5%**	**98.3%**

Licensee Comments: none

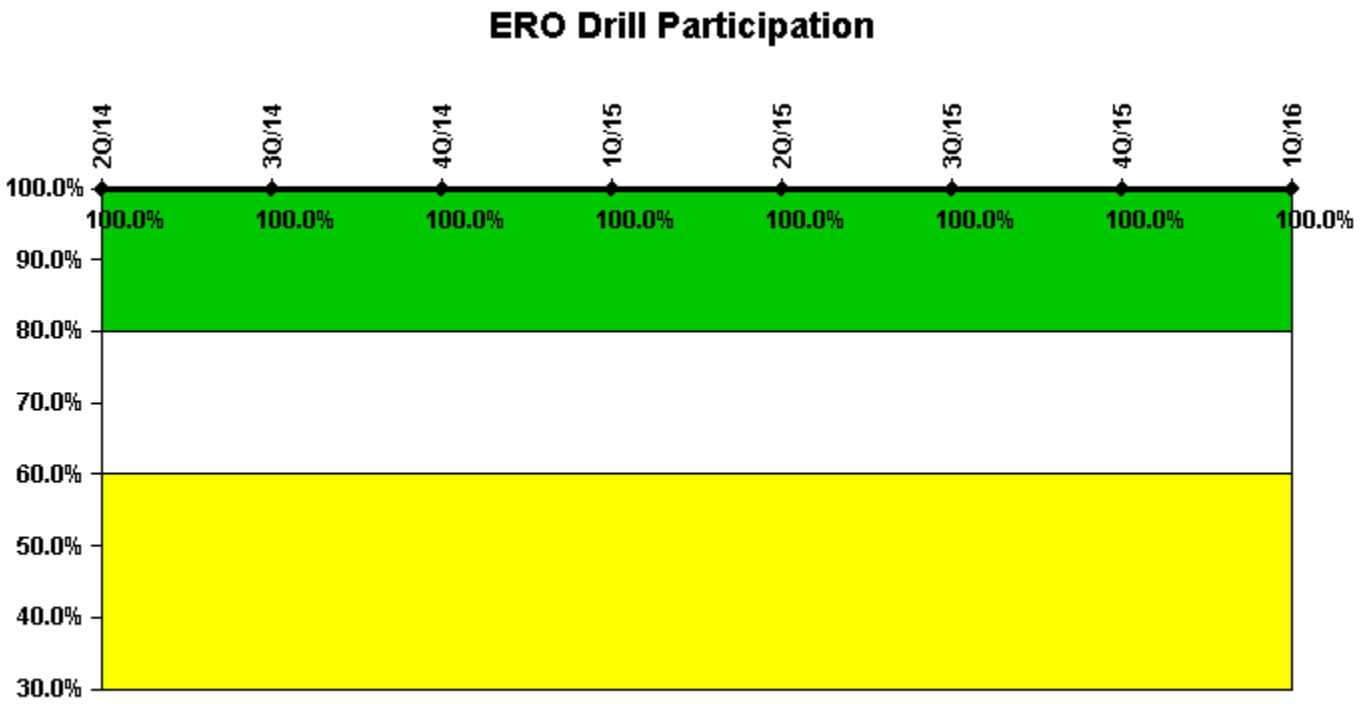

Thresholds: White < 80.0% Yellow < 60.0%

Notes

ERO Drill Participation	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Participating Key personnel	78.0	78.0	78.0	72.0	75.0	72.0	77.0	70.0
Total Key personnel	78.0	78.0	78.0	72.0	75.0	72.0	77.0	70.0
Indicator value	**100.0%**	**100.0%**	**100.0%**	**100.0%**	**100.0%**	**100.0%**	**100.0%**	**100.0%**

Licensee Comments: none

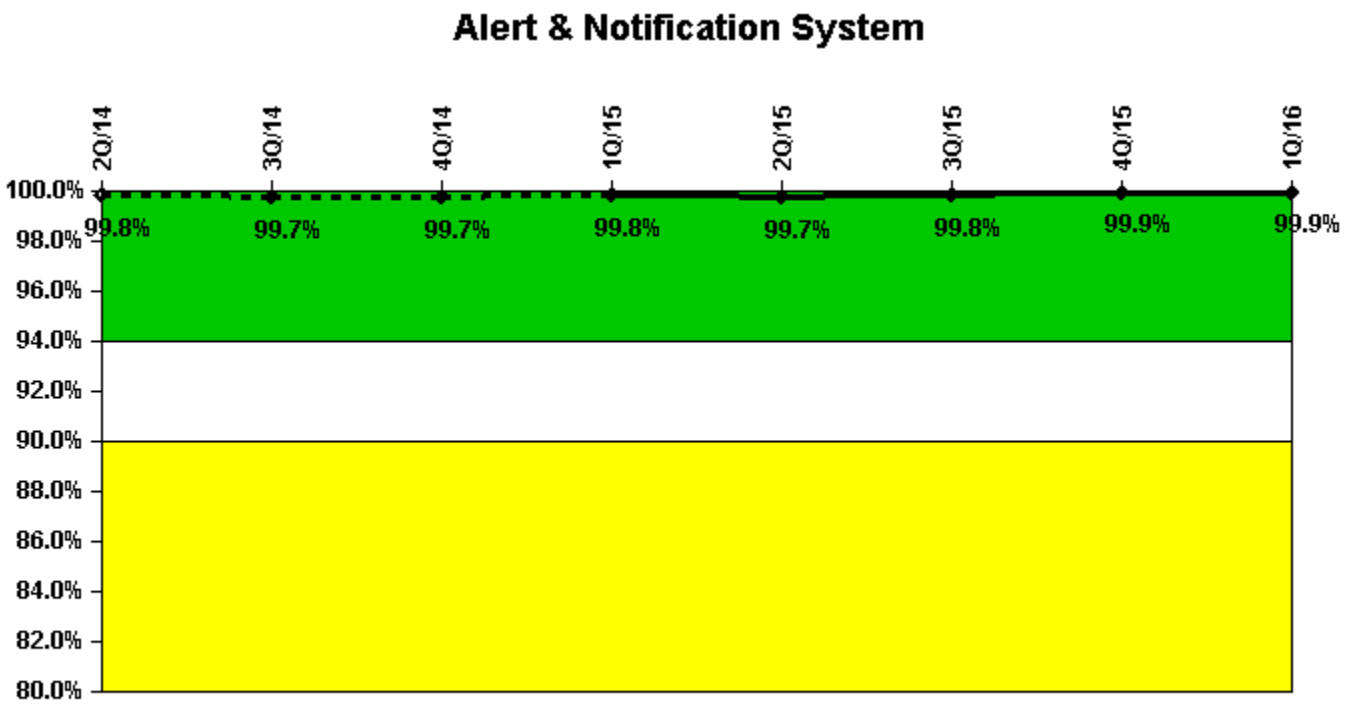

Thresholds: White < 94.0% Yellow < 90.0%

Notes

Alert & Notification System	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
Successful siren-tests	2939	2928	2940	2895	2937	2985	2943	2942
Total sirens-tests	2944	2944	2944	2898	2944	2990	2944	2944
Indicator value	**99.8%**	**99.7%**	**99.7%**	**99.8%**	**99.7%**	**99.8%**	**99.9%**	**99.9%**

Licensee Comments: none

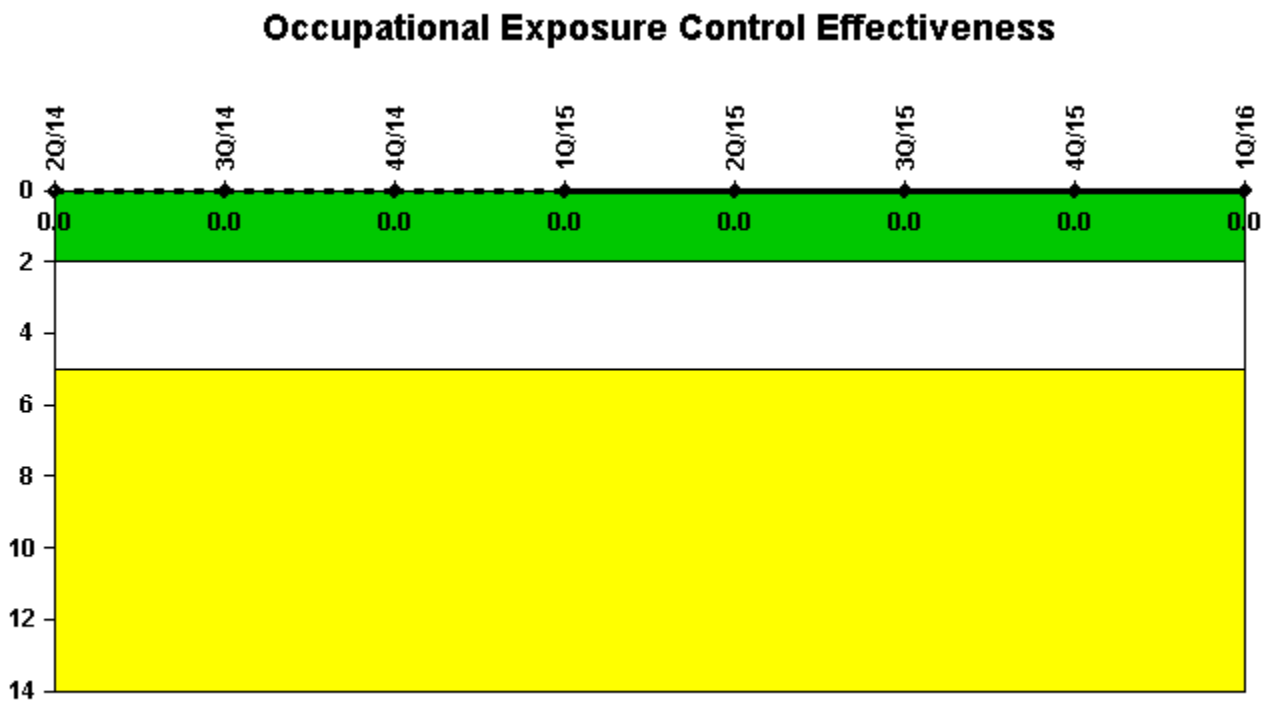

Thresholds: White > 2.0 Yellow > 5.0

Notes

Occupational Exposure Control Effectiveness	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
High radiation area occurrences	0	0	0	0	0	0	0	0
Very high radiation area occurrences	0	0	0	0	0	0	0	0
Unintended exposure occurrences	0	0	0	0	0	0	0	0
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

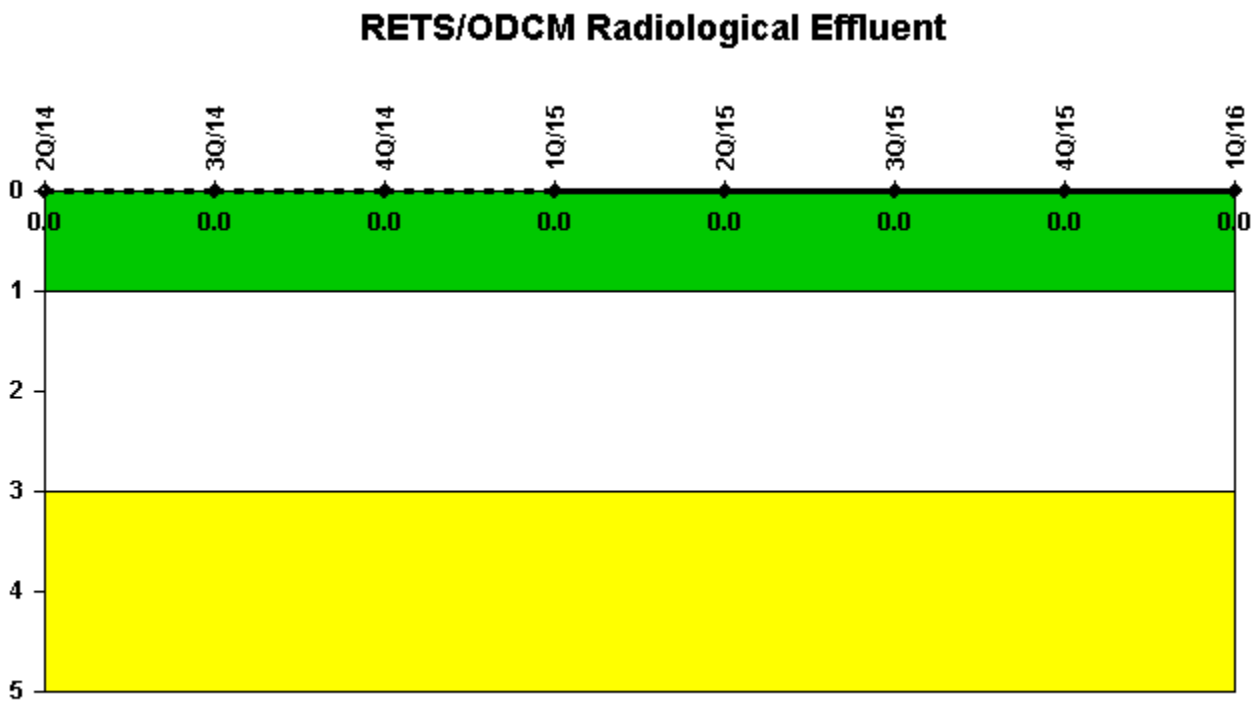

Thresholds: White > 1.0 Yellow > 3.0

Notes

RETS/ODCM Radiological Effluent	2Q/14	3Q/14	4Q/14	1Q/15	2Q/15	3Q/15	4Q/15	1Q/16
RETS/ODCM occurrences	0	0	0	0	0	0	0	0
Indicator value	**0**	**0**	**0**	**0**	**0**	**0**	**0**	**0**

Licensee Comments: none

Although the Security Cornerstone is included in the Reactor Oversight Process assessment program, the Commission has decided that specific information related to findings and performance indicators pertaining to the Security Cornerstone will not be publicly available to ensure that security information is not provided to a possible adversary. Other than the fact that a finding or performance indicator is Green or Greater-Than-Green, security related information will not be displayed on the public web page.

Action Matrix Summary | Inspection Findings Summary | PI Summary | Reactor Oversight Process

Last Modified: April 23, 2016